



Optimizing nitrification in biological rapid sand filters for drinking water production

Albrechtsen, Hans-Jørgen; Smets, Barth F.; Lee, Carson Odell; Tatari, Karolina; Nielsen, P. B.; Binning, Philip John; Boe-Hansen, Rasmus; Wagner, Florian Benedikt

Publication date:
2016

Document Version
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

Citation (APA):
Albrechtsen, H.-J., Smets, B. F., Lee, C. O., Tatari, K., Nielsen, P. B., Binning, P. J., Boe-Hansen, R., & Wagner, F. B. (2016). *Optimizing nitrification in biological rapid sand filters for drinking water production*. Abstract from World Water Congress & Exhibition 2016, Brisbane, Australia.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

IWA World Water Congress & Exhibition 2016



www.worldwatercongress.org

Congress Programme & Exhibition Catalogue

09 - 14 OCTOBER, 2016
BRISBANE, QUEENSLAND, AUSTRALIA



Principal Sponsor



Australian Government



Platinum Sponsors



Dedicated to a better Brisbane



Optimizing nitrification in biological rapid sand filters for drinking water production

H-J Albrechtsen*, BF. Smets*, CO. Lee*, K Tatari*, PB Nielsen**, PJ. Binning*, R Boe-Hansen**, FB Wagner*

* DTU Environment, Technical University of Denmark, Department of Environmental Engineering, Bygningstorvet, Building 115, 2800 Kgs. Lyngby, hana@env.dtu.dk.

** Krüger A/S, Gladsaxevej 363, DK-2860 Søborg

Abstract: Addition of phosphate or trace metals or better management e.g. in terms of ammonium load can improve the nitrification rate and efficiency in biological rapid sand filters.

Keywords: Nitrification; phosphate; tracemetals

Introduction

Nitrification as a mean to remove ammonium (NH_4^+) is essential in most groundwater based water works, and biological rapid sand filtering is a very wide spread approach. However, the nitrification may not start sufficiently fast in new filters or may not remove ammonium to sufficiently low concentrations to reach guideline values or even worse – the nitrification may be incomplete, leading to accumulation of the toxic intermediate nitrite (NO_2^-). Efficient nitrification in the filters is also imperative to avoid unwanted microbial after growth, oxygen consumption, and formation of toxic nitrite (NO_2^-) in the distribution system.

Although nitrification is a well known process many of the underlying microbial processes in are poorly understood in the drinking water production. This limits the management of the filters and which can result in start-up problems and insufficient removal of the treated compounds. A deeper insight in the composition of the microbial communities (e.g. importance of AOB vs. AOA), the dominant nitrifying guilds, elimination of limiting factors such as micronutrients or tracemetals and an optimal management could all contribute to a better nitrification. The support material also plays a significant role (Gülay et al., 2014).

The aim of this research project was to optimize the nitrification in rapid sand filters.

Material and Methods

The nitrification was studied in laboratory- and pilot-scale packed columns, and in full-scale filters at several water works. To investigate for relation between NH_4^+ load and NH_4^+ removal rate, the NH_4^+ load was increased in short term upshifts in pilot-scale filter columns, operated with sand from a full-scale filter. When equilibrium was reached, the load was shifted down again to prevent alteration of the microbial community.

The effect of phosphate addition was investigated in pilot-scale packed column where the NH_4^+ loading rate was increased beyond the actual NH_4^+ removal capacity of the filters. Phosphate was added to one column but not to the control column (Lee, 2014). In a different experiment, phosphate was added to a full-scale filter with incomplete nitrification. Water was sampled over depth of the filter to study the distribution of the added nutrient, and its effect on NH_4^+ removal. Another study included two laboratory-scale columns (Fig. 1) (Tatari et al., 2013), packed with sand from another

full-scale filter with incomplete NH_4^+ removal. The NH_4^+ loading was varied and trace metals were added to one column, whereas the other column was control without addition. Selected trace metals were added to the respective full-scale filter to investigate the effect on full-scale nitrification.

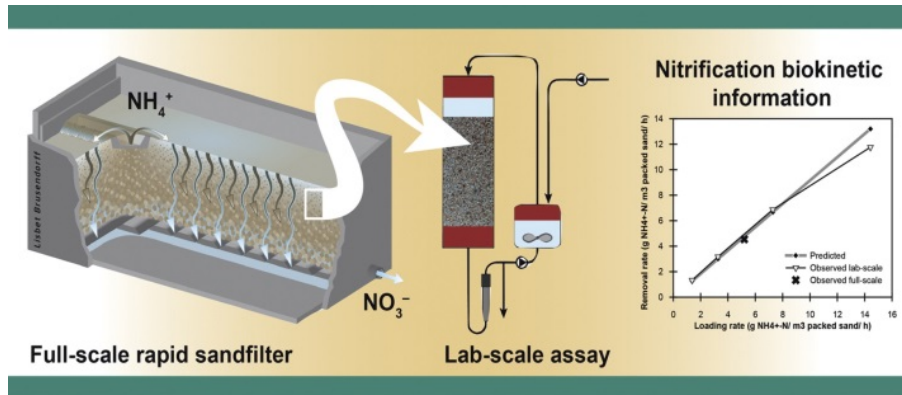


Figure 1 Depth specific samples of filter material was collected and investigated in the developed small scale columns to reveal biokinetic information on nitrification (Tatari et al., 2013).

Results and Conclusions

The short term upshifts of NH_4^+ load revealed that the filters have a substantial capacity in NH_4^+ removal and are able to deal with dynamic inflow concentrations (Fig. 2). There was no difference in the removal rate whether the load was increased by increased flow rate or increased concentration in the influent (Lee et al., 2014).

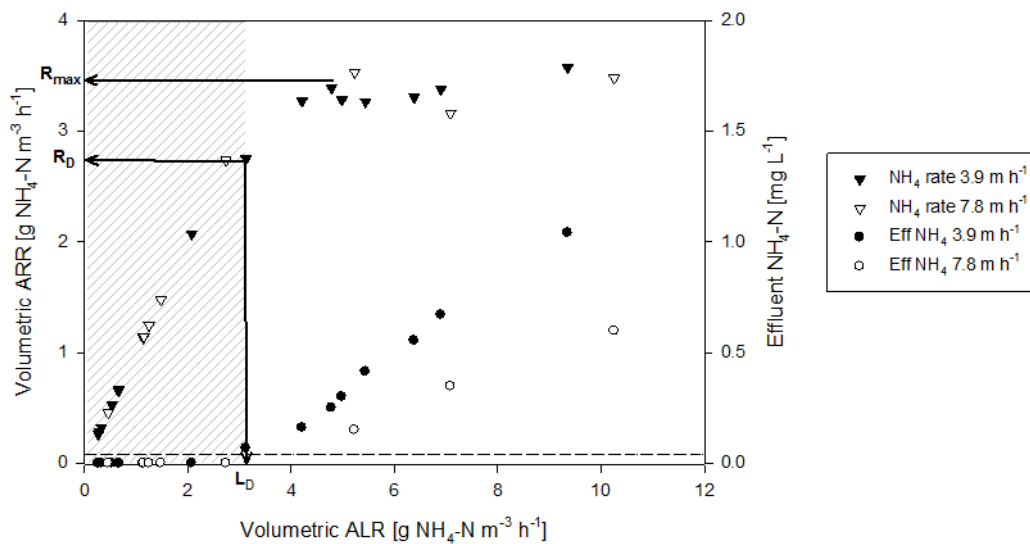


Figure 2 Safe operational window of nitrification (shaded are) where an increase in the ammonium load causes an adequate increase in the nitrification rate (Lee et al., 2014).

With sand from plant A, additional PO_4^{3-} did not result in increased removal rates compared to the control for all applied loading conditions. NH_4^+ removal rate increased over time in both columns (Fig. 3A) whereas with sand from plant B, NH_4^+ removal was substantially increased when PO_4^{3-} was added (Fig. 3B), with 57 %

higher removal at the end of the experiment compared to the control. Packed column lab- and pilot experiments showed that in some cases the addition of PO_4^{3-} to poorly performing RSF does clearly improve nitrification. However, it is also suggested that incomplete nitrification in RSF is not necessarily caused by a lack of nutrients (Lee, 2014).

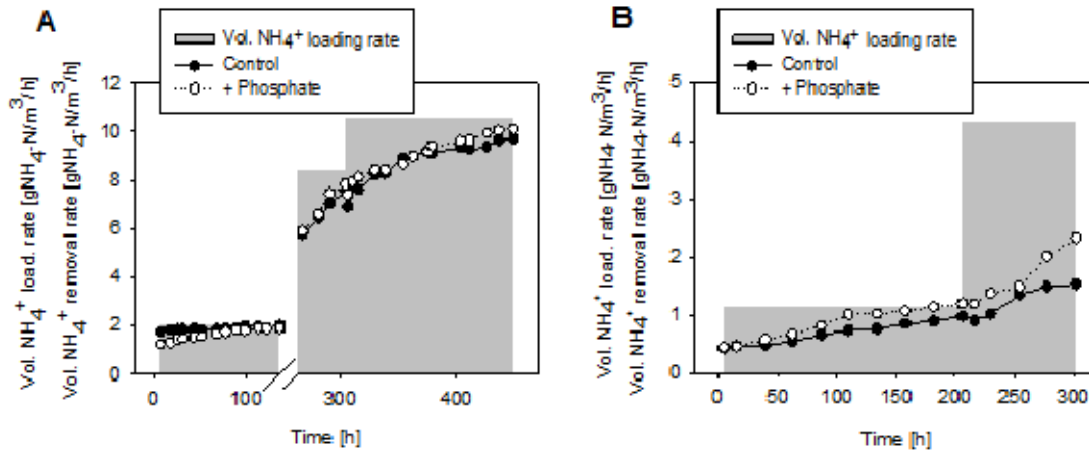


Figure 3 Applied volumetric NH_4^+ loading rate and achieved volumetric NH_4^+ removal rates during the lab-scale experiments with sand from plant A (A) and plant B (B).

In a laboratory-scale column NH_4^+ removal was higher when trace metals were added, compared to a control, especially at increased NH_4^+ loading rates. Addition of selected trace metals to a full scale biological rapid sand filter stimulated NH_4^+ removal rapidly, reducing the filter effluent NH_4^+ concentration until NH_4^+ was limiting (Wagner et al., 2014).

Overall, our findings demonstrate the possibility of using phosphorus or trace metals addition to overcome incomplete NH_4^+ removal, and to increase the NH_4^+ removal capacity in water works' biological filters.

Acknowledgments

This work was supported by the Danish Council for Strategic Research via the project DW Biofilters and by the UrbanWaterTech Research School. Further info is available at <http://www.dwbiofilters.dk>. The authors would like to thank the water treatment plants that participated in this study for their co-operation.

References

- Gülay, A.; Tatari, K.; Musovic, S.; Mateiu, R.; Albrechtsen, H.-J.; Smets, B.F. (2014) Internal porosity of mineral coating supports microbial activity in rapid sand filters for drinking water treatment. *Appl. Environ. Microbiol.*, **80**(22) 7101-7020.
- Lee, C.O. (2014). Processes effecting nitrification performance in biological rapid sand filters. PhD Thesis. Technical University of Denmark.
- Lee, C.O.; Boe-Hansen, R.; Musovic, S.; Smets, B.F.; Albrechtsen, H.-J.; Binning, P. (2014). Effects of dynamic operating conditions on nitrification in biological rapid sand filters for drinking water treatment. *Water Res.*, **64C**:226–236.

Tatari, K.; Smets, B.F.; Albrechtsen, H.-J. (2013) A novel bench-scale column assay to investigate site-specific nitrification biokinetics in biological rapid sandfilters. *Water Res.*, **47**(16):6380-6387.

Wagner F.B., Nielsen, P.B., Lee, C.O., Tatari, K., Boe-Hansen, R., Albrechtsen, H.-J. (2014) Phosphorus limitations of nitrification in biological sand filters for drinking water treatment – A study at 3 different scales. WQTC14, AWWA.