



## The Parker Project: Cross-Brand Service Testing Using V2G

**Andersen, Peter Bach; Hashemi Toghroljerdi, Seyedmostafa; Sousa, Tiago; Sørensen, Thomas Meier; Noel, Lance; Christensen, Bjørn Klint**

*Published in:*  
World Electric Vehicle Journal

*Link to article, DOI:*  
[10.3390/wevj10040066](https://doi.org/10.3390/wevj10040066)

*Publication date:*  
2019

*Document Version*  
Peer reviewed version

[Link back to DTU Orbit](#)

*Citation (APA):*  
Andersen, P. B., Hashemi Toghroljerdi, S., Sousa, T., Sørensen, T. M., Noel, L., & Christensen, B. K. (2019). The Parker Project: Cross-Brand Service Testing Using V2G. *World Electric Vehicle Journal*, 10(4). <https://doi.org/10.3390/wevj10040066>

---

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Article

# The Parker project: Cross-brand service testing using V2G

Peter Bach Andersen <sup>1, \*</sup>, Seyedmostafa Hashemi <sup>1, \*</sup>, Tiago Sousa <sup>1, \*</sup>, Thomas Meier Soerensen <sup>1</sup>, Lance Noel <sup>2</sup>, and Bjoern Christensen<sup>3</sup>,

<sup>1</sup> Department of Electrical Engineering, Technical University of Denmark, 2800 Lyngby, Denmark

<sup>2</sup> Nuvve Corp, San Diego, CA 92106, USA

<sup>3</sup> Next-dimension, Danville, CA 94506, USA

\* Author to whom correspondence should be addressed

Version December 12, 2019 submitted to World Electric Vehicle Journal

**Abstract:** The Parker project sought to experimentally validate that contemporary series-produced electric vehicles (EVs), capable of V2G, are ready to participate in a number of advanced grid services. In such services the timing, size and direction of power and energy exchanged between the EV battery and grid is controlled as to support either a single building, the local neighborhood or the regional power system. Vehicles purposely designed for such services are referred to as grid integrated electric vehicles (GIVs). The field of research, describing how GIVs may be used to actively support the power system is called Vehicle-Grid Integration (VGI). The purpose of this paper is to present how the Danish Parker project has systematically categorized a range of grid services, collected in a service catalog, and then, illustrate state-of-the-art EVs ability to support such services through experimental validation. Results are presented for three different tests performed in Parker; marginal emission factor charging, frequency containment reserves and a performance test for controlling power setpoints. The ultimate aim of this paper, and the Parker project, is to promote the GIV concept so that it may inform the design and capabilities of present and future EVs, EV supply equipment (EVSE) and communication standards.

**Keywords:** Grid Integrated Electric Vehicle; Vehicle-Grid Integration; Vehicle-To-Grid; V2G; Smart Charging; Electric Vehicles

## 1. Introduction

Electrification of transportation is a key component in meeting international CO<sub>2</sub> reduction commitments. The immediate effect of such electrification will be both a challenge, due to a new demand for power and energy, and an opportunity in having the vehicles become active assets that may support the power system.

The research field of vehicle-grid integration (VGI) explore not only the adverse effects of electrification in terms of grid impacts and overloading, but also the potential benefits in the form of services that electric vehicles (EVs) can bring to the power system. **The California Public Utilities commission provides the following definition: “Vehicle-Grid Integration (VGI) can harness the usage characteristics of and technologies within the PEVs to allow them to serve as a grid asset, reducing operating costs for facility and vehicle owners, the utilities’ distribution maintenance requirements, and energy prices in the wholesale market”.** VGI research has been documented in countless publications and R&D projects [1-14].

A service can be defined as the act of influencing the timing, size and direction of power and energy exchanged between the EV battery and an external load or electric network to provide value not related to transportation. The nature of services, dealing with everything from loading issues in

33 the distribution system to acting as mobile loads in Vehicle-To-Tool applications, has vastly different  
34 requirements to the abilities and performance of the EV and the electric vehicle supply equipment  
35 (EVSE). Namely the support of vehicle-to-grid (V2G) and the speed with which power can be controlled  
36 may determine the range of services that an EV and its EVSE may be able to provide.

37 One of the main developments in the field of VGI is the support of V2G through DC chargers  
38 supported by the CHAdeMO protocol. This approach, where the power conversion is left to the EVSE  
39 and the EV thereby readily may enable V2G through the CHAdeMO standard, has allowed a broader  
40 support of V2G than ever before.

41 **The main goals of the Parker project [1] are; first, to describe the taxonomy used to**  
42 **systematically describe the range of services that EVs may provide, which has been collected in**  
43 **a service catalog. Second, to presents the experimental validation of state-of-the-art EVs from**  
44 **Nissan, Mitsubishi and PSA to test their ability to provide advanced, V2G-based, services. By**  
45 **proving the VGI readiness of such vehicles the authors hope to set a standard which may guide**  
46 **the design of future EVs to unlock their potential in supporting a stable, economic power system**  
47 **based on renewable energy.**

48 This paper serves first and foremost as an introduction to the Parker project and its approach to  
49 VGI research - for a more technical and in-depth description of the test setup and methodology we  
50 refer to the WEVJ paper [2]. This paper is a slightly modified version of a EVS31 paper [3].

51 This paper is organized as follows: first, related work will be described in a "State of the art" section,  
52 next "Power and energy services" will describe the services identified and explored by the Parker  
53 project. Then, the section "Experimental validation" will describe the components and configuration  
54 used in the test-setup and present data from three different tests. Finally, the paper will conclude on  
55 study presented in this paper and contemplate future work.

## 56 2. State of the art

57 A 1997 publication by Prof. Kempton [4] marked the onset of modern VGI research and the  
58 exploration of V2G technology. Since this potential was first described, Prof. Kempton has led a  
59 number of scientific and commercial activities to prove that bidirectional EVs can provide power  
60 services to the power systems. Willett *et al.* have proven how slightly retrofitted EVs, primarily  
61 based on AC charging, may provide power balancing on a commercial basis [5,6]. Prof. Kempton has  
62 initiated collaboration with multiple automobile OEMs proving the technical ability to support V2G  
63 across several different EV brands.

64 Later, inspired by the work of Prof Kempton, the Danish Nikola project [7] sought to systematically  
65 list and investigate the services that an EV may provide to power systems by developing a first version  
66 of the service catalog describe later in this paper. Nikola also sought to experimentally validate services  
67 on different brands of EVs [8] using AC chargers with dynamic power limitation using the IEC 61851  
68 standard. The project also started the first Danish research efforts on testing frequency containment  
69 reserves (FCR) provision using V2G [9]. Finally, the project thoroughly investigated how EVs may  
70 provide local grid services through both simulation and experimental efforts [10,11].

71 Currently a new generation of VGI projects have been launched, focusing on field testing using  
72 both AC and DC charging, and with support of V2G. This includes the French GridMotion project [12],  
73 the Danish ACES project[13], and the California-based INVENT project [14].

74 **These research projects, as well as others, have all contributed to the scientific state-of-art on**  
75 **investigating the potential and mechanisms for aggregating EVS for performing V2G services.**

76 **In [15] the authors use a statistical assessment approach to determine the potential of using**  
77 **V2G for ancillary services considering constraints from car usage and local grid limits. Further in**  
78 **[16] the potential is explored in terms of earnings through frequency containment reserves using**  
79 **V2G enabled EVs considering driving requirements and the efficiency of the V2G chargers used.**  
80 **In [17] the authors explore the earning potential for frequency regulation in the UK based on a**  
81 **large dataset of real EV driving data and historical market prices. Finally the paper [18] compare**

82 the earning potential of providing frequency containment reserves both with and without the use  
83 of V2G.

84 Other publications deal with the mechanisms which may be used to gain value from V2G. In  
85 [19] V2G is used to prevent imbalances in the distribution grid. The suggested approach involves  
86 a real-time coordination with local PV installations. In [20] a stochastic optimization model is  
87 proposed to control a fleet of V2G enabled vehicles to support a reliability-oriented distribution  
88 grid reconfiguration. Finally, [21] provide a review of optimization techniques which may be used  
89 for EV integration.

90 In addition to the R&D efforts above, Copenhagen has been host to the worlds first commercial  
91 V2G hub [22]. Here, the utility Frederiksberg Forsyning is collaborating with Nissan, Enel and NUVVE,  
92 and the utilities fleet of e-NV200 vans has since fall 2016 participated in the frequency containment  
93 reserve market. The Parker project is connected to this pilot through data sharing in order to promote  
94 scalability and replicability of this solution. While the commercial pilot at Frederiksberg Forsyning and  
95 the projects mentioned above illustrate the maturing of the technology, there are still neither standards  
96 that fully support VGI nor any international norm on what constitutes a GIV.

97 The Parker project builds on the experience and learning from previous R&D while leveraging  
98 new technological developments, specifically the V2G support from new DC chargers and CHAdeMO.  
99 The main novelty of the Parker project is that it is the first project to experimentally validate the ability  
100 to provide V2G services across several contemporary EV models.

101 The validation is both performed by testing some of the most demanding services today,  
102 i.e. Frequency Containment Reserves(FCR) [23], but also by using a test cycle for measuring the  
103 performance of EVs and EVSEs in responding to a power request. T

104 The project has found that EVs, using DC chargers and the CHAdeMO 2.0, protocol may offer  
105 demanding grid services by providing a fast, accurate and precise response to bi-directional power  
106 requests.

107 Parkers investigation of performance may allow us to understand how EVs may support future,  
108 even more demanding services and meet emerging grid codes [24].

### 109 3. Power and energy service

110 One of the objective of the Parker project has been to suggest a systematic and comprehensive  
111 listing of the services an EV may provide. Services can roughly be divided into categories according  
112 to the graphical level at which they are aimed and can create value. Fig. 1 illustrates these different  
113 domains that the EV owner may choose to actively support.

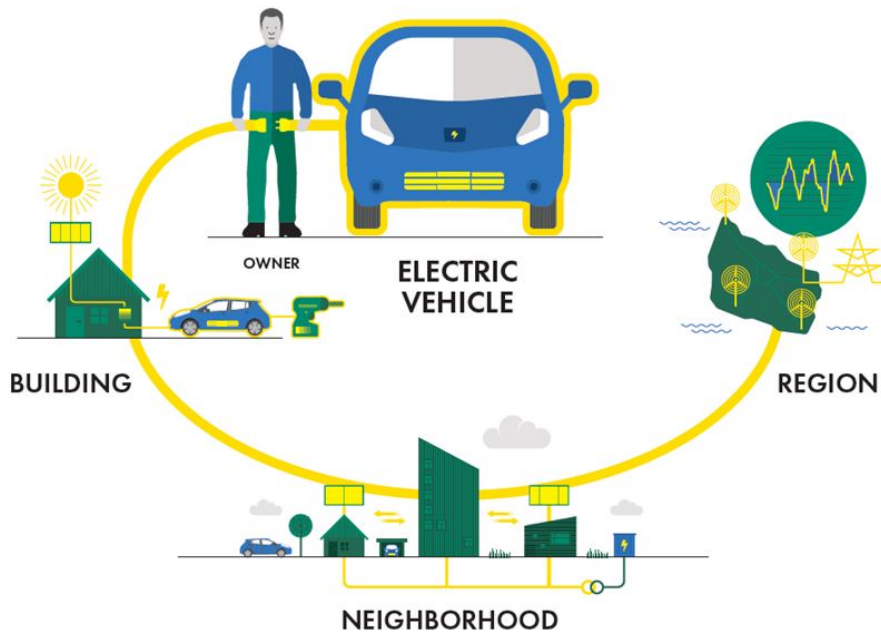


Figure 1. Vehicle-Grid Integration - possible uses of the EV

114 For each of the above domains, EVs can offer services that support:

- 115 • **Region**, balanced and economical power systems based on renewable energy.  
 116 • **Neighborhood**, local distribution grids and new urban energy infrastructures and communities.  
 117 • **Building**, energy-optimized buildings with local production.

118 The above classification, based on the geographical domain, may be more intuitive than the  
 119 classical power system hierarchy - transmission system, distribution system and behind the meter. The  
 120 three levels, however, still roughly corresponds to these levels of the power system.

121 Next, a total of six service categories are suggested and mapped to the levels above. Each category  
 122 is meant to represent a logical grouping of related services. In Fig. 2 these six categories, used by  
 123 Parker, are listed and some examples of services are provided for each category.










Domain	Categories	Service examples	EV+EVSE requirements	
			Controllability/Performance	
Region (Transmission) 	Power balancing	Synthetic inertia		-Fast activation -Controllable ramping rate -Bidirectional (V2G)
		Frequency containment		
Neighborhood (Distribution) 	Energy Balancing	Regulation		(no special performance requirements)
		Marginal emission		
Building (behind meter) 	Grid contingencies	Loading issues		- Reactive power capabilities
		Voltage issues		
	Energy Autonomy	Bilateral trading		- Bidirectional (V2B)
		Self consumption maximization		
	Islanded operation	Back-up power		- Bidirectional (V2B) -Islanding capability
		Fully off-grid		
	Mobile load serving	Vehicle-to-tool Vehicle-to-Vehicle		- Bidirectional (V2L)

Figure 2. Parker service catalog

Below follows a brief description of each category:

- **Power balancing**, services relying on the battery and power electronics ability to provide high, instantaneous power (kW) for balancing purposes.
- **Energy balancing**, services that used the batteries ability to consume, store and return quantities of energy (kWh) for balancing purposes
- **Grid contingencies**, Services that support the safe and reliable operation of local distribution systems.
- **Energy Autonomy**, services that allow for energy autonomy by allowing an increasing degree of energy to be produced and consumed locally.
- **Islanded operation**, allow islanded operation when a connection to the power system is not practical or possible.
- **Mobile load serving**, services using the EV as a mobile source of power and energy where access to the power system is not practical or possible.

Fig. 2 also indicate the controllability and performance needed to support each category. The circle in the figure represents 4 quadrant power control - the horizontal axis (P) is active power and the vertical axis (Q) reactive power.

The green line in the circle denote the control that may be needed - or that may enhance the services provided.

While the authors has only denoted the need for reactive power control within the grid contingencies category (for voltage support), the ability for bidirectional active power control (V2G) will likely be useful in several of the categories.

145 An extended version of the Service catalog can be found in appendix A.

146 The emphasis of the Parker project has been on services at the regional level, especially power  
147 balancing, as well as services aimed at the neighborhood level in the shape of local grid contingencies.  
148 A number of specific services from these categories has then been selected for experimental validation.  
149 Some of these services will be presented in the next section.

#### 150 4. Experimental validation

151 **The purpose of the experimental validation in Parker is to assess contemporary EVs ability**  
152 **to provide advanced and V2G-based services. These validations can be valuable to the area of**  
153 **Vehicle-Grid Integration as they serve as a benchmark for other, and future, brands of EVs.**

##### 154 4.1. Experimental setup

155 The main components in Parker, used to conduct the experimental validation, are four EV models;  
156 Nissan Leaf, Nissan Evalia, Mitsubishi Outlander PHEV and Peugeot iOn, provided to the Parker  
157 project by partners Nissan, Mitsubishi Motors and PSA. The EVSEs used are provided by project  
158 partner Enel X and are 10 kW bidirectional DC CHAdeMO chargers. All OEM vehicles are connected  
159 to the Enel EVSE and each constitutes a "EV/EVSE pair" used for testing. Since the EVSE is based on  
160 DC charging, it will contain the power electronics and inverters necessary to support V2G. i.e. for DC  
161 charging in particular, the EV cannot be seen in isolation but relies on the capabilities and performance  
162 of the EVSE connecting it to the power system.

163 The bidirectional powerflow between EV and EVSE is controlled through an aggregator developed  
164 by project Partner NUVVE. For each test the NUVVE aggregator calculates and dispatches a power  
165 request which is sent to each EVSE. The EVSE then forwards the request to the EV using CHAdeMO  
166 messages. The power provided (bidirectional) by the EV is measured by a meter installed in the Enel  
167 chargers. **This reference configuration is illustrated in Fig. 3. The picture in Fig. 4 show the physical**  
168 **setup, with two Mitsubishi iOns connected to Enel X bidirectional chargers, in the PowerLabDK**  
169 **EVLab facility in which the tests were carried out.**

170 A set of services from the Parker service catalog has been selected for experimental validation.  
171 Services has then been tested across all project vehicles to investigate cross-brand support. The  
172 following subsections presents three different tests and describes the four EV models ability to provide  
173 them.



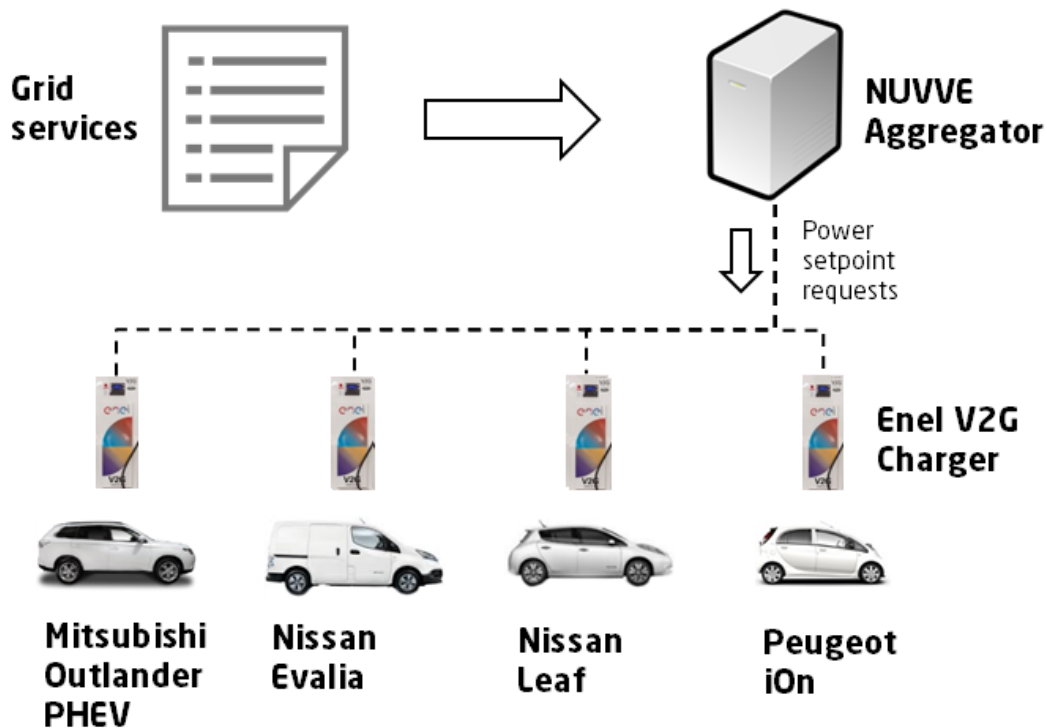


Figure 3. Parker reference configuration



Figure 4. Parker laboratory setup

#### 174 4.2. Service - Marginal Emission Factor

175 The first service belongs to the energy balancing category and is fairly easy to provide as it does  
 176 not depend on V2G nor has high requirements in regards to activation time. This service can informally  
 177 be referred to as smart charging and simply postpone charging until periods where it is more suitable  
 178 to consume energy. Many EVs already support static smart charging where EV owners can specify  
 179 a fixed time for charging to commence, e.g. informed by a time-of-use tariff. This particular service  
 180 represents a dynamic smart charging scenario where the time suitable for energy consumption may  
 181 change on a frequent basis and it therefore may be more practical to leave the charging control to a third  
 182 party such as an EV aggregator.

183 Specifically, this service seeks to reduce the  $CO_2$  production caused by charging. With  
 184 sufficient energy data and forecasts it is possible to identify the hours of the day where the



185 added load of EVs is likely to cause the least additional  $CO_2$  emission considering the marginal  
 186 production. A marginal emission factor (MEF) has been developed in the Parker project in  
 187 collaboration with the company Tomorrow, which captures the additional  $CO_2$  emissions of each  
 188 additional unit of electricity consumed.

189 The MEF is made available through a signal which has been used for the test.

190 In Fig. 5 (top) Requested power is used to let the EVs charge in hours with the lowest MEF  
 191 signal value. The majority of energy needed is charged using the 1st hour of the test - while the  
 192 remainder is charged during the 4th hour. This is a result of the 1st and 4th hours having the  
 193 lowest MEF value and thus offering the least  $CO_2$  intensive energy. All cars can be seen to follow  
 194 the requested power rather accurately - The vehicles with smaller batteries (Outlander and iOn)  
 195 can be seen to reduce the charging power as the batteries are approaching full capacity.

196 The difference between power requested by the aggregator and the power provided by the  
 197 vehicles is shown in figure Fig. 5 (bottom). While all EVs follow the requested power well some peaks  
 198 are observed due to delays in vehicle response when a change in the power setpoint occurs.

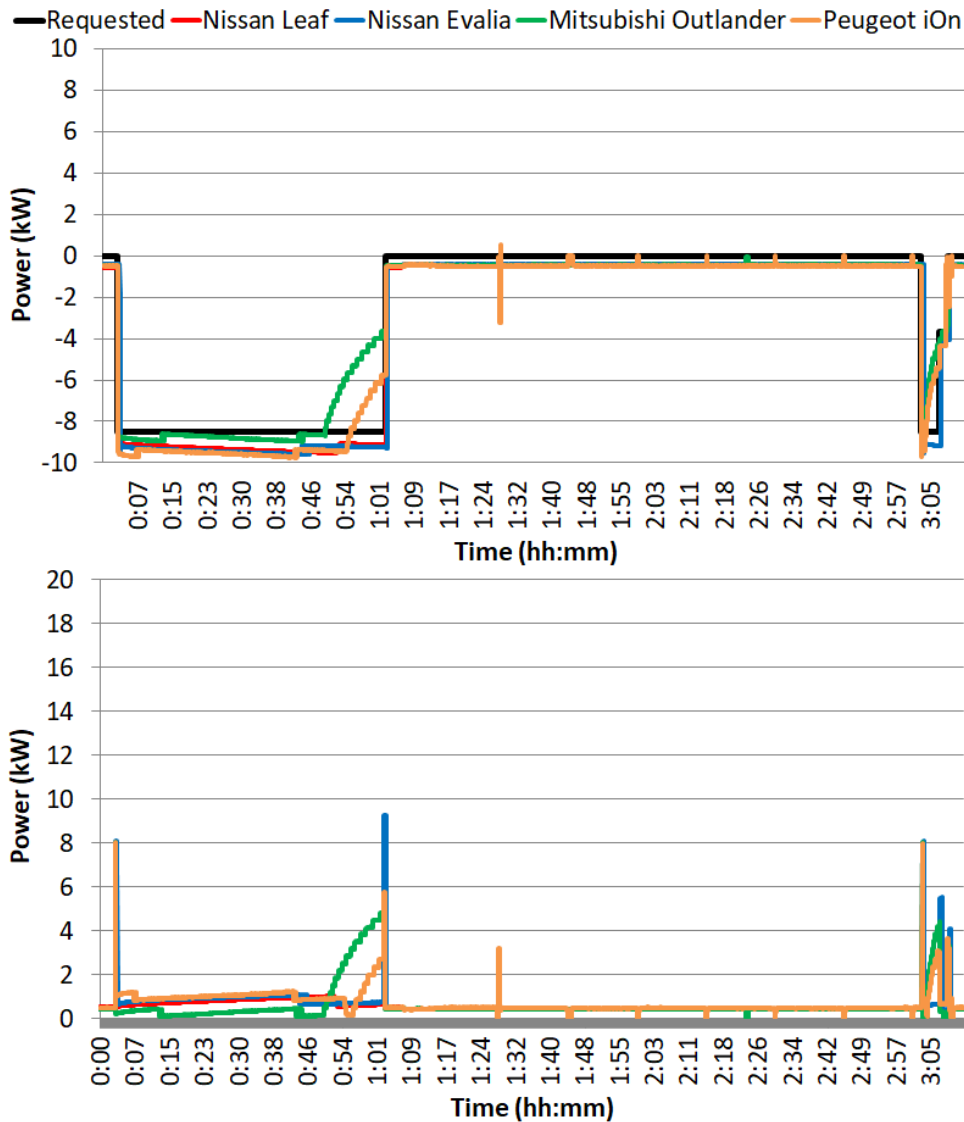


Figure 5. Parker service - Marginal Emission Factor, top: requested and provided power for service, bottom: absolute difference between requested and provided power


### 199 4.3. Service - Frequency Containment Reserves

200 This service differs from the MEF test as it both utilize V2G and requires a fast power response.  
 201 To provide FCR an aggregator would monitor the regional system frequency and dispatch a charge or  
 202 discharge request to the EV according to a predefined droop function. Generally, the EVs will be set to  
 203 charge if the frequency is high (according to a reference value or band), and discharge if the frequency  
 204 is low.

205 FCR services has response requirements spanning from 150 sec down to 5 sec depending on  
 206 the specific product provided. The ability to support V2G substantially strengthen an EVs ability to  
 207 provide FCR.

208 This specific service is based on FCR provided in the western part of Denmark as part of the  
 209 Continental Europe Regional group.

210 Fig. 6 (top) shows the Requested power sent to all project vehicles and the corresponding response  
 211 recorded by the EVSEs. It can be observed that the three vehicles participating in this test all are able  
 212 to follow the bidirectional requested power set-point in a sufficiently precise and timely manner. It can  
 213 be seen from Fig. 6 (bottom) that no large deviations between power requested and provided occur.  
 214 This is because the power setpoints change more gradually in this test (without large steps).

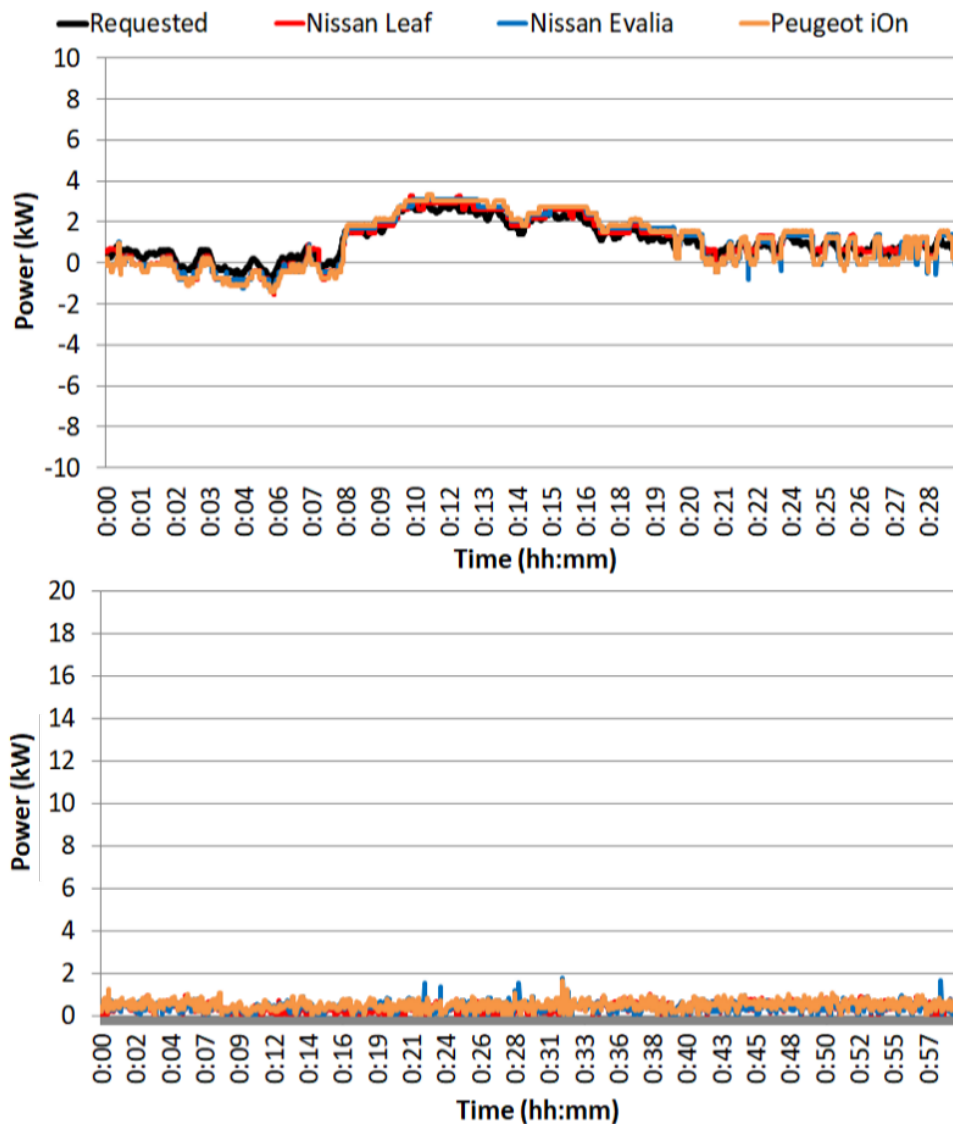

**Figure 6.** Parker service - Frequency Containment Reserves, top: requested and provided power for service, bottom: absolute difference between requested and provided power

215 4.4. Active power performance test

216 The last test does not represent a specific service but is rather designed to measure the performance  
 217 of the vehicles and EVSEs. The test cycle suggested here, consist first of a continuous and then a  
 218 step-wise variation of charging power set-points and can be said to be the most demanding of the  
 219 three tests. This cycle allows for a measurement of, for instance, set point granularity (continuous  
 220 portion) and response times (step-wise portion).

221 It can be seen in Fig. 7 that the provided power closely followed the request setpoint. Short  
 222 deviations occur (seen as spikes in the absolute difference between request and response) due to a  
 223 response delay.

224 A separate publication [24] elaborates on how the performance of the vehicles may be quantified  
 225 using this test.

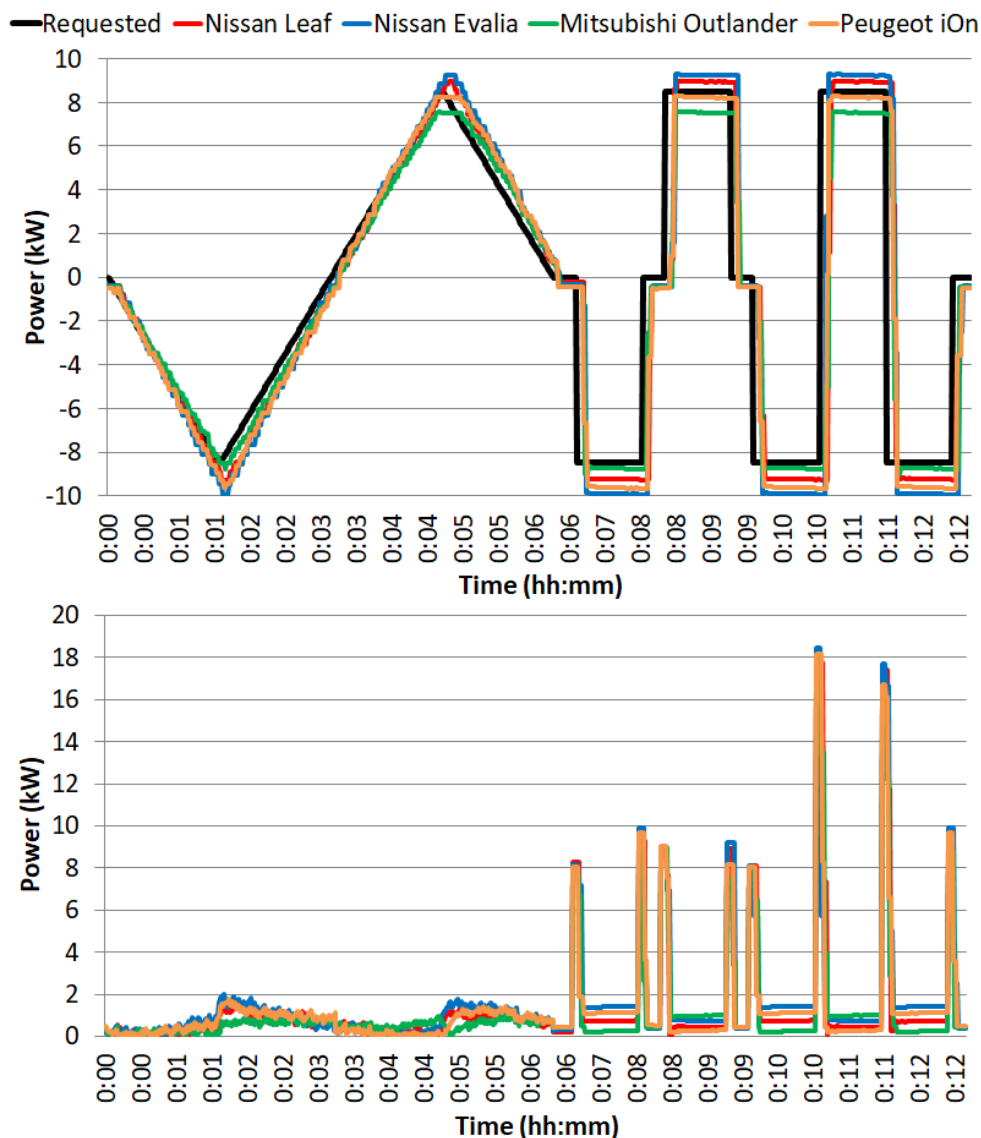


Figure 7. Parker performance test - active power, top: requested and provided power for test, bottom: absolute difference between requested and provided power

226 Based on the tests conducted in Parker, including the three above, the project has been able to  
 227 conclude that the vehicle are ready and able to provide advanced grid services relying on a fast and  
 228 bidirectional exchange of power.

## 229 5. Conclusion

230 This paper has described how the Parker project have sought to systematically list, and then test  
231 EV services towards a number of contemporary unmodified electric vehicles using bidirectional DC  
232 chargers.

233 The experimental validation showed a good performance for the vehicles tested (Nissan Leaf,  
234 Nissan Evalia, Peugeot iOn, Mitsubishi Outlander PHEV) and can serve as a benchmark for  
235 upcoming car models and standards. The reaction time were measured to 5-6 seconds (including  
236 communication delays) using an aggregator - down to a few seconds when controlling charger and  
237 car directly. Ultimately the performance depends on the design of the power electronics as well  
238 as the software and protocols used to control it. The project concludes that V2G capability works  
239 well for a number of contemporary EVs today, using a DC V2G charger and CHAdeMO 2.0, but  
240 further work is needed to make such capabilities universal.

241 It is important to stress that V2G is currently only available in series-produced EVs through  
242 novel DC chargers and use of the CHAdeMO 2.0 protocol. Besides from V2G, other capabilities,  
243 such as reaction time when altering a power setpoint, granting access to battery State-Of-Charge  
244 (SOC) and vehicle identification through the EVSE need to be considered to fully support VGI  
245 services. For the broadest possible support, these capabilities need to be available through both  
246 DC and AC charging and be implemented in all international charging interfaces and standards;  
247 In Europe most notably in the ISO/IEC 15118 and CCS standard.

248 While the Parker project has successfully proven the V2G readiness of the participating  
249 vehicles, further improvements may further extend the number of services that EVs can offer.  
250 By decreasing the response and activation time of the EV-EVSE pair, even more time-critical  
251 power balancing services may be provided. Also, adding new capabilities such as reactive  
252 power provision and islanding support would extend services that EVs can provide. A main  
253 recommendation of the Parker project is to pursue a common definition of a grid integrated vehicle.  
254 i.e. the capabilities and performance that an EV should possess to be able to claim V2G and grid  
255 readiness.

256 The vehicles and chargers in Parker can be seen as a first generation of equipment which has been  
257 designed with power services in mind - representing a stride forward for the field of Vehicle-Grid  
258 Integration.

259 **Author Contributions:** methodology, P.B.A., S.H., T.S., T.M.S., L.N. and B.C.; data curation, L.N., B.C. and P.B.A.;  
260 visualization, P.B.A.; project administration, P.B.A.; writing—original draft preparation, P.B.A.; Writing - review &  
261 editing, P.B.A., S.H., T.S., T.M.S., L.N. and B.C.

262 **Funding:** The work in this paper has been conducted by the Danish research project Parker  
263 ([www.parker-project.com](http://www.parker-project.com)) and is supported through the EUDP funding program (grant nr. 2016-1-12410)

## 264 Abbreviations

265 The following abbreviations are used in this manuscript:

266	EV	Electric Vehicle
	EVSE	Electric Vehicle Supply Equipment
	FCR	Frequency Containment Reserves
267	GIV	Grid Integrated Electric Vehicles
	V2G	Vehicle-To-Grid
	VGI	Vehicle-Grid Integration

268

269 1. The Parker project. <http://parker-project.com/>, 2016.

- 270 2. Zecchino, A.; Thingvad, A.; Andersen, P.B.; Marinelli, M. Test and Modelling of Commercial V2G  
271 CHAdeMO Chargers to Assess the Suitability for Grid Services. *World Electr. Veh. J.*, 2019, Vol 10.  
272 <https://doi.org/10.3390/wevj10020021>, 2019.
- 273 3. Andersen, P.B.; Hashemi, S.; Sousa, T.; Soerensen, T.M.; Noel, L.; Christensen, B. Cross-brand validation of  
274 grid services using V2G-enabled vehicles in the Parker project. Accepted for EVS 31 & EVTeC 2018, 2018.
- 275 4. Kempton, W.; Letendre, S.E. Electric vehicles as a new power source for electric  
276 utilities. *Transportation Research Part D: Transport and Environment* **1997**, *2*, 157 – 175.  
277 doi:[https://doi.org/10.1016/S1361-9209\(97\)00001-1](https://doi.org/10.1016/S1361-9209(97)00001-1).
- 278 5. Kempton, W.; Tomic, J. Vehicle-to-grid power implementation: From stabilizing the grid to supporting  
279 large-scale renewable energy. *Journal of Power Sources* **2005**, *144*, 280 – 294.
- 280 6. Kempton, W.; Tomić, J. Vehicle-to-grid power fundamentals: Calculating capacity and net revenue. *Journal*  
281 *of Power Sources* **2005**, *144*, 268 – 279. doi:<https://doi.org/10.1016/j.jpowsour.2004.12.025>.
- 282 7. Andersen, P.B.; Marinelli, M.; Olesen, O.J.; Andersen, C.A.; Poilasne, G.; Christensen, B.; Alm, O. The  
283 Nikola project - Intelligent electric vehicle integration. IEEE PES Innovative Smart Grid Technologies,  
284 Europe, 2014, pp. 1–6.
- 285 8. Marinelli, M.; Martinenas, S.; Knezovic, K.; Andersen, P.B. Validating a centralized approach to primary  
286 frequency control with series-produced electric vehicles. *Journal of Energy Storage* **2016**, *7*, 63 – 73.  
287 doi:<https://doi.org/10.1016/j.est.2016.05.008>.
- 288 9. Martinenas, S.; Marinelli, M.; Andersen, P.B.; Træholt, C. Implementation and demonstration of grid  
289 frequency support by V2G enabled electric vehicle. 2014 49th International Universities Power Engineering  
290 Conference (UPEC), 2014, pp. 1–6. doi:10.1109/UPEC.2014.6934760.
- 291 10. Knezović, K.; Marinelli, M.; Zecchino, A.; P.B.Andersen.; Træholt, C. Supporting involvement of electric  
292 vehicles in distribution grids: Lowering the barriers for a proactive integration. *Energy* **2017**. submitted.
- 293 11. Knezovic, K.; Martinenas, S.; Andersen, P.B.; Zecchino, A.; Marinelli, M. Enhancing the Role of Electric  
294 Vehicles in the Power Grid: Field Validation of Multiple Ancillary Services. *IEEE Transactions on*  
295 *Transportation Electrification* **2017**, *3*, 201–209. doi:10.1109/TTE.2016.2616864.
- 296 12. GridMotion Project: reducing electric vehicle usage cost thanks to smart charging process, 2017.
- 297 13. Across Continents Electric Vehicle Services (ACES). <http://aces-bornholm.eu>, 2017.
- 298 14. Electric Vehicle Integration (INVENT), 2017.
- 299 15. Sarabi, S.; Davigny, A.; Courtecuisse, V.; Riffonneau, Y.; Robyns, B. Potential of vehicle-to-grid ancillary  
300 services considering the uncertainties in plug-in electric vehicle availability and service/localization  
301 limitations in distribution grids. *Applied Energy* **2016**, *171*, 523–540.
- 302 16. Thingvad, A.; Ziras, C.; Marinelli, M. Economic Value of Electric Vehicle Reserve Provision in the Nordic  
303 Countries under Driving Requirements and Charger Losses. *Journal of Energy Storage* **2019**, *21*, 826–834.  
304 doi:10.1016/j.est.2018.12.018.
- 305 17. Thingvad, A.; Calearo, L.; Andersen, P.B.; Marinelli, M.; Neaimh, M.; Suzuki, K.; Murai, K. Value of V2G  
306 Frequency Regulation in Great Britain Considering Real Driving Data. Innovative Smart Grid Technologies  
307 (ISGT Europe), 2019 IEEE PES International Conference and Exhibition, 2019.
- 308 18. Thingvad, A.; Martinenas, S.; Andersen, P.; Marinelli, M.; Christensen, B.; Olesen, O. Economic Comparison  
309 of Electric Vehicles Performing Unidirectional and Bidirectional Frequency Control in Denmark with  
310 Practical Validation. *2016 Proceedings of the 51st International Universities Power Engineering Conference* **2016**.
- 311 19. E. Akhavan-Rezai, M. F. Shaaban, E.F.E.S.; Karray, F. Managing demand for plug-in electric vehicles in  
312 unbalanced LV systems with photovoltaics. *IEEE Trans. Ind. Informatics* **2017**, *13*, 1057–1067.
- 313 20. A. Kavousi-Fard, M.A.R.; Niknam, T. Reliability-oriented reconfiguration of vehicle-to-grid networks.  
314 *IEEE Trans. Ind. Informatics* **2015**, *11*, 682–691.
- 315 21. K. M. Tan, V.K.R.; Yong, J.Y. Integration of electric vehicles in smart grid: A review on vehicle to grid  
316 technologies and optimization techniques. *Renew. Sustain. Energy Rev.* **2019**, *53*, 720–732.
- 317 22. Arias, M.N.B.; Hashemi, S.; Andersen, P.B.; Træholt, C.; Romero, R. V2G Enabled EVs Providing Frequency  
318 Containment Reserves: Field Results. 2018 IEEE International Conference on Industrial Technology (ICIT  
319 2018), 2018.
- 320 23. Hashemi, S.; Arias, N.B.; Andersen, P.B.; Christensen, B.; Træholt, C. Frequency Regulation Provision Using  
321 Cross-Brand Bidirectional V2G-Enabled Electric Vehicles. 2018 the 6th IEEE International Conference on  
322 Smart Energy Grid Engineering (SEGE 2018), 2018.

- 323 24. Zecchino, A.; Thingvad, A.; Andersen, P.B.; Marinelli, M. Suitability of Commercial V2G CHAdeMO  
324 Chargers for Grid Services. Accepted for EVS 31 & EVTeC 2018, 2018.



325 **Appendix A**

# The Parker “VGI service catalog” 2.0

Domain	Categories	Service examples	Short description	EV+EVSE requirements		USER
				Controllability/Performance	Incentives	
Region (Transmission)	Power balancing	Synthetic inertia	Mimics inertia of rotating machines		-Fast activation -Controllable ramping rate -Bidirectional (V2G)	 Availability payment
		Frequency containment	Keeps the frequency in a desired window			
Neighborhood (Distribution)	Energy Balancing	Wholesale energy	Provide responsiveness to varying energy prices		(no special performance requirements)	 Savings on energy costs / Renewable-based charging
		Regulation	Balances energy schedules/portfolios			
	Marginal emission	Defer charging based on the energy sources that will cover marginal consumption in a given hour.		-Reactive power capabilities	 Savings on connection costs / compensation from utility	
	Grid contingencies	Loading issues Voltage issues				Mitigate overloading of transformers and cables in LV network. Can also include phase load balancing. Mitigate over- or undervoltages in LV network
Building (behind meter)	Energy Autonomy	Bilateral trading	Local peer-to-peer trading of energy.		- Bidirectional (V2B)	 Savings/Independence
		Self consumption maximization	Ensure the highest possible utility of locally produced energy			
	Islanded operation	Back-up power Fully Off-grid	Sustain a small power system temporarily disconnected from the grid. Sustain a small power system permanently disconnected from the grid.		- Bidirectional (V2B) -Islanding capability	 Security of supply /Independence
Mobile load serving	Mobile load serving	Vehicle-to-tool	Provide a mobile power-source for equipment during in-field use.		- Bidirectional (V2L)	 Access to mobile power source
		Vehicle-to-Vehicle	Provide energy directly from one vehicle to another			

**Figure A1.** Full Parker service catalog