



## Capabilities and costs for ancillary services provision by wind power plants

Cutululis, Nicolaos Antonio

*Publication date:*  
2013

[Link back to DTU Orbit](#)

*Citation (APA):*  
Cutululis, N. A. (Author). (2013). Capabilities and costs for ancillary services provision by wind power plants. Sound/Visual production (digital)

---

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.



# Capabilities and costs for ancillary services provision by wind power plants

Nicolaos A. Cutululis


DTU Wind Energy  
Department of Wind Energy



# SUMMARY

Objective	To establish a reference basis and policy recommendations for future network codes and market design in the area of ancillary services from variable renewables.
Output	Needs for and costs of ancillary services provided by wind and solar PV.
Background	<ul style="list-style-type: none"><li>• Future high shares of variable renewables in electricity consumption</li><li>• Electricity market liberalisation</li></ul>
Target groups	System operators, energy regulators, policy makers, RES-E generators and power industry in general.
Consortium	Coordinator: EWEA Partners: EPIA, 3E, VTT, Fraunhofer IWES, Acciona, UCD NUID, DTU Wind Energy, EDSO4SG, Mainstream, SMA, GE

## Project plan of actions

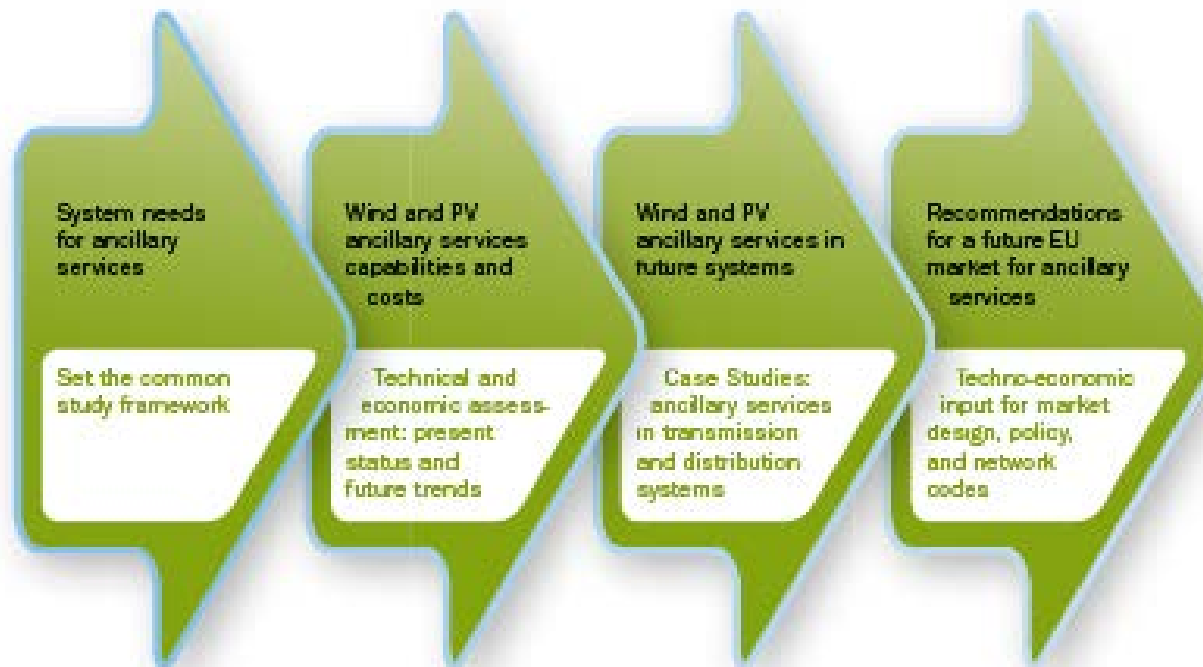

# Methodology

## System needs for AS

- List of services
- Impacts in services at wind large wind energy penetrations
- Cost structure definition
- Procurement survey
- Costs from conventional generation

## Capabilities and Costs

- Literature survey
- Questionnaires – detailed on technical functionalities
- Interviews – focused on services
- Control strategies
- Costs estimation

## Case studies

- Simulation of service provision at
- Verification of capabilities and costs
- Assessment at transmission and distribution level



## Table for AS categories

Frequency support	Voltage support	System restoration
Frequency Containment Reserve FCR (<5, 10 or 30 sec)  Frequency Restoration Reserve FRR (<15 min)  Replacement Reserve RR (15 min to hours)	Normal Operation: control of power factor, reactive power or voltage	Black start
Fast frequency response (synthetic inertia) (< 2s)  Ramping margin (1, 3, 8 hours ahead)	Fast reactive current injection	Islanding

## Cost structure

### Ability / capability

- investment cost related to providing the capability

### Readiness / holding / availability

- cost for capacity reserved, opportunity cost losing energy that cannot be sold
- link to other markets

### Utilisation / response

- actual provision of the service, like energy as used with fuel cost
- increased maintenance costs (wear and tear)

## FoF – Frequency related services

Type of functionality	Functionality name	Ancillary Service					Implementation level
		FCR	FRR	RR	FFR	RM	
Technical	Active Power Control	X	X	X		X	WT/WF
	Active Power Delta Control Mode	+	+	+			WT/WF
	Active Power Limitation Control Mode	+	+	+		X	WT/WF
	Active Power Gradient Control Mode	+	+	+		+	WT/WF
	Frequency Sensing	X	X		X		WT/WF
	Frequency Sensitivity Mode (or Droop Control)	+	+				WT/WF
	Active Power Setpoint Processing	X	X	X	X	X	WT/WF
	Setpoint Priority Management	-	-	-	-	-	WF
	Temporary Active Power Increase				-		WT
Operational	Ability to Calculate Actual Active Power Production	+	+				WT
	Power production forecast		+	+		+	WF
	Communication and Control Interface	X	X	X	X	X	WT/WF
	Communication and Control Interface with the SO	X	X	X	X	X	WF
	Wind Power Plant Management System	+	+	+		+	WF

### References:

- X Functionality required and today generally available
- + Functionality required but not always available or optionally available
- Functionality rarely available/ not implemented but implementable/ programmable
- O Functionality required and NOT available
- WT Functionality considered at Wind Turbine level
- WF Functionality considered at Wind Farm (controller) level



## FoF – Frequency related services

### State-of-the-art / Limitations

- Control functionalities for active power control generally available
- The extent of frequency related services is limited

### Challenges

- Clear specifications for active power control modes
- Impact assessment of service provision in turbine life time
- Forecast accuracy
- Impact of fast active power boost delivery followed by decrease in active power

## FoF – Voltage related services

Type of functionality	Functionality name	Ancillary Service		
		SSVC	FRCI	Implementation level
Technical	Reactive Power Setpoint Processing	X		WT/WF
	Reactive Power Control Scheme	X		WT/WF
	Reactive Power Control	X		WT/WF
	Voltage Control	X		WT/WF
	Power Factor Control	X		WT/WF
	Reactive Power Provision	+		WT/WF
	Fast Positive Sequence Reactive Current Injection Capability		+	WT
	Fast Active Current Reduction Capability		+	WT
	Fast Negative Sequence Current Provision		-	WT
Operational	Communication and Control Interface	X	X	WT/WF
	Communication and Control Interface with the SO	X	X	WF

### References:

- X Functionality required and today generally available
- + Functionality required but not always available or optionally available
- Functionality rarely available/ not implemented but implementable/ programmable
- O Functionality required and NOT available
- WT Functionality considered at Wind Turbine level
- WF Functionality considered at Wind Farm (controller) level

## FoF – Voltage related services

### State-of-the-art/Limitations

- Functionalities for voltage control generally available
- The extent of those capabilities depend on the conversion system

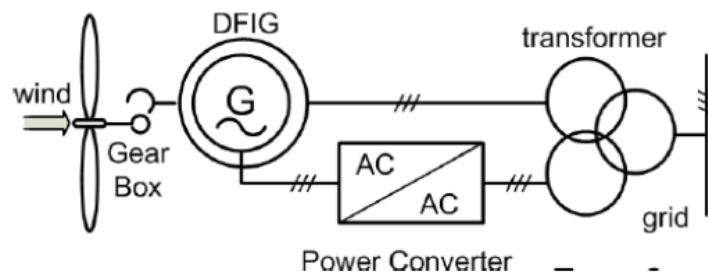


Figure 1: diagram of a Type 3 WT.

### Challenges

- Economical challenges for the extending reactive power capability range (i.e. at zero active power)
- Specification of FRCI


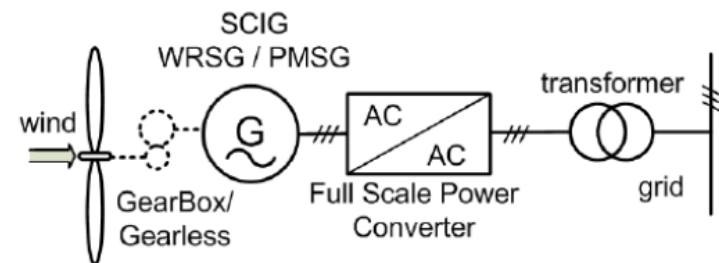




Figure 2: diagram of a Type 4 WT.

# Variability and predictability - Forecast method

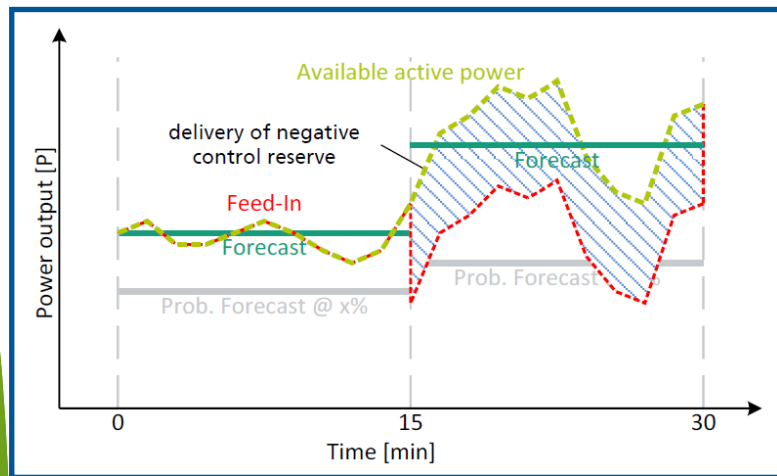

Actual Feed in  
Probabilistic Forecast ID  
Offer ID  
Probabilistic Forecast DA  
Offer DA


Losses due to uncertainty

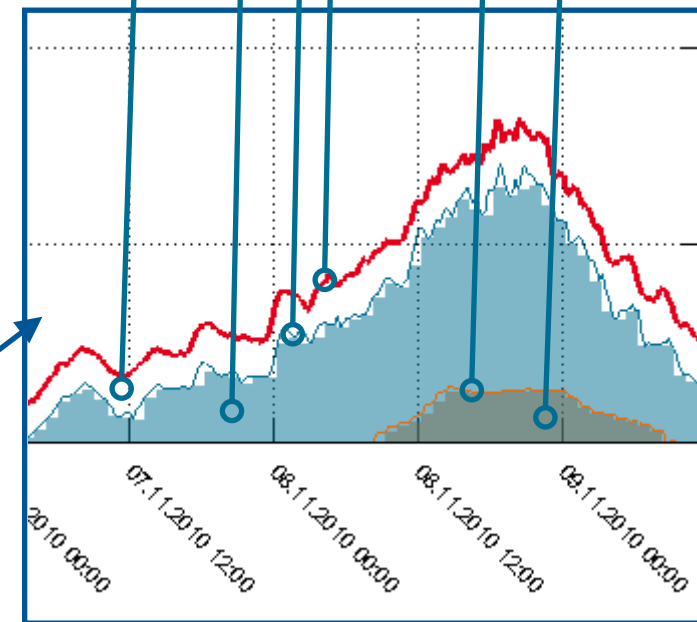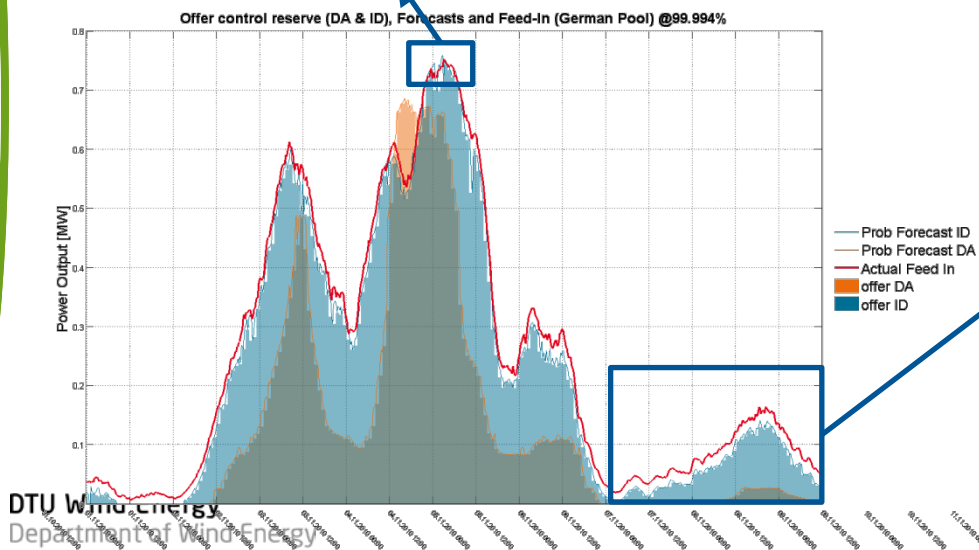

# Variability and predictability

## Effect of product length in potential of service provision

30 GW in Germany

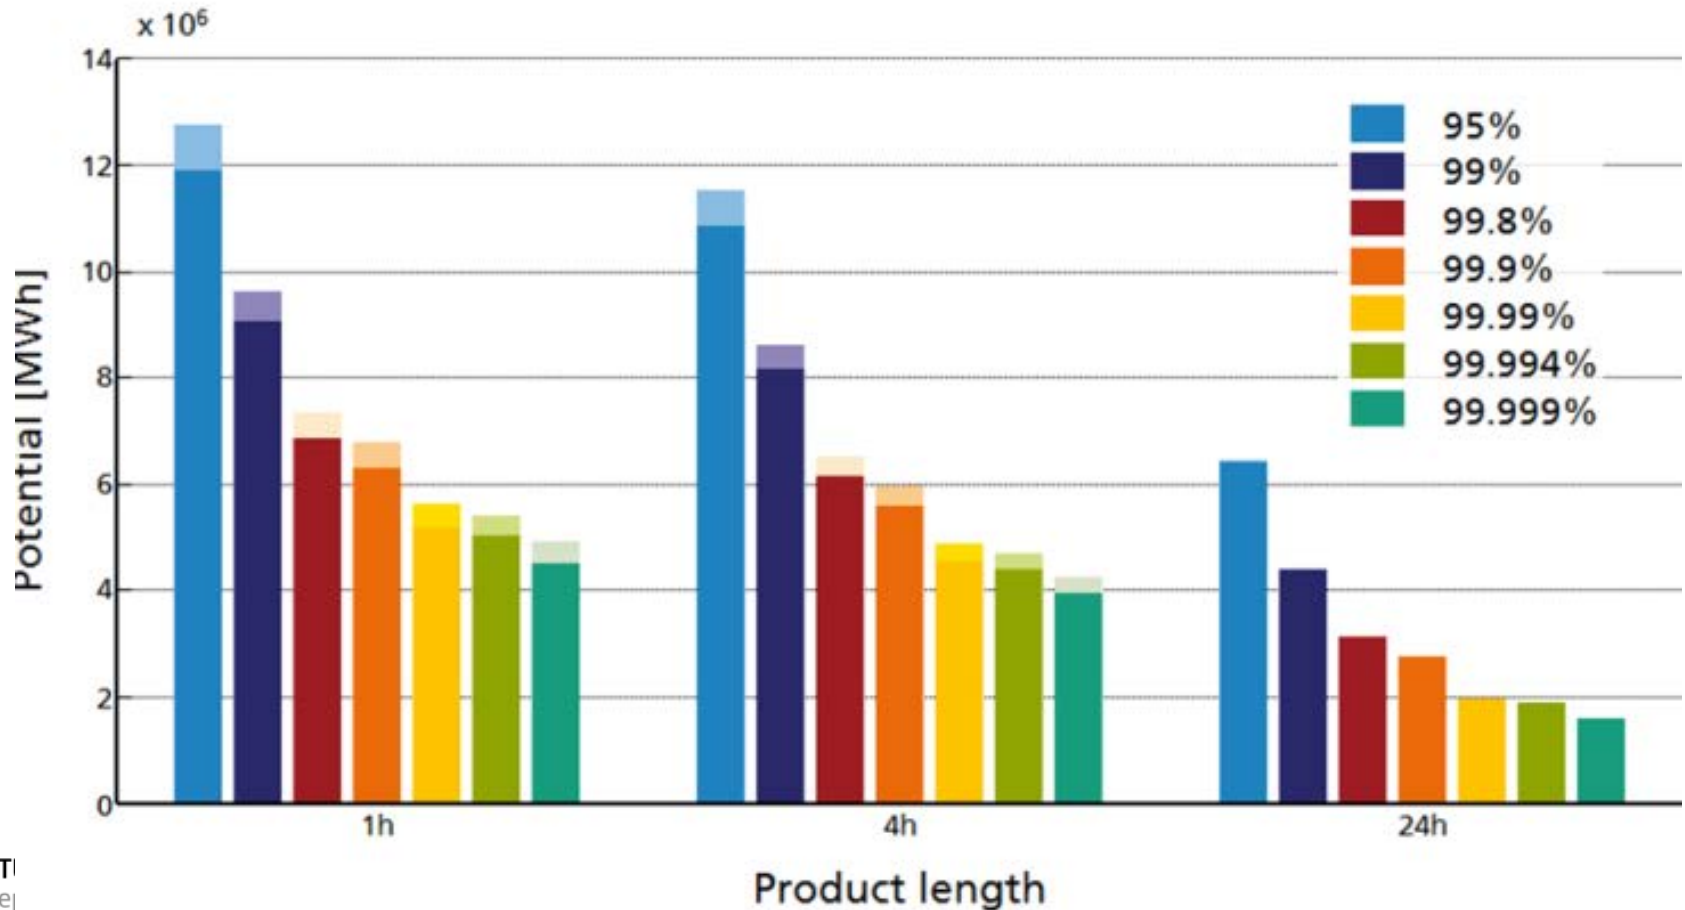



## Gap Analysis

- Technology
  - Time constraints for the fast services (communication and control)
  - “Tear & Wear” costs need further investigation
- Requirements
  - Grid codes – a lack of clear specifications
  - Required performances might have an adverse reaction
- Operational
  - Service acquiring method (procurement and pre-qualification)

## Conclusions

- Wind power technologies have adequate control capabilities to provide ancillary services, but these are not widely used
- The main challenges are related to incorporating the stochastic nature of wind
  - Forecast accuracy
  - Available active power calculation method
  - Improvement of communication and control capabilities
- Other challenge is the absence of a clear specifications to
  - Define response and delivery of the service for ‘very fast’ services (FFR, FCRI)
  - allow accurate assessment of impacts in the lifetime of the technology
  - enable participation in the market (procurement, prequalification)

[www.reservices-project.eu](http://www.reservices-project.eu)

Contact:

Nicolaos A. Cutululis

[niac@dtu.dk](mailto:niac@dtu.dk)