



Removal of pesticides with filter sand from biological rapid sand filters

Hedegaard, Mathilde Jørgensen; Albrechtsen, Hans-Jørgen

Publication date:
2015

Document Version
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

Citation (APA):

Hedegaard, M. J., & Albrechtsen, H-J. (2015). *Removal of pesticides with filter sand from biological rapid sand filters*. Poster session presented at IWA Specialized Conference: Biofilms in Drinking Water Systems: from Treatment to Tap, Arosa, Switzerland.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Removal of pesticides with filter sand from biological rapid sand filters




Mathilde J. Hedegaard* and Hans-Jørgen Albrechtsen**

*DTU Environment, mjhe@env.dtu.dk

**DTU Environment, hana@env.dtu.dk


INTRODUCTION

Pesticides and metabolites are detected in 24% of the active waterworks abstraction wells in Denmark, where the water treatment is simple consisting of aeration of anaerobic groundwater followed by filtration in rapid sand filters. Due to the sustainability of rapid sand filters it is of interest to utilise these to remove pesticides biologically.

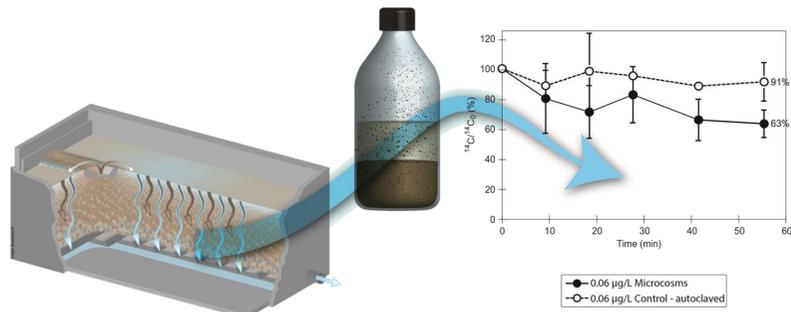

METHODS

Filter sand was collected at three different waterworks and microcosms were set-up within 24 hours with filter sand, water and ¹⁴C-pesticide at an environmentally realistic low initial concentration of 0.03-0.38 µg/L. The analysis for ¹⁴C was based on a double vial system.

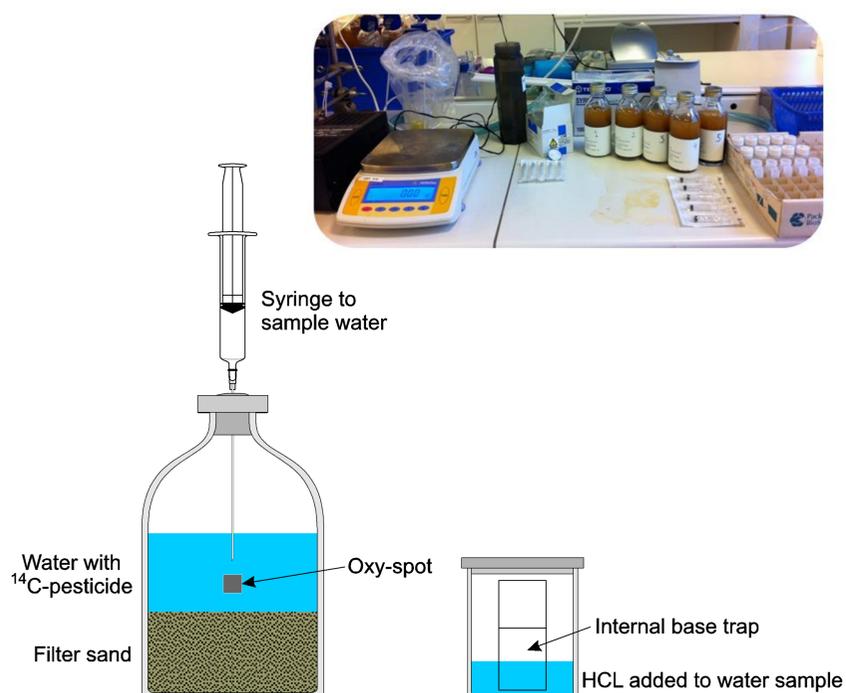

RESULTS – Removal potential

All investigated pesticides were removed from the water phase when it was in contact with filter material from all three investigated rapid sand filters. More bentzone TP and *p*-nitrophenol was removed in the microcosms compared to the abiotic controls, demonstrating the removal in the microcosms was partial biological. The microbial degradation in the filter sand from Sjælsø waterworks Plant II led to a partial mineralisation – ¹⁴CO₂ production from bentzone TP reached 8-14%, glyphosate 42-43% and *p*-nitrophenol 7-10% of the initially added pesticide after six days. Thus, all three pesticides were biologically degraded in filter sand from Sjælsø waterworks Plant II.

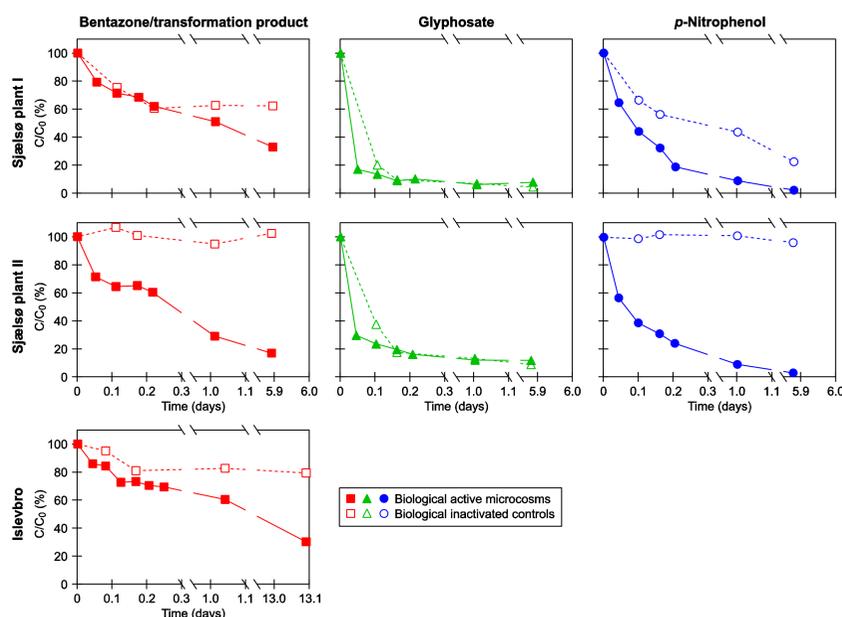


Figure 1 The fraction of ¹⁴C in the water phase of the initial amount of ¹⁴C₀ in the microcosms (duplicates) and abiotic controls (modified from Hedegaard and Albrechtsen, 2014).

RESULTS – Removal kinetics

Bentzone removal with filter sand from Sjælsø waterworks Plant II was investigated during the filter contact time of one hour. During the first 60 minutes more than 35% of the initially added bentzone was removed.

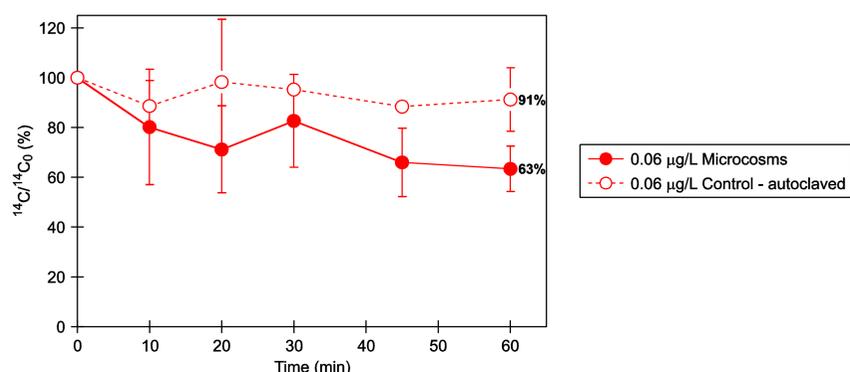


Figure 2 Mean concentrations are given as percentage of the initial concentration (0.06 µg/L) in microcosms (triplicate) and controls with autoclaved filter sand (duplicates).

CONCLUSIONS

1. An evident removal potential of MCP, bentzone and its transformation product, glyphosate, and *p*-nitrophenol was shown in samples from rapid sand filters at three Danish waterworks. The microbial removal was largest in filter sand collected from Sjælsø Plant II
2. In filter sand from Sjælsø waterworks Plant II bentzone concentration in the water phase decreased with more than 35% of the initial concentration within 60 minutes as a result of microbial removal

Perspectives

Substantial microbial pesticide removal is possible within the contact time of rapid sand filters and thereby a potential for treatment of pesticide contaminated groundwater. This is of commercial interest due to the economical and environmental sustainability of this water treatment method.