



## Load Frequency Control in Microgrids using target adjusted Model Predictive Control

Banis, Frederik; Guericke, Daniela; Madsen, Henrik; Poulsen, Niels

*Published in:*  
IET Renewable Power Generation

*Link to article, DOI:*  
[10.1049/iet-rpg.2019.0487](https://doi.org/10.1049/iet-rpg.2019.0487)

*Publication date:*  
2019

*Document Version*  
Peer reviewed version

[Link back to DTU Orbit](#)

*Citation (APA):*  
Banis, F., Guericke, D., Madsen, H., & Poulsen, N. (2019). Load Frequency Control in Microgrids using target adjusted Model Predictive Control. *IET Renewable Power Generation*, 14(1), [118]. <https://doi.org/10.1049/iet-rpg.2019.0487>

---

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

# Load Frequency Control in Microgrids using target adjusted Model Predictive Control

Frederik Banis\*, Daniela Guericke\*, Henrik Madsen\*, Niels Kjølstad Poulsen\*  
 \*DTU Compute, Technical University of Denmark

**Abstract**—Model Predictive Control (MPC) has been applied in multiple ways to the Load Frequency Control problem. In this paper we illustrate and compare a target adjusted MPC to a classical MPC formulation. The target adjusted approach is also posed as optimal control law. The target adjusted MPC is an alternative formulation that incorporates the system equilibrium into the control objective. The derived alternative controller can be used as alternative to classical MPCs.

**Index Terms**—Predictive Control, Load Frequency Control, Active Power Control, Disturbance Observer, Real-Time Systems

TABLE I  
 NOMENCLATURE.  $\langle / \rangle$  DENOTES UNSPECIFIED UNITS.

Symbol	Description	Unit
$u^*$	Optimal input sequence (Control variables)	pu
$\bar{u}$	Input reference trajectory	pu
$x$	System state	/
$\hat{x}$	One-step prediction of $x$	/
$\tilde{x}$	State target	/
$\bar{u}$	Control target	/
$\hat{d}$	Disturbance estimate	pu
$\hat{d}_e$	$\epsilon$ augmented disturbance estimate	/
$y$	Frequency deviation (Controlled variable)	pu
$\hat{y}$	One-step prediction of $y$	pu
$y_m$	Grid frequency measurement	Hz
$\epsilon$	Integrated output error	Hz
$\epsilon_A, \epsilon_B, \epsilon_{B_d}$	Multiplicative model-plant errors w.r.t. corresponding model parameters	/
$\tilde{p}$	System equilibrium	/
$w$	State error: Wiener process	/
$v$	Measurement error: White noise process	Hz
$\theta$	Model parameter vector	/
$\sigma, h$	Nonlinear model functions	/
$\omega$	Standard Wiener process	/
$T_s$	Controller sampling time	s
$N$	Prediction horizon	/
$L_x, L_d$	Kalman gain w.r.t. states and w.r.t. disturbance	/
$A, B, B_d, G,$ $E, C, D$	State Space System matrices	/
$\Phi_x$	Free Markov parameters	/
$\Gamma_u$	Forced Markov parameters (controlled)	/
$\Gamma_d$	Forced Markov parameters (uncontrolled)	/
$G, h$	Objective inequality coefficients, bounds	/
$K$	Optimal Control feedback gain	/
$K_\infty$	Lumped deduced disturbance gain	/
$K_{u,\infty}$	Disturbance gain to the system inputs	pu
$K_{x,\infty}$	Disturbance gain to the system states	/
$\Delta f$	Frequency deviation with respect to nominal frequency	Hz
$W_z$	Output space precision penalization	/
$W_{\Delta u}$	Rate of movement penalization	/
$W_{\bar{u}}$	Input reference tracking penalization	/
$\beta$	Tuning term: Input reference tracking	/
$H$	Inertia based supply time	s
$D$	Load damping coefficient	/

## I. INTRODUCTION

The increasing share of Renewable Energy Sources (RES) in the energy production mix is associated with considerable power production uncertainty. Remedies for the issue can be categorized into improvements of infrastructure and improvements of system controls. An approach enabling for the combination of the two categories is the concept of Microgrids (MGs) which makes it possible to unlock the flexibility required for integrating large shares of fluctuating RES. Coordinated control of controllable units within the MG enables for leveraging of synergies in an optimized manner, due to that the limited complexity of the confined system allows for the implementation of online optimization control strategies at a high degree of precision in the controls. An example for such control strategy is Model Predictive Control (MPC). The system operation and resilience can then be improved amongst others by inclusion of information of uncertain processes in the form of forecasts, for example with respect to the uncertainty associated with RES. Furthermore, this facilitates the use of the MG as a virtual and flexible power plant which enhances the possibilities of unlocking the flexibility required to comply with agreed market bids.

Designing controls for virtual power plants involves the setup of a control structure with consideration of complexity and system dynamics. Incorporation of predictions of stochastic processes introduce complexity due to the combinatorial explosion of manifold process outcomes. In contrary, fast system control loops require prompt decision making. Handling problem complexity in this setting and simultaneously providing sufficient sampling rates of well-posed control signals constitute two major challenges associated with the optimized control of MGs with high shares of RES. This problem complexity is usually handled by the setup of a temporal control hierarchy — the problem complexity is then managed by several specialized control routines [Sch78]. See Figure 1 as illustration of this principle. Control hierarchies are also considered in related areas such as ancillary services provision [DZ+18; Mad+14].

The control structure that evolved historically in the context of frequency control is split into a primary frequency control loop, a secondary frequency control loop and a tertiary frequency control loop. The primary controls hereby serve for the stabilization of the system frequency after a disturbance within delay of a few seconds. Secondary control initiates its compensation to such event in the magnitude of some seconds

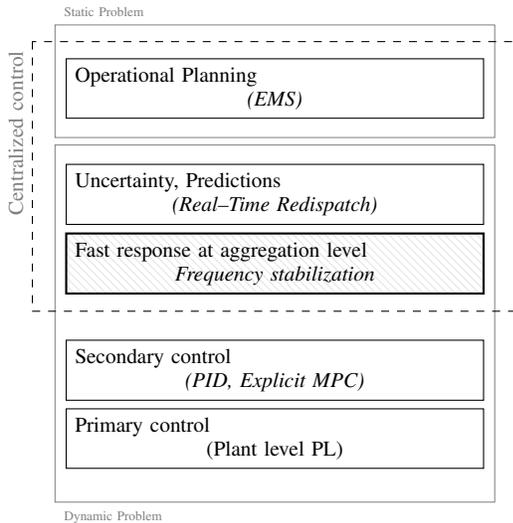


Fig. 1. Exemplary hierarchy of controllers in the centralized control scheme and their associated dominant focus. An operational planning layer takes long-term predictions and complex system requirements in the planning stage into account. The real-time redispatch adjusts the system operation to altered requirements during operation. Scope of this paper: The frequency stabilization problem at the aggregated system level (centralized controls).

to minutes. Tertiary control covers a longer temporal window [Bev14; Kun94].

TABLE II  
ABBREVIATIONS.

RES	Renewable Energy Systems
LFC	Load Frequency Control
AGC	Automatic Generation Control
MG	Microgrid
MPC	Model Predictive Control
OC	Optimal Control
LQG	Linear Quadratic Gaussian regulator
CL	Closed Loop
MISO	Multiple-Input Single-Output
SDE	Stochastic Differential Equation
c0	Classic quadratic regulator formulation
c1	Target adjusted regulator formulation

[Per+17; Par+16; Han+14] are examples where the optimization problem for the aggregated MG system is posed with a sampling rate in the magnitude of multiple minutes. Consequently, they act on the tertiary control layer. Stochastic Programming formulations are typically used for such problems, due their capability to treat uncertainty associated with process predictions. [Pan+13b; Sha+09; Sha+17] provide literature overview over the topic of Load Frequency Control (LFC) and Automatic Generation Control (AGC). For the secondary control problem many solution approaches have been proposed, including optimal control [Cal72; Bar73; Fos+70; Zha+13] or adaptive controllers and robust controllers [Sir+10; Wan+94]. Often, these approaches are combined with state observers [Yam+86] and system identification techniques [Hai+00]. Proactive action in the LFC can improve its performance and MPC is a control strategy enabling for it. Examples

can be found in [Ers+16; Ven+08; Shi+13]. In this paper we illustrate an MPC formulation for LFC based on [Pan+03; Gon+08]. To the best of our knowledge this controller has not yet been presented for the LFC problem. An Optimal Controller (OC) using the same approach is also presented. The control problem is stated here in the context of MG LFC but can be applied to different problems alike. This paper does not consider a thorough treatment of the underlying control theory — it can be obtained by consideration of, among others, [Pan+03; Gon+08].

## II. MODELS

We consider the swing equation [Ben15; Bev14; Kun94] as our main state in the controller model:

$$\frac{d}{dt} \Delta f(t) = -\frac{D}{2H} \Delta f(t) + \frac{1}{2H} \Delta P_{\text{mech}}(t) \quad (1)$$

$\Delta f$  denotes the frequency deviation from nominal frequency,  $D$  is the load damping coefficient and  $H$  the inertia based supply time.  $\Delta P_{\text{mech}}$  is the power balance within the grid. The model maps the overall power imbalance to an angular frequency deviation from the nominal grid frequency by taking the approximated system inertia into account. The swing equation is a means to express the lumped system inertia and its parameters are both unknown and time-varying. Consequently adaptive estimation techniques [Ulb+14] should be applied in order to obtain a precise model for varying conditions.

The considered underlying processes are nonlinear and can be modeled using Stochastic Differential Equations (SDEs) such as formulated for example in [Kri+04]:

$$dx_t = f(x_t, u_t, t, \theta) dt + \sigma(u_t, t, \theta) d\omega_t \quad (2)$$

$$y_k = h(x_k, u_k, t_k, \theta) + v_k \quad (3)$$

where  $t$  is the time variable;  $t_k$  are sampling instants;  $x_t$  is a vector of system states with the main state being the frequency deviation from nominal frequency  $\Delta f$ ;  $u_t$  is a vector of input variables;  $y_k$  is the single output variable and equals the main state  $\Delta f$ ;  $\theta$  is a vector of parameters;  $f$ ,  $\sigma$  and  $h$  are nonlinear functions;  $\omega_t$  is a standard Wiener process and  $v_k$  is a white noise process with  $v_k \in \mathcal{N}(0, S(u_k, t_k, \theta))$ . See [Kri+04] for further clarifications and details of this formulation.

All used system models are linearized, enabling the application of linear control theory. The power balance is obtained by using lumped system models — groups of actors sharing dominant dynamics and requirements are hereby lumped together, resulting in a reduced order model. See in this context [Ers+16; Sax19]. The accepted loss in precision of this reduced model compared to the untreated linear system model is a design choice and has to be traded against the gained reduction in computational load in the optimization step. The linearized discrete time system model can be formulated as stated in Equation 4, see [Kri+04].

$$\frac{dx_{t|j}}{dt} = f_0 + A(x_t - x_j) + B(u_t - u_j) + G(d_t - d_j) + w_t \quad (4a)$$

$$y_t = Cx_t + e_t \quad (4b)$$

$x$  is the system state;  $u$  the controlled system input,  $d$  the uncontrolled system input (disturbance).  $w$  and  $e$  are process and measurement noise respectively. This is a multiple-inputs single-output (MISO) system if more than one unit in the MG are considered.

### III. TARGET ADJUSTED DLQR

The feedback control law of the classical DLQR is commonly formulated as

$$u_k^* = -K\hat{x}_{k|k} \quad (5)$$

Whereas the target adjusted DLQR can be stated as

$$u_k^* = K(\hat{x}_{k|k} - \tilde{x}_{k|k}) - \tilde{u}_{k|k} \quad (6)$$

$K$  is hereby found by solving the discrete-time algebraic Riccati equation [VD81; Lau78]. The equilibrium operating point of the system can be stated in terms of the input and state of the system  $\tilde{p}$ .  $\tilde{p}$  can be linearly related to the filtered lumped disturbance  $\hat{d}$ :

$$\tilde{p}_{k|k} = \{\tilde{x}_{k|k}, \tilde{u}_{k|k}\} = K_\infty \hat{d}_{k|k} \quad (7)$$

$K_\infty$  is a gain from a unit disturbance to one corresponding system equilibrium point. Scaling by the estimate  $\hat{d}$  recovers another system equilibrium corresponding to  $\hat{d}$ .  $K_\infty$  can be obtained using a least-squares approximation, due to that the lumped system matrix  $M$  for the considered systems is non-symmetric in the MISO case:

$$\overbrace{\begin{bmatrix} A-I & B \\ C & 0 \end{bmatrix}}^M \overbrace{\begin{bmatrix} K_{x,\infty} \\ K_{u,\infty} \end{bmatrix}}^{K_\infty} = \begin{bmatrix} B_d \\ 0 \end{bmatrix} \quad (8)$$

This approach is outlined in [Mus+93; Pan+03] and related approaches have been applied e.g. in [Huu+10]. Notice that the system of equations denoted in Equation 8 has to be solved once for each model formulation.  $B_d$  hereby denotes the lumped modeled disturbance dynamics. Mismatch of  $B_d$  related to the real system dynamics lead to loss of controller performance. This loss of performance is then to be compensated for by application of appropriate robustness and adaptive control strategies which are not subject of this paper. For an ideal  $B_d$ , this regulator formulation achieves asymptotic stability in the controlled variable  $\Delta f$ .

#### A. Offset free frequency tracking

In order to drive the output  $f \rightarrow \bar{f}$ , where  $\bar{f}$  is the goal frequency and  $\bar{f} = f_{\text{nom}} + \Delta f$ , the control law Equation 5 can be augmented to include the integrated offset

$$\epsilon_{k+1|k} = \epsilon_{k|k} + \hat{y}_{k|k} - \bar{y}_k \quad (9)$$

$\hat{y}_{k|k}$  here is the output of the system model using the state estimate  $\hat{x}_{k|k}$  and  $\bar{y}_k = \Delta \bar{f}_k$ , the goal frequency deviation. The target Equation 7 then becomes

$$\tilde{p}_{k|k} = \{\tilde{x}_{k|k}, \tilde{u}_{k|k}\} = K_\infty(\epsilon_{k|k} + \hat{d}_{k|k}) \quad (10)$$

### IV. MODEL PREDICTIVE REGULATORS

#### A. Classic quadratic objective

The classic quadratic reference tracking objective can be stated as such:

$$\begin{aligned} \min_{u, k} J_0 = & \|\Phi_x \hat{x}_{k|k} + \Gamma_u u_k + \Gamma_d \hat{d}_{k|k} - \tilde{y}_k\|_{W_z}^2 \\ & + \beta \|u_k\|_{W_{\Delta u}}^2 \\ & + (1 - \beta) \|u_k - \bar{u}_{k|k}\|_{W_{\bar{u}}}^2 \end{aligned} \quad (11)$$

Notice that we could neglect the control action regularization term  $\|u_k\|_{W_{\Delta u}}^2$  in the case where we use a Kalman filter as smoothing component in the control loop.  $\beta$  is a tuning term used to gradually move the controller from regulatory behavior *without* input reference tracking ( $\beta = 1$ ) to regulatory behavior *with* input reference tracking ( $\beta = 0$ ). If offset-free control in the controlled variable  $\Delta f$  is aimed for,  $\hat{d}$  can be augmented with the integrated error in the controlled variable  $\epsilon$ . Then,  $d_e$  is used instead of  $d$ . In this case,  $\tilde{y} = 0$ . See for example [Huu+11].

$$\hat{d}_{e,k|k} = \hat{d}_{k|k} + \epsilon_k \quad (12)$$

$$\epsilon_{k+1|k} = \epsilon_{k|k} + \hat{y}_{k|k} - \bar{y}_k \quad (13)$$

Then

$$\tilde{y}_k = 0 \quad (14)$$

Alternatively, offset-free control can be achieved by using the following integrating term in the objective function:

$$\tilde{y}_{k+1|k} = \tilde{y}_{k|k} + \hat{y}_{k|k} - \bar{y}_k \quad (15)$$

A mismatch in the disturbance-associated model dynamics  $\Gamma_d$  can lead to loss of performance in the controlled variables.

#### B. Target adjusted quadratic objective

The target adjusted approach discussed in Section III can be applied in the MPC framework using

$$\begin{aligned} \min_{u, k} J_1 = & \|\Phi_x(\hat{x}_{k|k} - \tilde{x}_{k|k}) + \Gamma_u(u_k - \tilde{u}_{k|k}) - \bar{y}_k\|_{W_z}^2 \\ & + \beta \|u_k - u_{k-1}^*\|_{W_{\Delta u}}^2 \\ & + (1 - \beta) \|u_k - \bar{u}_{k|k}\|_{W_{\bar{u}}}^2 \end{aligned} \quad (16)$$

Again  $\beta$  denotes a tuning term used to switch the controller from regulatory behavior without input reference tracking to regulatory behavior with input reference tracking. Hereby, the target Equation 7 is used. A similar regulator implementation can be found in [Ban+18].

### C. Constraints

Hard input constraints and ramp-rate constraints for both MPCs can be formulated as

$$u_{\min,k} \leq u_k \leq u_{\max,k} \quad (17)$$

$$\Delta u_{\min,k} \leq \Delta u_k \leq \Delta u_{\max,k} \quad (18)$$

$$G_k u_k \leq h_k \quad (19)$$

[Jør+11] include examples of hard input constraint and ramp-rate constraint formulations.

## V. STATE OBSERVER

We estimate the residual  $\hat{d}$  using a Kalman filter following the formulations given in [Pan+01; Pan+03]. The augmented system model with integrating disturbance estimate and filter equations is then given by:

$$\begin{bmatrix} \hat{x}_{k+1|k} \\ \hat{d}_{k+1|k} \end{bmatrix} = \begin{bmatrix} A & B_d \\ 0 & I \end{bmatrix} \begin{bmatrix} \hat{x}_{k|k-1} \\ \hat{d}_{k|k-1} \end{bmatrix} + \begin{bmatrix} B \\ 0 \end{bmatrix} u_k + \begin{bmatrix} L_x \\ L_d \end{bmatrix} (y_{m,k|k-1} - C\hat{x}_{k|k-1} - C_d\hat{d}_{k|k-1}) \quad (20)$$

where  $y_m$  is the local grid frequency measurement. This is the one-step predictor of both estimated state  $\hat{x}$  and disturbance  $\hat{d}$ . Notice that  $\hat{d}$  hereby is a lumped disturbance capturing any mismatch between desired and effective input-output relation. As improvement to this approach an Extended Kalman Filter can be used as stated for example in [Kri+04], in order to achieve faster convergence and to estimate the uncertainty  $P_d$  of the disturbance as well.

The performance of this filter affects the control performance. See [Huu+10] for additional applications.

## VI. PREDICTIONS

The classical MPC formulation stated in Equation 11 incorporates the disturbance prediction sequence  $\hat{d}_{k+N|k}$  via the disturbance impulse response coefficients  $\Gamma_d$ . The discussed target adjusted DLQR and MPC formulations, Equation 5 and Equation 16, do not have this capability. However, they can incorporate an expected future state of the disturbance process  $\hat{d}_{k+j|k}$ . The predictive performance of using this approach versus consideration of the full disturbance prediction sequence consequently is lower in most cases.

## VII. TUNING

For the discussed controllers — as generally for OC and MPC — a multitude of tuning opportunities do exist. Tuning is then most commonly a recursive process in which the controlled parameters are adjusted such as to comply for example with network standards [Eur13].

Soft output constraints are one means to adjust the CL performance. In the context of the LFC problem, soft output constraints allow, for example, for tailoring of the objective in order to more aggressively aim for frequency stabilization outside of the specified frequency band. For soft output constraints and a MISO system, a set of  $2N$  slack variables are introduced into the optimization problem,  $N$  being the prediction horizon in the presented control objectives. This leads to a computationally more demanding formulation. See e.g. [Gur+09].

Another important CL system property for the LFC problem is the capability to balance between variance in the controlled variable and variance of the control variables. The latter is often referred to as control effort. The control effort hereby is to be tuned in order to distribute the regulatory share and balance the wear and tear in the set of system actors, see e.g. [Huu+10]. As discussed in [Ers+16], the control effort tuning can be augmented to include economical weights — prices which inform the control law about how to distribute the control effort. Due to the mixing of operational and economical considerations in the resulting objective, this is a sub-optimal treatment of economical aspects.

When using controllers within a control hierarchy, input reference tracking is required. The corresponding tracking precision selection is adjusted by tuning of the penalization matrix  $W_{\bar{u}}$ . Both  $W_{\Delta u}$  and  $W_{\bar{u}}$  are hereby selected by some tuning method: Genetic Algorithms (GA) [Pan+13a] is an example for such method.

As generally in context of MPC, online system identification techniques, incorporation of adaptive measures and robustness considerations should be considered in order to compensate for unmodeled uncertainty. Such methods may be applied for the discussed target adjusted controller as well.

## VIII. SIMULATIONS

Consider the test system as shown in Equation 21 and the constraints given in Equation 22. It consists of

- Swing equation parameterized with  $D = 1.5$  and  $H = 6.0$  as stated in Equation 1
- Actors (control inputs  $U_0, U_1, U_2$  respectively):
  - Tie-line dynamics
  - Two generators including turbine and governor dynamics

then Control inputs are chosen based on the documented control laws. The system exposes the poles and zeroes illustrated in Figure 2. The dynamics are selected in order to reflect a simple multi-actor system with a reasonable range of dynamics, see Table III.

$$A = \begin{bmatrix} 0.7165 & 0.0265 & 0.0165 & 0.2146 & 0.0087 & 0.1125 & 0.0775 \\ 0.0 & 0.7165 & 0.0 & 0.0 & 0.0 & 0.0 & 0.0 \\ 0.0 & 0.0 & -0.0066 & -0.0825 & 0.0 & 0.0 & 0.0 \\ 0.0 & 0.0 & 0.066 & 0.8253 & 0.0 & 0.0 & 0.0 \\ 0.0 & 0.0 & 0.0 & 0.0 & -0.0036 & -0.0454 & 0.0 \\ 0.0 & 0.0 & 0.0 & 0.0 & 0.0727 & 0.9085 & 0.0 \\ 0.0 & 0.0 & 0.0 & 0.0 & 0.0 & 0.0 & 0.1353 \end{bmatrix} \quad (21a)$$

$$B = \begin{bmatrix} 0.0297 & 0.0173 & 0.0089 \\ 1.7008 & 0.0 & 0.0 \\ 0.0 & 0.066 & 0.0 \\ 0.0 & 0.1397 & 0.0 \\ 0.0 & 0.0 & 0.0727 \\ 0.0 & 0.0 & 0.1464 \\ 0.0 & 0.0 & 0.0 \end{bmatrix} \quad (21b)$$

$$C = [1.0 \ 0.0 \ 0.0 \ 0.0 \ 0.0 \ 0.0 \ 0.0] \quad (21c)$$

$$D = [0.0 \ 0.0 \ 0.0] \quad (21d)$$

$$\begin{bmatrix} -0.5 \\ 0.0 \\ 0.0 \end{bmatrix} \leq u \leq \begin{bmatrix} 0.5 \\ 0.2 \\ 0.3 \end{bmatrix} \quad (22a)$$

$$\begin{bmatrix} -0.02 \\ -0.01 \\ -0.01 \end{bmatrix} \leq \Delta u \leq \begin{bmatrix} 0.08 \\ 0.005 \\ 0.0025 \end{bmatrix} \quad (22b)$$

TABLE III  
TEST SYSTEM STEP-RESPONSE CHARACTERISTICS OBTAINED USING MATLAB.

Step-response characteristic / unit	Swing	Tie-line	Gen. 1	Gen. 2
Rise time (s)	18.00	12.00	22.00	44.00
Settling time (s)	32.00	24.00	40.00	80.00
Settling min. (p.u.)	0.6119	0.9030	0.9086	0.9089
Settling max. (p.u.)	0.6667	1.00	1.00	0.9999
Overshoot (%)	0.00	0.00	0.00	0.00
Undershoot (%)	0.00	0.00	0.00	0.00
Peak (p.u.)	0.6667	1.00	1.00	0.9999
Peak time (s)	138.00	138.00	158.00	198

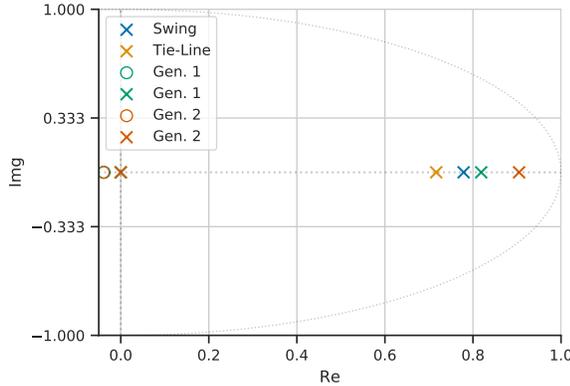


Fig. 2. Poles-Zeroes map of the considered test system (swing equation Swing, tie-line dynamics Tie-Line, generator dynamics 1 and 2, Gen. 1 and Gen. 2 respectively). Both Gen. 1 and Gen. 2 have a pole at the origin and a zero in the left-half plane.

All systems are discretized using the zero-order hold approach with sampling rate of 2 seconds. The sampling rate here is chosen arbitrarily. The online optimization problems are solved using the GUROBI solver [Gur18]. The solution to the least-squares problem is obtained using the LAPACK GELSD driver [And+99]. Load data time-series is obtained

from [Ope]. The classical MPC stated in Section IV-A is in the following referred to as  $c_0$ , the target adjusted MPC stated in Section IV-B is referred to as  $c_1$ .

We aim to test for:

- Whether  $c_1$  is capable of stabilizing the system frequency
- Whether constraints and penalization matrices have the desired effect on the CL system for  $c_1$
- How  $c_1$  compares to  $c_0$  in terms of sensitivity to model uncertainties

Notice that in all presented simulations no disturbance predictions are used. Given the presence of uncertainty compensated predictions, the response characteristics can be improved as a result to the proactive action of the two discussed controllers.

#### A. Disturbance rejection

$c_1$  is applied to the test system Equation 21 with control effort penalization  $\tilde{W}_{\Delta u}$  as stated in Equation 23 below and without enabled input reference tracking term.  $\tilde{W}_{\Delta u}$  are the first  $n_u \times n_u$  elements of  $W_{\Delta u}$ .

$$\tilde{W}_{\Delta u} = \begin{bmatrix} 1.0 & 0.0 & 0.0 \\ 0.0 & 0.05 & 0.0 \\ 0.0 & 0.0 & 1.0 \end{bmatrix} \quad (23)$$

The second generator (U1) resulting from  $W_{\Delta u}$  is penalized the least and is consequently most active in terms of control effort. See Figure 3. This penalization is exemplary for a real application where the operation of selected units is to be maintained mostly constant. Unit U1 saturates in the up-ramp event on the ramp-rate constraints and partly on the hard input bounds.

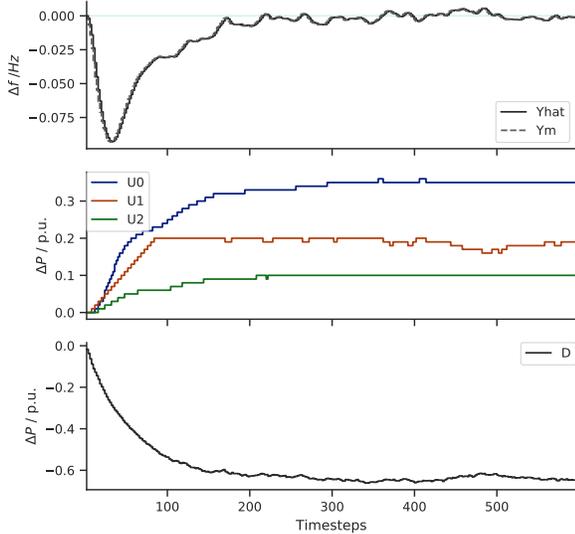


Fig. 3. Target adjusted MPC (c1). Uppermost graph: Frequency deviation from reference (main state and single output), middle graph: Control input deviations from reference, lowermost graph: disturbance deviation from reference (grid load). The control effort penalization depicted in Equation 23 lead to the stronger utilization of U1. Saturation on the ramp-rate constraints and hard bounds can be observed for U1.

### B. Input reference tracking

Another important property for the LFC problem is the tracking of input-references, illustrated in Figure 4.

All three units receive individual input trajectories with step changes applied at two time instances throughout the experiment. As disturbance the trajectory depicted in Figure 3 is used. For the time-range 350–600 an ill-posed trajectory is given to the controller: the summation of active power injection requests does not match the actual load. The controlled variable is nevertheless maintained close to its reference due to the chosen tracking penalization term  $W_{\bar{u}} = 1e^{-2}$ . For increasing  $W_{\bar{u}}$ , the tracking precision increases. Consequently, the performance in  $\Delta f$  deteriorates stronger for ill-posed input reference trajectories with increasing  $W_{\bar{u}}$ .

### C. Parametric system model mismatch

In Figure 5, c0 and c1 trajectories in  $\Delta f$  are compared for different multiplicative model-plant errors  $\epsilon_A$ ,  $\epsilon_B$ , and  $\epsilon_{B_d}$ . The disturbance trajectory given in Figure 3 without noise term is used to excite the system. It is to be noted that the sensitivity in the control effort penalization term  $W_{\Delta u}$  differs for the two controllers. Additional differences in the sensitivity to available means to tuning apply. Accordingly, trajectories

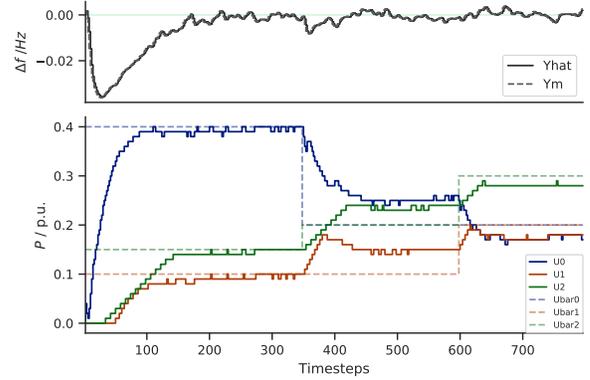


Fig. 4. Input reference tracking with c1 and  $W_{\bar{u}} = 1e^{-2}$ . The reference trajectories given from timestep 350–600 are a mismatch to the actual disturbance. As disturbance the trajectory given in Figure 3 is used.

should be considered and compared in qualitative rather than quantitative manner. Furthermore, only a selection of lumped multiplicative parametric mismatches are considered here in order to exhibit some differences in the two considered controllers. For all considered experiments the control laws remain asymptotically stable in  $\Delta f$ .

For  $\epsilon_A = 1.0$  the response of c1 is less aggressive. The opposite is true for  $\epsilon_A = 0.9$ . c1 oscillates for  $\epsilon_A = 0.8$ , the control law is then not sufficiently damped. The stabilization of c0 is slower for most of the corresponding trajectories, see the central graph in Figure 5. A dedicated plot for the mismatch in  $G$  is neglected here, due to that the resulting response characteristics are similar as for the already given multiplicative mismatch in  $B$  in the central graph. For  $\epsilon_{B_d} = 0.5$ , c0 overshoots. When the lumped filter disturbance dynamics  $B_d$  exceed the system disturbance dynamics  $G$  by a factor of 1.5 as shown in the lower-most graph, controller c1 exhibits a faster response.

## IX. DISCUSSION

The target adjusted MPC c1 based on LQG is an alternative solution to the LFC control problem. It exposes different properties compared to the classical MPC formulation c0. The response to perturbations in form of disturbance steps is comparatively damped; a characteristic that is non-desirable. As shown in Figure 5, tuning of the Kalman Filter can alter the response characteristics and lead to a more pronounced response in comparison to the classical MPC formulation c0. c1 in all considered simulations stabilizes  $\Delta f$  unidirectional, that is, asymptotically from a single deviation direction. c0, at least for the non-mismatch scenario, exposes the slight overshoot typical to OC and MPC — an often desirable property.

c1 has only predictive capabilities by using the expected disturbance considering the optimization horizon  $E(\hat{d}_{k+N|k})$ . c0 in contrast evaluates a potentially available disturbance prediction sequence  $\hat{d}_{k+N|k}$  directly within the objective function and consequently can achieve higher precision in the control

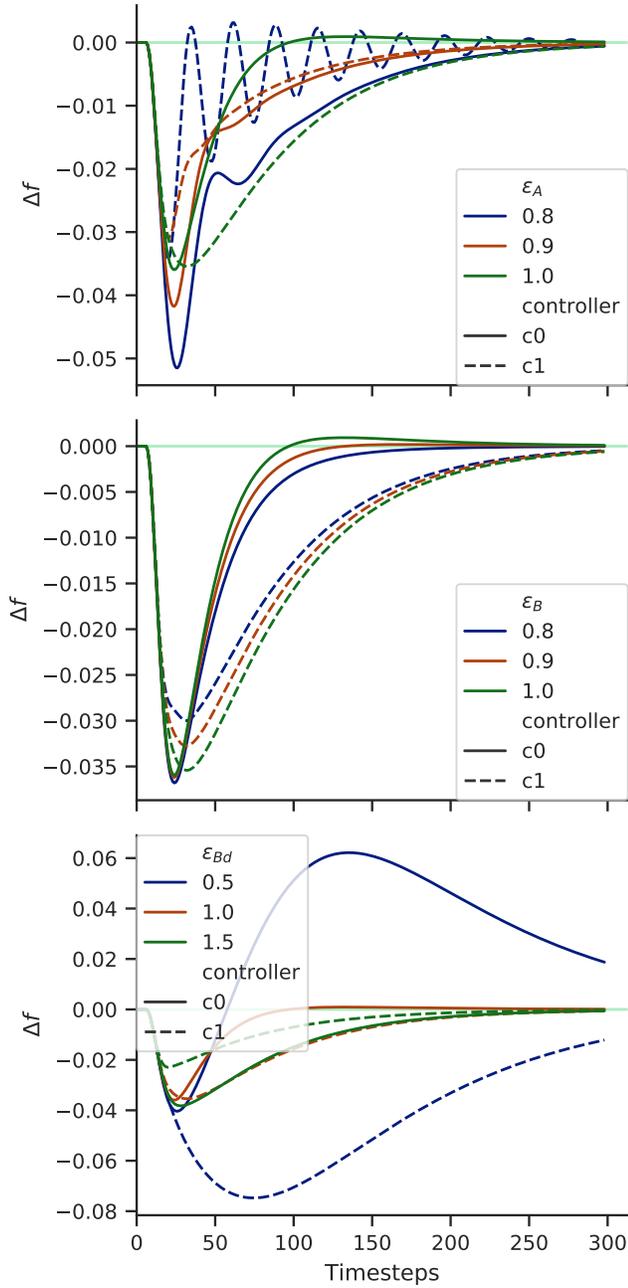


Fig. 5. Comparison of multiplicative lumped parametric mismatches of the free system response coefficients  $A$  ( $\epsilon_A$ ), forced system response coefficients  $B$  ( $\epsilon_B$ ) and lumped filter disturbance response coefficients  $B_d$  ( $\epsilon_{B_d}$ ). The disturbance trajectory given in Figure 3 without noise term is used.

decisions. Input reference tracking is successfully demonstrated in Figure 4, convergence to the imposed references hereby can be achieved with a chosen precision using the input reference tuning term  $W_{\bar{u}}$ .

## X. CONCLUSION

We present an alternative optimal control and model predictive control formulation for the LFC problem. To the best knowledge of the author, these control law formulations are applied in this control problem for the first time. The formulation is compared to a classical MPC. The approaches incorporate an approximated system equilibrium into the controller objective and gain from an estimated lumped disturbance. We show that the derived MPC controller can be used to stabilize the frequency using a three-actor system and that it can be used to track input references. The proposed MPC formulations may be utilized within existing control hierarchy concepts.

It is shown that the proposed formulation does not expose advantages compared to the classical MPC. However, it can be considered an alternative in approaching the problem and means to comparison of different regulator formulations and associated properties.

## XI. ACKNOWLEDGMENTS

This work has been supported by *ENERGINET.DK* under the project microgrid positioning - *uGRIP* and the *CITIES* project.

## REFERENCES

- [And+99] E. Anderson et al. *LAPACK Users' Guide: Third Edition*. en. SIAM, Jan. 1999.
- [Ban+18] Frederik Banis et al. "Utilizing Flexibility in Microgrids Using Model Predictive Control". In: *MedPower 2018*. Croatia, Nov. 2018.
- [Bar73] W. R. Barcelo. "Effect of Power Plant Response on Optimum Load Frequency Control System Design". In: *IEEE Transactions on Power Apparatus and Systems PAS-92.1* (Jan. 1973), pp. 254–258.
- [Bev14] Hassan Bevrani. *Robust Power System Frequency Control*. Power Electronics and Power Systems. Cham: Springer International Publishing, 2014.
- [Cal72] M. Calovic. "Linear Regulator Design for a Load and Frequency Control". In: *IEEE Transactions on Power Apparatus and Systems PAS-91.6* (Nov. 1972), pp. 2271–2285.
- [DZ+18] Giulia De Zotti et al. "Ancillary Services 4.0: A Top-to-Bottom Control-Based Approach for Solving Ancillary Services Problems in Smart Grids". en. In: *IEEE Access* 6 (2018), pp. 11694–11706.
- [Ers+16] A. M. Ersdal et al. "Model Predictive Load-Frequency Control". In: *IEEE Transactions on Power Systems* 31.1 (Jan. 2016), pp. 777–785.

- [Fos+70] C. E. Fosha et al. "The Megawatt-Frequency Control Problem: A New Approach Via Optimal Control Theory". In: *IEEE Transactions on Power Apparatus and Systems* PAS-89.4 (Apr. 1970), pp. 563–577.
- [Gon+08] A.H. González et al. "Conditions for Offset Elimination in State Space Receding Horizon Controllers: A Tutorial Analysis". en. In: *Chemical Engineering and Processing: Process Intensification* 47.12 (Nov. 2008), pp. 2184–2194.
- [Hai+00] Y. Hain et al. "Identification-Based Power Unit Model for Load-Frequency Control Purposes". In: *IEEE Transactions on Power Systems* 15.4 (Nov. 2000), pp. 1313–1321.
- [Han+14] Christian A. Hans et al. "Minimax Model Predictive Operation Control of Microgrids". In: *IFAC Proceedings Volumes*. 19th IFAC World Congress 47.3 (Jan. 2014), pp. 10287–10292.
- [Huu+10] J. K. Huusom et al. "Tuning of Methods for Offset Free MPC Based on ARX Model Representations". In: *Proceedings of the 2010 American Control Conference*. June 2010, pp. 2355–2360.
- [Huu+11] J. K. Huusom et al. "Adaptive Disturbance Estimation for Offset-Free SISO Model Predictive Control". In: *Proceedings of the 2011 American Control Conference*. San Francisco, CA, USA: IEEE, June 2011, pp. 2417–2422.
- [Jør+11] John Bagterp Jørgensen et al. "Finite Horizon MPC for Systems in Innovation Form". In: *Decision and Control and European Control Conference (CDC-ECC), 2011 50th IEEE Conference*. Orlando, USA: IEEE, 2011, pp. 1896–1903.
- [Kri+04] Niels Rode Kristensen et al. "Parameter Estimation in Stochastic Grey-Box Models". en. In: *Automatica* 40.2 (Feb. 2004), pp. 225–237.
- [Kun94] Kundur. *Power System Stability And Control*. en. McGraw-Hill, 1994.
- [Lau78] Alan J. Laub. "A Schur Method for Solving Algebraic Riccati Equations". eng. In: *Massachusetts Institute of Technology, Laboratory for Information and Decision Systems LIDS-R ; 859* (1978), pp. 44–46.
- [Mad+14] Henrik Madsen et al. "Control of Electricity Loads in Future Electric Energy Systems". In: *Handbook of Clean Energy Systems* 6 (2014), p. 63.
- [Mus+93] Kenneth R. Muske et al. "Model Predictive Control with Linear Models". en. In: *AIChE Journal* 39.2 (1993), pp. 262–287.
- [Ope] *Open Power System Data, ENTSO-E Transparency Platform*. English. 2018.
- [Pan+01] Gabriele Pannocchia et al. "Robustness of MPC and Disturbance Models for Multivariable III-Conditioned Processes". In: *TWMCC, Texas-Wisconsin Modeling and Control Consortium* (2001).
- [Pan+03] Gabriele Pannocchia et al. "Disturbance Models for Offset-Free Model-Predictive Control". In: *AIChE journal* 49.2 (2003), pp. 426–437.
- [Pan+13a] Sidhartha Panda et al. "Automatic Generation Control of Multi-Area Power System Using Multi-Objective Non-Dominated Sorting Genetic Algorithm-II". In: *International Journal of Electrical Power & Energy Systems* 53 (Dec. 2013), pp. 54–63.
- [Pan+13b] Shashi Kant Pandey et al. "A Literature Survey on Load-Frequency Control for Conventional and Distribution Generation Power Systems". en. In: *Renewable and Sustainable Energy Reviews* 25 (Sept. 2013), pp. 318–334.
- [Par+16] Alessandra Parisio et al. "Stochastic Model Predictive Control for Economic/Environmental Operation Management of Microgrids: An Experimental Case Study". In: *Journal of Process Control* 43 (July 2016), pp. 24–37.
- [Per+17] M. Pereira et al. "Robust Economic Model Predictive Control of a Community Micro-Grid". In: *Renewable Energy*. Special Issue: Control and Optimization of Renewable Energy Systems 100 (Jan. 2017), pp. 3–17.
- [Sax19] Sahaj Saxena. "Load Frequency Control Strategy via Fractional-Order Controller and Reduced-Order Modeling". en. In: *International Journal of Electrical Power & Energy Systems* 104 (Jan. 2019), pp. 603–614.
- [Sch78] F. C. Schweppe. "Power Systems '2000': Hierarchical Control Strategies". In: *IEEE Spectrum* 15.7 (July 1978), pp. 42–47.
- [Sha+09] H. Shayeghi et al. "Load Frequency Control Strategies: A State-of-the-Art Survey for the Researcher". en. In: *Energy Conversion and Management* 50.2 (Feb. 2009), pp. 344–353.
- [Sha+17] Ravi Shankar et al. "A Comprehensive State of the Art Literature Survey on LFC Mechanism for Power System". en. In: *Renewable and Sustainable Energy Reviews* 76 (Sept. 2017), pp. 1185–1207.
- [Shi+13] Mojtaba Shiroei et al. "A Functional Model Predictive Control Approach for Power System Load Frequency Control Considering Generation Rate Constraint: Functional MPC Approach For Power System LFC". en. In: *International Transactions on Electrical Energy Systems* 23.2 (Mar. 2013), pp. 214–229.
- [Sir+10] S. F. Siraj et al. "A Robust Adaptive Predictive Load Frequency Controller to Compensate for Model Mismatch". In: *2010 4th International Power Engineering and Optimization Conference (PEOCO)*. June 2010, pp. 33–37.
- [Ulb+14] Andreas Ulbig et al. "Impact of Low Rotational Inertia on Power System Stability and Opera-

- tion”. In: *IFAC Proceedings Volumes*. 19th IFAC World Congress 47.3 (Jan. 2014), pp. 7290–7297.
- [VD81] P. Van Dooren. “A Generalized Eigenvalue Approach for Solving Riccati Equations”. In: *SIAM Journal on Scientific and Statistical Computing* 2.2 (June 1981), pp. 121–135.
- [Ven+08] A. N. Venkat et al. “Distributed MPC Strategies With Application to Power System Automatic Generation Control”. In: *IEEE Transactions on Control Systems Technology* 16.6 (Nov. 2008), pp. 1192–1206.
- [Wan+94] Y. Wang et al. “New Robust Adaptive Load-Frequency Control with System Parametric Uncertainties”. In: *Transmission and Distribution IEE Proceedings - Generation* 141.3 (May 1994), pp. 184–190.
- [Yam+86] K. Yamashita et al. “Optimal Observer Design for Load-Frequency Control”. en. In: *International Journal of Electrical Power & Energy Systems* 8.2 (Apr. 1986), pp. 93–100.
- [Zha+13] C. Zhao et al. “Optimal Load Control via Frequency Measurement and Neighborhood Area Communication”. In: *IEEE Transactions on Power Systems* 28.4 (Nov. 2013), pp. 3576–3587.
- [Ben15] Benjamin Schäfer. “Decentral Smart Grid Control”. English. In: *New Journal of Physics*. New Journal of Physics 17.1 (2015).
- [Eur13] European Network of Transmission System Operators for Electricity. *The Network Code on Load-Frequency Control and Reserves*. English. June 2013.
- [Gur+09] Guru Prasath et al. “Soft Constraints for Robust MPC of Uncertain Systems”. In: *IFAC Proceedings Volumes (ifac-papersonline)*. 1st ser. 7 (2009), pp. 225–230.
- [Gur18] Gurobi Optimization. *Gurobi Optimizer Reference Manual*. Gurobi Optimization, LLC. 2018.