



Linking calculation of wakes from offshore wind farm cluster to the Danish power integration system

Larsén, X. G.; Volker, P.; Imberger, M.; Fischereit, J.; Koivisto, M.; Das, K.; Kanellas, P.; Sørensen, P.; Langor, E.; Duin, M.

Total number of authors:
18

Publication date:
2019

Document Version
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

Citation (APA):

Larsén, X. G., Volker, P., Imberger, M., Fischereit, J., Koivisto, M., Das, K., Kanellas, P., Sørensen, P., Langor, E., Duin, M., Hawkins, S., Maule, P., Ahsbahs, T., Du, J., Hahmann, A., Davis, N., Ott, S., & Badger, J. (2019). *Linking calculation of wakes from offshore wind farm cluster to the Danish power integration system*. Poster session presented at WindEurope Offshore 2019, Copenhagen, Denmark.

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Linking calculation of wakes from offshore wind farm cluster to the Danish power integration system

PO.160




X. G. Larsén¹(xgal@dtu.dk), P. Volker¹, M. Imberger¹, J. Fischereit¹, M. Koivisto¹, K. Das¹, P. Kanellas¹, P. Sørensen¹, E. Langor¹, M. Duin³, Kishore¹, S. Hawkins², P. Maule¹, T. Ahsbahs¹, J. Du¹, A. Hahmann¹, N. Davis¹, S. Ott¹, J. Badger¹

1: DTU Wind Energy; 2: Vattenfall; 3: Wageningen University

Abstract

For the first time, the Danish power integration system takes into account of wake effects from large offshore wind farm clusters. The wake effect was calculated through an innovative, mesoscale wind-wave-wake coupled modeling system developed at DTU Wind Energy Department.




Objectives

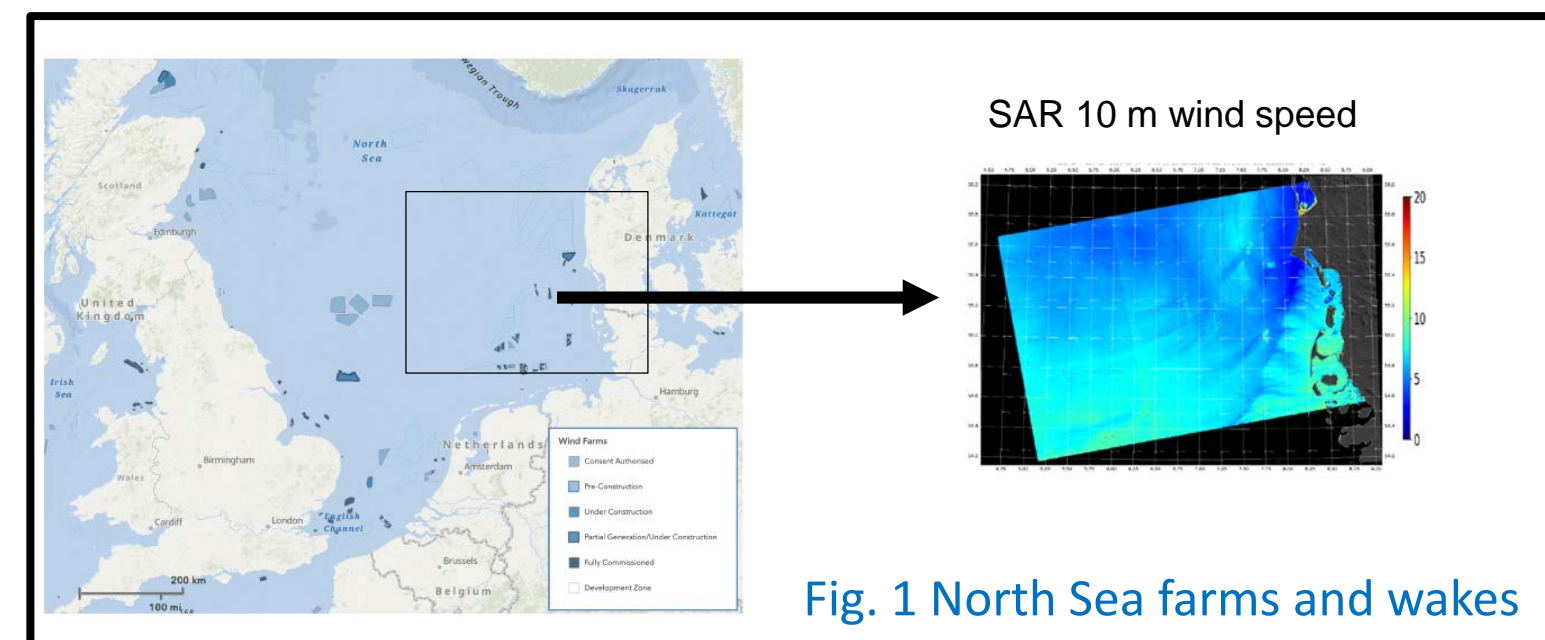

Offshore wind farm clusters are growing, see Fig. 1 for the crowdedness over part of the North Sea. Farms downwind of other farms suffer from reduced wind resource, namely the wake effect (e.g. Fig. 1). This farm-farm wake effect has never been taken into consideration in a power integration system.

In an offshore environment, winds interact with waves. This project also aims to answer how the interaction is between winds, waves, currents and wakes (Fig. 2, [1]), and how it will affect the power integration system. Eventually an optimized modeling system will be recommended for the offshore application.

Methods

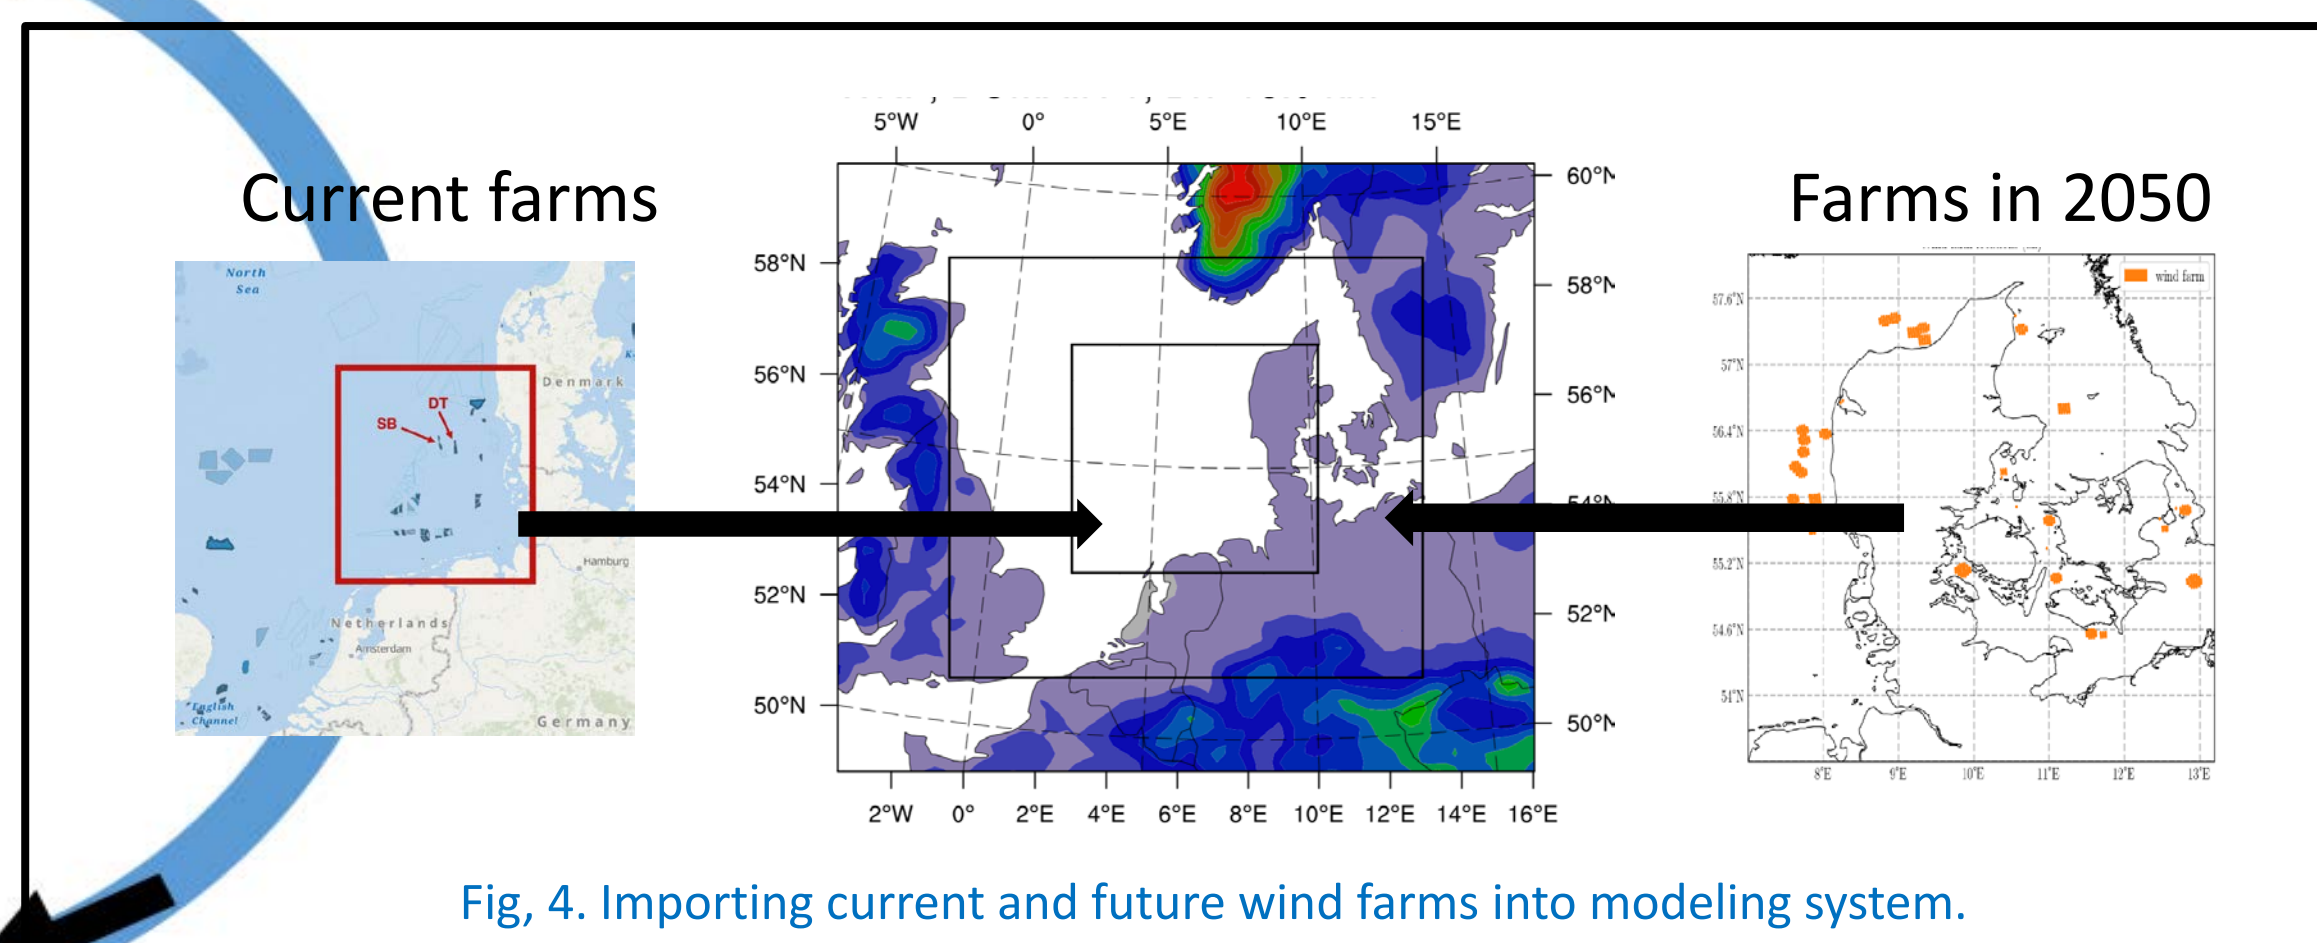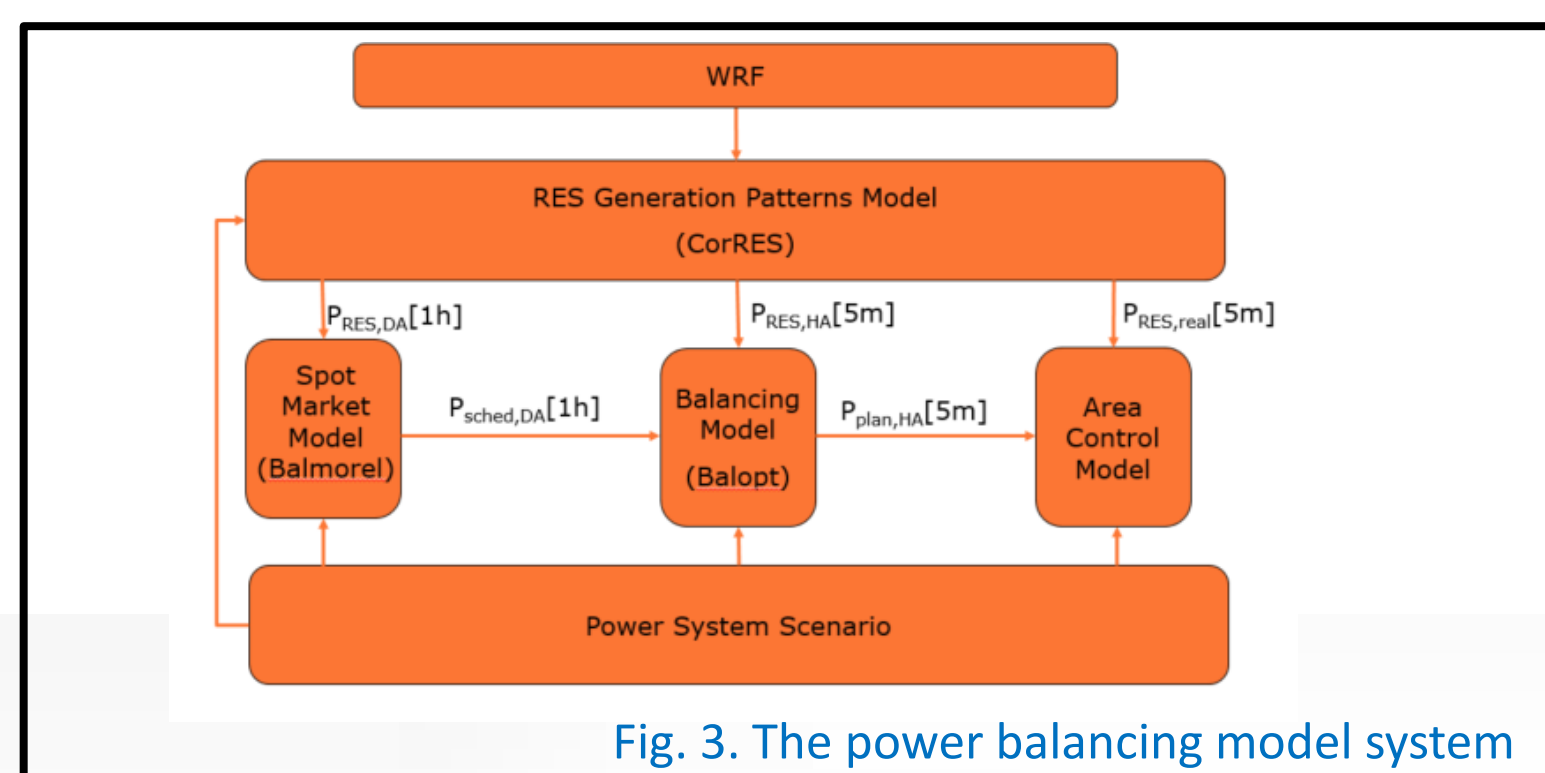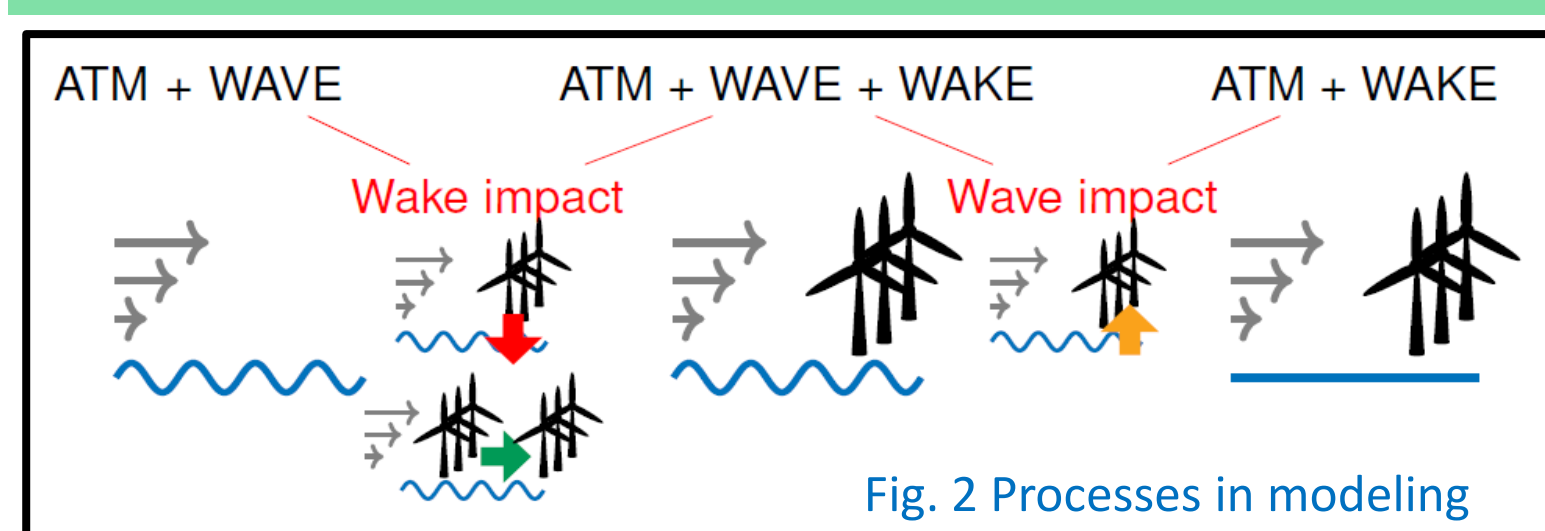

- Couple wind-wave-current-wake modeling (WRF-SWAN(WBLM)-ROMS-EWP/FITCH)[2,3]
- Power balancing model with coupled model input
- Long term modeling, using both climatologically representative year method [4] and statistical-dynamical downscaling method [1]
- For current, as well as future scenarios (2050)
- Calibration, verification and validation using measurements (SCADA at DanTysk (DT) and Sandbank (SB), numerous stations and SAR data)

Results

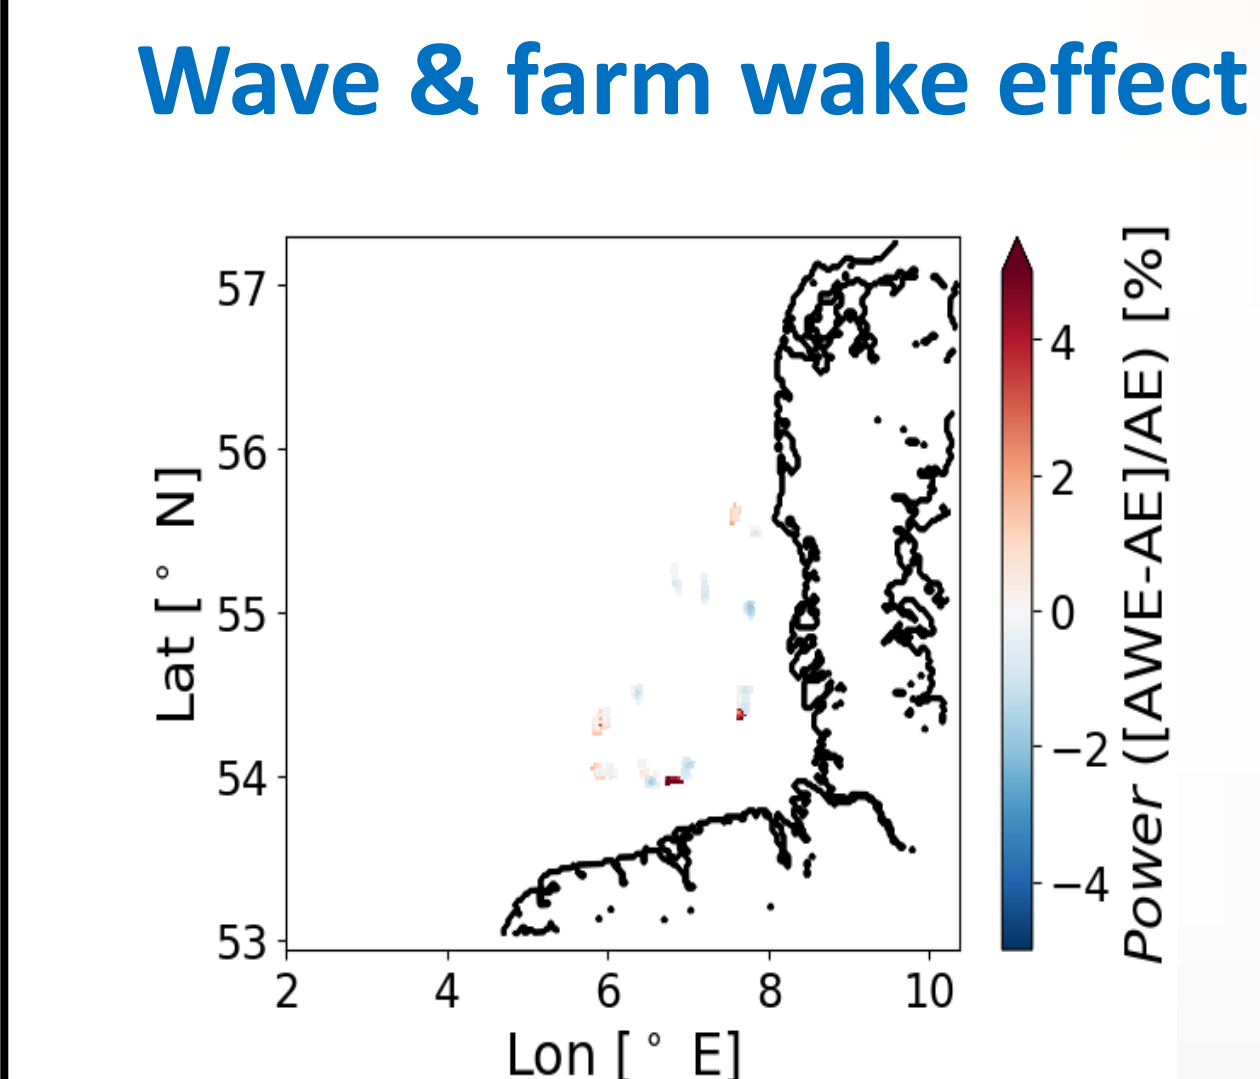
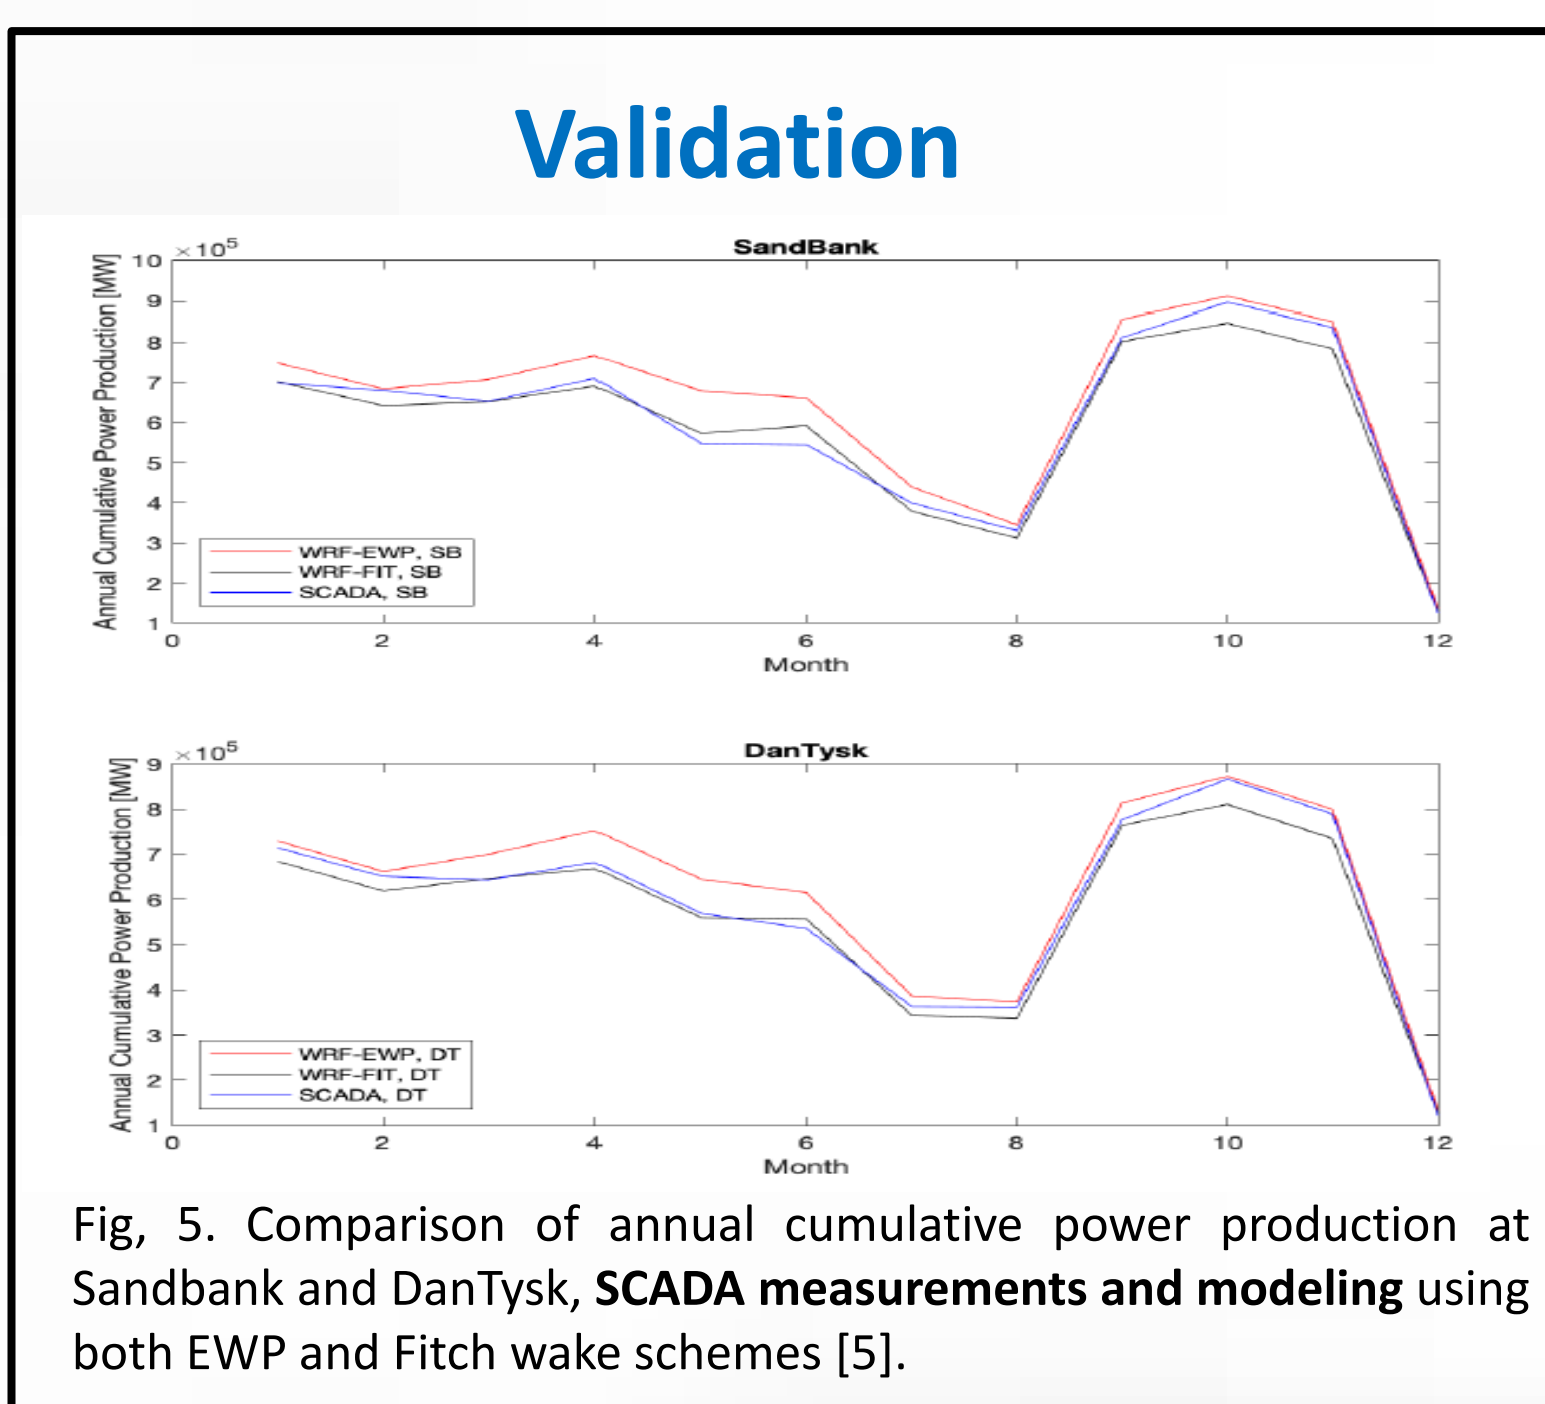


Fig. 6a. Long term wave effect on mean power production at wind farms using coupled model WRF-SWAN (WBLM)-EWP[1].

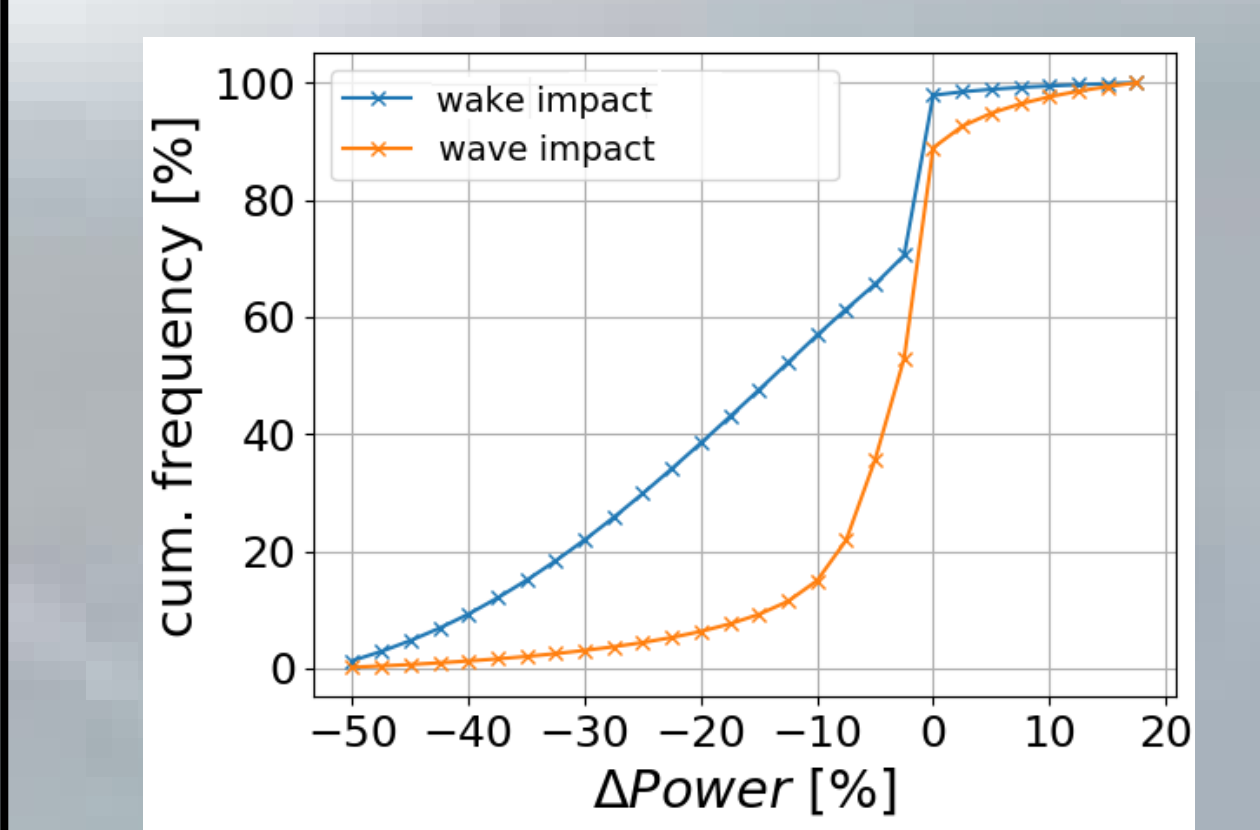


Fig. 6b. Cumulative frequency for changed power production due to wave and wake effect, respectively, using coupled model WRF-SWAN (WBLM)-EWP for current climate over domain in Fig6a[1].

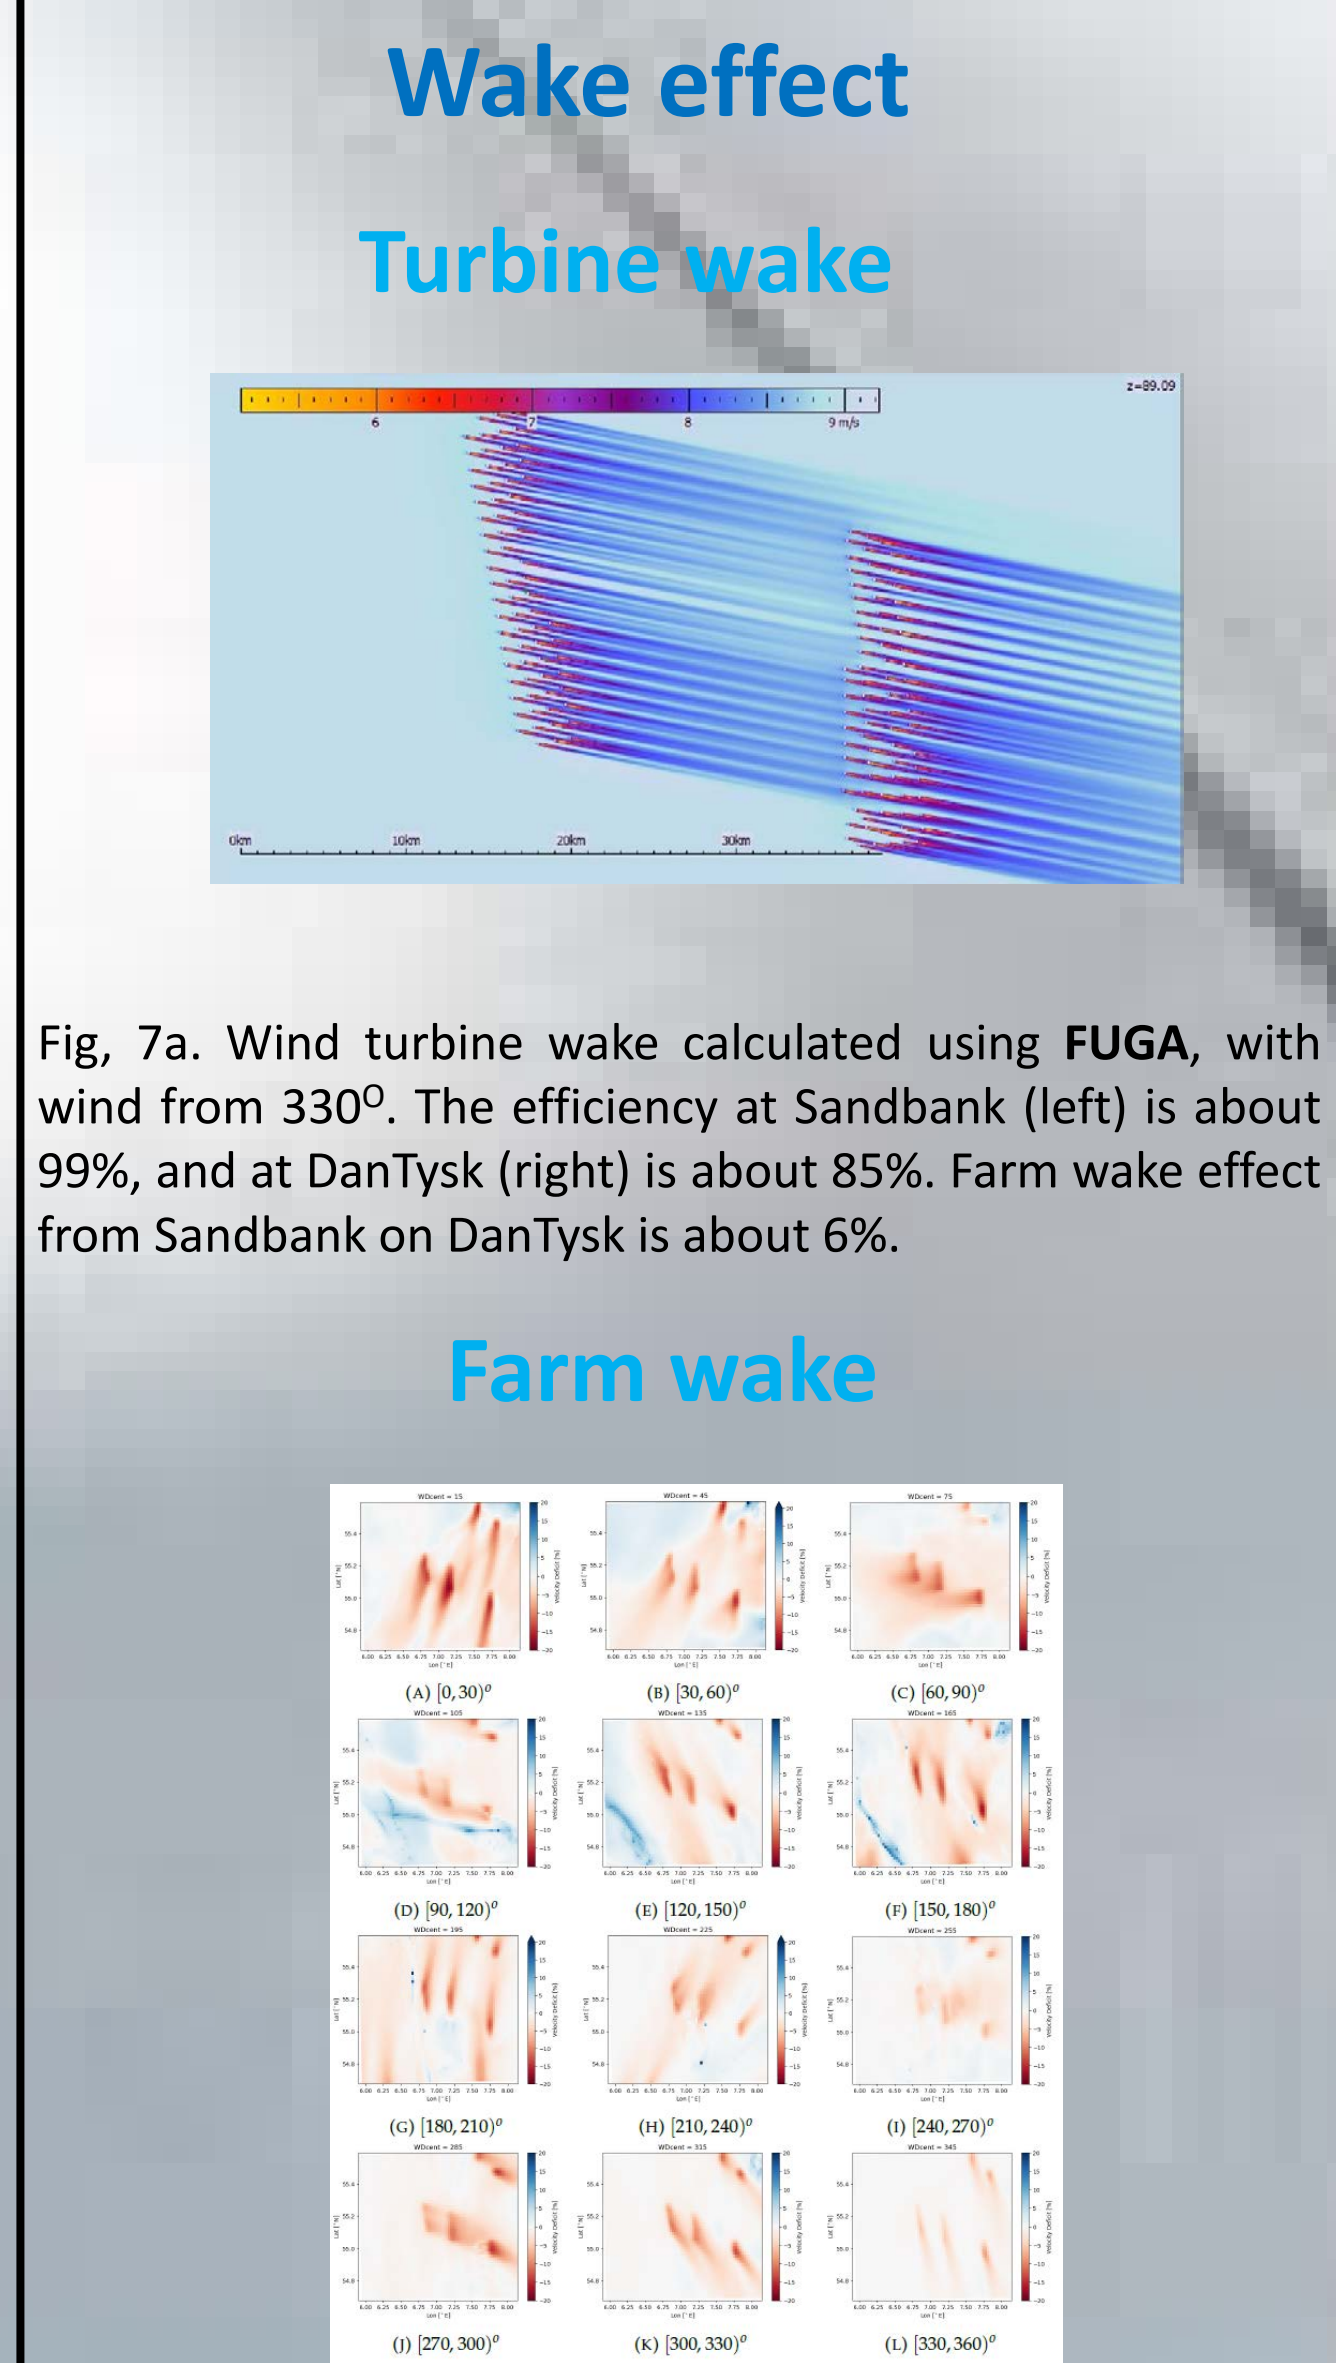


Fig. 7a. Wind turbine wake calculated using FUGA, with wind from 330°. The efficiency at Sandbank (left) is about 99%, and at DanTysk (right) is about 85%. Farm wake effect from Sandbank on DanTysk is about 6%.

Fig. 7b. Monthly mean wind speed deficit at hub height for May 2018 using Fitch scheme based on prevailing direction around Sandbank and DanTysk [5]

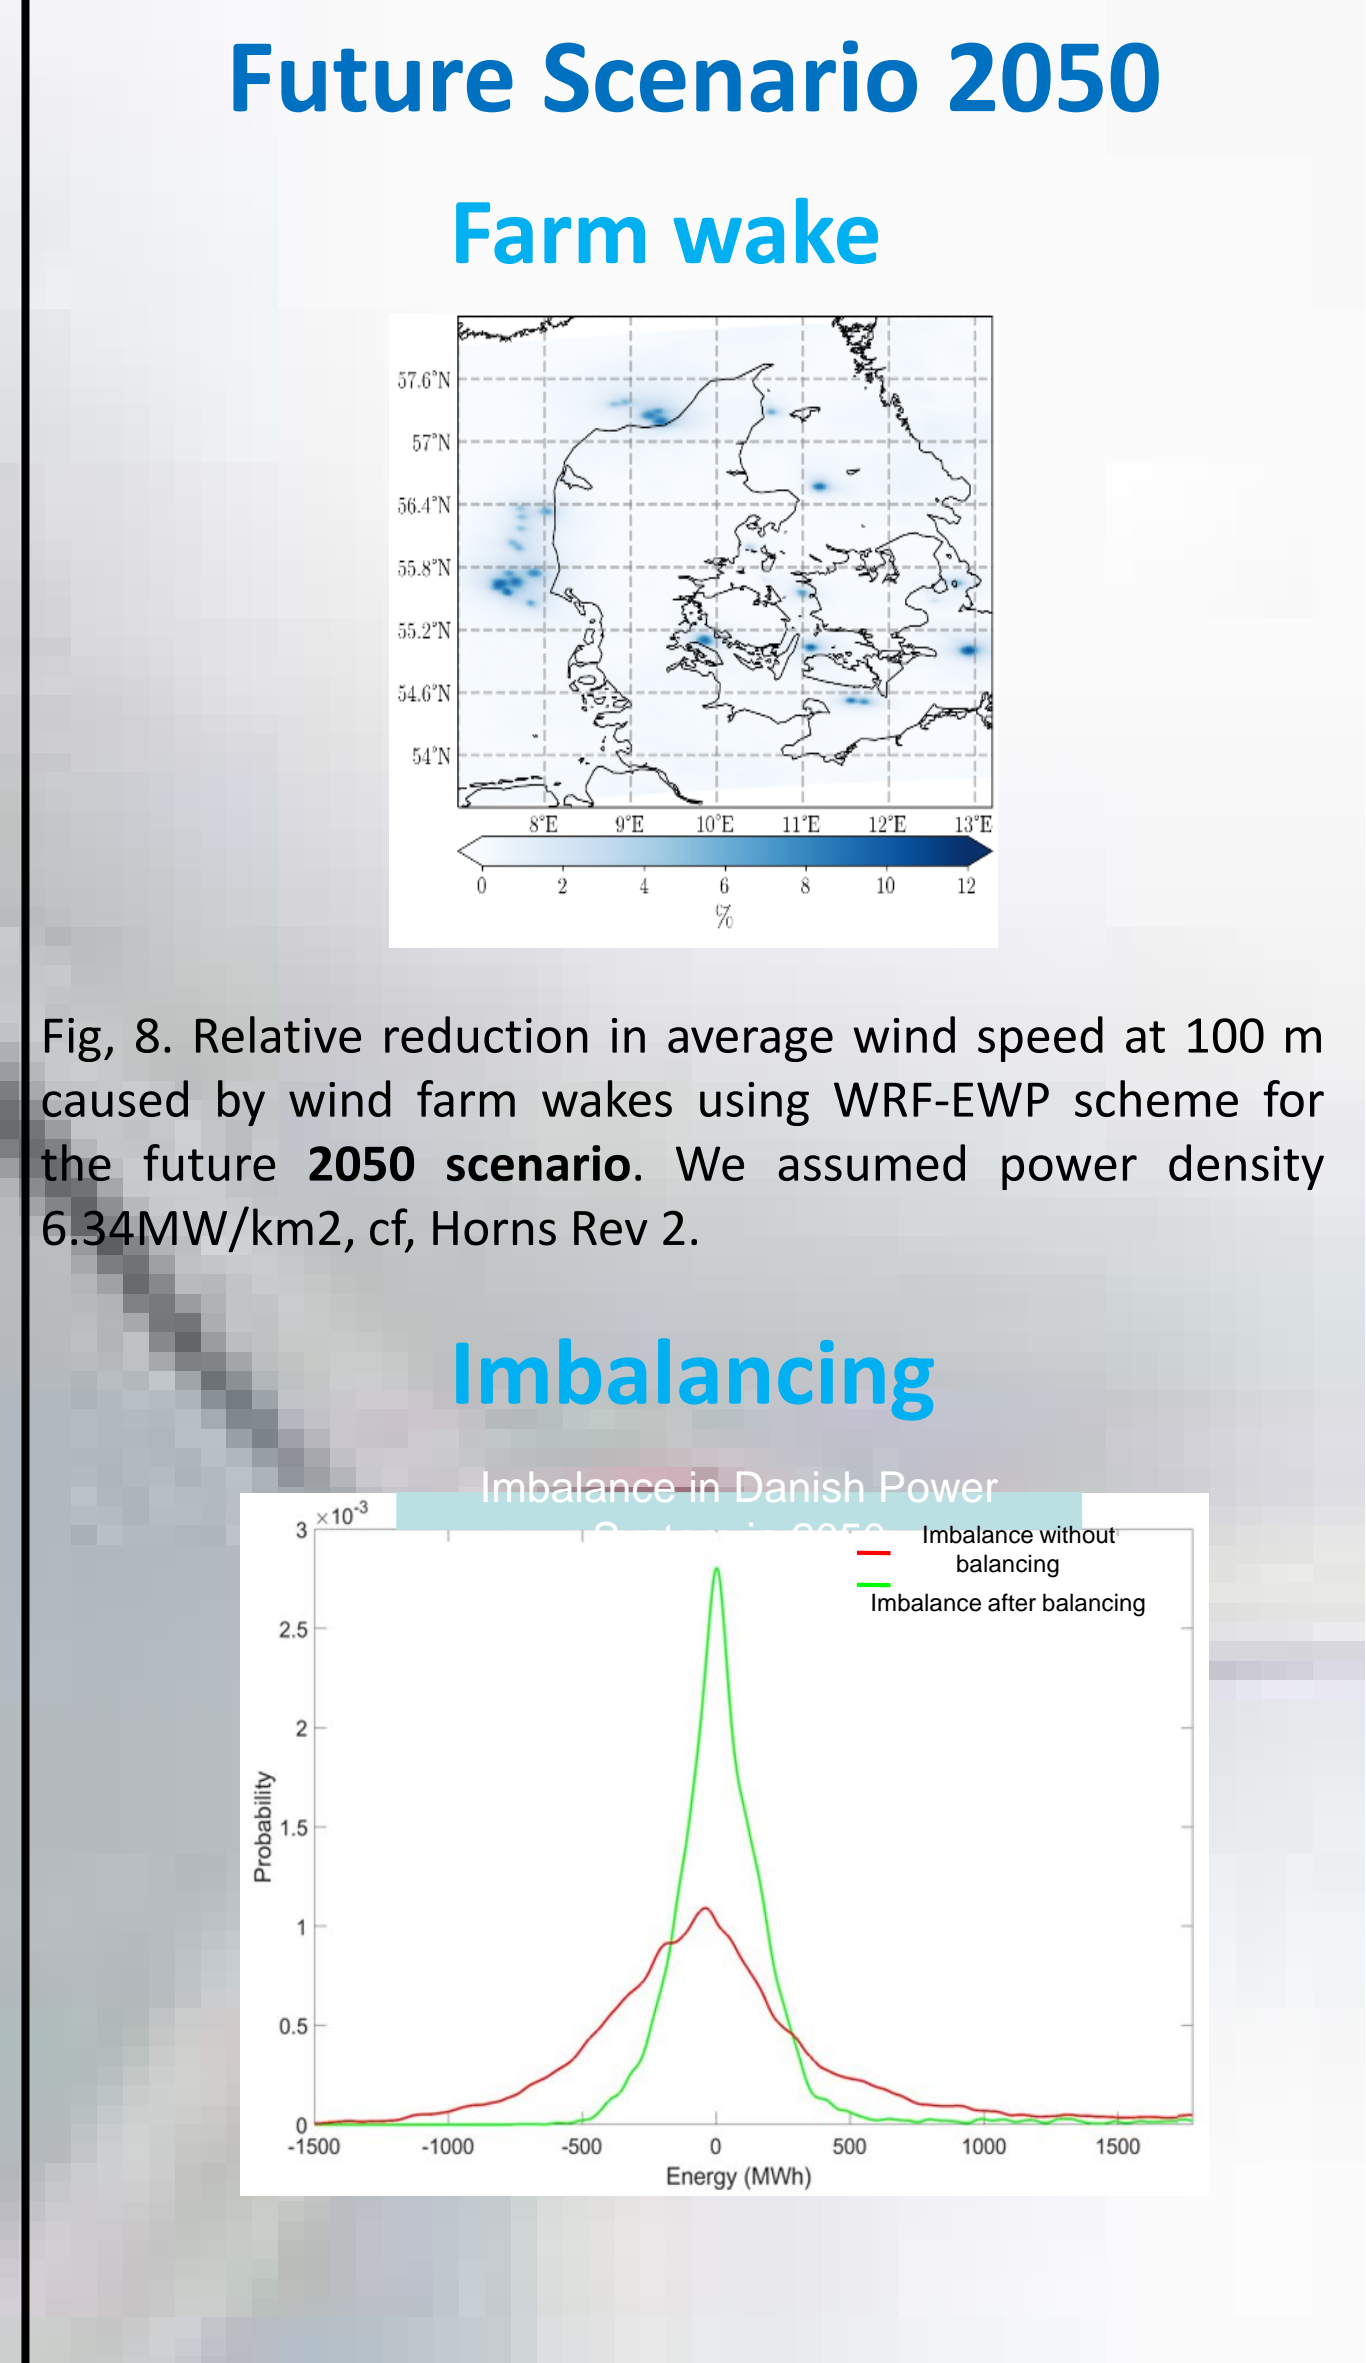


Fig. 8. Relative reduction in average wind speed at 100 m caused by wind farm wakes using WRF-EWP scheme for the future 2050 scenario. We assumed power density 6.34MW/km2, cf. Horns Rev 2.

Fig. 9. Probability distribution function of the Real Time imbalance induced in the Danish power system in the year 2050. Red curve is in case of no Intra-Hour balancing optimization. Intra-farm wakes are considered so far.

Conclusions

- A Robust wind-wave-ocean-wake coupled modeling system developed at DTU Wind Energy, providing real time meteorological, wave and ocean, and wake parameters.
- A first time model ready for input to power integration system, for current and future scenario. The model is of general use.
- The offshore wind farm cluster wake effect is considerable.

References

1. Jana Fischereit, Xiaoli Guo Larsén (2019): Interactions of oceanic surface waves and offshore wind farm wakes, To be submitted to Wind Energy.
 2. Du J., Bolaños R. and Larsén X. (2017): The use of a wave boundary layer model in SWAN. J. Geophys. Res.:Oceans. DOI: 10.1002/2016JC012104, vol. 122, No 1, p42 - 62.
 3. Volker, P. J. H., Badger, J., Hahmann, A. N., and Ott, S.: The Explicit Wake Parametrisation V1.0: a wind farm parametrisation in the mesoscale model WRF, Geosci. Model Dev., 8, 3715-3731, 2015
 4. NEWA project
 5. Langor E. (2019): Characteristics of Offshore Wind Farm Wakes and their Impact on Wind Power Production from Long-term Modelling and Measurements, Master Thesis DTU Wind Energy-M-0315

MEET US AT BOOTH C1-B51

wineurope.org/offshore2019

#Offshore2019

