



## Benchmarking strategies to control GHG production and emissions

Flores-Alsina, Xavier; Arnell, Magnus; Corominas, Lluís; Sweetapple, Chris; Fu, Guangtao; Butler, David; Vanrolleghem, Peter A.; Gernaey, Krist V.; Jeppsson, Ulf

*Published in:*  
Quantification and Modelling of Fugitive Greenhouse Gas Emissions from Urban Water Systems

*Link to article, DOI:*  
[10.2166/9781789060461\\_0213](https://doi.org/10.2166/9781789060461_0213)

*Publication date:*  
2022

*Document Version*  
Publisher's PDF, also known as Version of record

[Link back to DTU Orbit](#)

*Citation (APA):*  
Flores-Alsina, X., Arnell, M., Corominas, L., Sweetapple, C., Fu, G., Butler, D., Vanrolleghem, P. A., Gernaey, K. V., & Jeppsson, U. (2022). Benchmarking strategies to control GHG production and emissions. In L. Ye, J. Porro, & I. Nopens (Eds.), *Quantification and Modelling of Fugitive Greenhouse Gas Emissions from Urban Water Systems: A report from the IWA Task Group on GHG* (pp. 213-228). IWA Publishing.  
[https://doi.org/10.2166/9781789060461\\_0213](https://doi.org/10.2166/9781789060461_0213)

---

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

## Chapter 9

# Benchmarking strategies to control GHG production and emissions

Xavier Flores-Alsina<sup>1</sup>, Magnus Arnell<sup>2,3</sup>, Lluís Corominas<sup>4</sup>, Chris Sweetapple<sup>5</sup>, Guangtao Fu<sup>5</sup>, David Butler<sup>5</sup>, Peter A. Vanrolleghem<sup>6</sup>, Krist V. Gernaey<sup>1</sup> and Ulf Jeppsson<sup>3</sup>

<sup>1</sup>Process and Systems Engineering (PROSYS) Centre, Department of Chemical and Biochemical Engineering, Technical University of Denmark, Søtofts Plads, Building 228 A, Kgs. Lyngby 2800, Denmark

<sup>2</sup>Unit of Urban Water Management, RISE Research Institutes of Sweden, Gjuterigatan 1D, Linköping SE-58273, Sweden

<sup>3</sup>Division of Industrial Electrical Engineering and Automation (IEA), Department of Biomedical Engineering, Lund University, PO Box 118, Lund SE-22100, Sweden

<sup>4</sup>ICRA, Catalan Institute for Water Research, Scientific and Technological Park, H<sub>2</sub>O Building, Emili Grahit 101, Girona 17003, Spain

<sup>5</sup>Centre for Water Systems, College of Engineering, Mathematics and Physical Sciences, University of Exeter, North Park Road, Exeter, Devon EX4 4QF, UK

<sup>6</sup>modelEAU, Département de génie civil et de génie des eaux, Université Laval, 1065 Avenue de la Médecine, Québec, Canada G1V 0A6

### SUMMARY

Benchmarking has been a useful tool for unbiased comparison of control strategies in wastewater treatment plants (WWTPs) in terms of effluent quality, operational cost and risk of suffering microbiology-related total suspended solids (TSS) separation problems. This chapter presents the status of extending the original Benchmark Simulation Model No 2 (BSM2) towards including greenhouse gas (GHG) emissions. A mathematical approach based on a set of comprehensive models that estimate all potential on-site and off-site sources of CO<sub>2</sub>, CH<sub>4</sub> and N<sub>2</sub>O is presented and discussed in detail. Based upon the assumptions built into the model structures, simulation results highlight the potential undesirable effects on increased GHG emissions when carrying out local energy optimization in the activated sludge section and/or energy recovery in the anaerobic digester. Although off-site CO<sub>2</sub> emissions may decrease in such scenarios due to either lower aeration energy requirement or higher heat and electricity production, these effects may be counterbalanced by increased N<sub>2</sub>O emissions, especially since N<sub>2</sub>O has a 300-fold stronger greenhouse effect than CO<sub>2</sub>. The reported results emphasize the importance of using integrated approaches when comparing and evaluating (plant-wide) control strategies in WWTPs for more informed operational decision-making.

**Keywords:** Carbon footprint, control strategies, GHG, modelling, multi-criteria evaluation, plant-wide, sustainability

## TERMINOLOGY

Term	Definition
Greenhouse gas	Gas that absorbs and emits radiant energy within the thermal infrared range.
Benchmarking	Objective comparison of two items.

### 9.1 INTRODUCTION


The main focus in assessing the operation of wastewater treatment plants (WWTPs) has historically been the effluent water quality under constraints of technical feasibility and cost. This certainly still holds, but discussions on sustainability in general, and the impact on climate change due to greenhouse gas (GHG) emissions in particular, have widened the scope for utilities and regulators (Gustavsson & Tumlin, 2013). An increasing interest in GHG emissions calls for novel approaches to evaluate the performance of control and operational strategies in order to include additional performance indicators related to GHG emissions (Mannina *et al.*, 2016; Nguyen *et al.*, 2020).

Aside from evaluating control and operational strategies (Gernaey *et al.*, 2014) before full-scale implementation (Ayesa *et al.*, 2006), dynamic activated sludge models (ASMs) (Henze *et al.*, 2000) have been widely used for multiple purposes in wastewater engineering, such as control and monitoring (Olsson 2012), benchmarking (Jeppsson *et al.*, 2007; Solon *et al.*, 2017), diagnosis (Rodriguez-Roda *et al.*, 2002), design (Flores-Alsina *et al.*, 2012), teaching (Hug *et al.*, 2009), optimization (Feldman *et al.*, 2018; Rivas *et al.*, 2008), and regulatory policy development of wastewater treatment plants (Meng *et al.*, 2016, 2020). Based on new knowledge on the chemical and biochemical mechanisms of GHG production, several efforts have been made to capture emissions of CO<sub>2</sub>, CH<sub>4</sub> and N<sub>2</sub>O, and to integrate these processes in the traditional ASMs (Domingo-Felez *et al.*, 2017; Ni & Yuan, 2015; Poquet *et al.*, 2016).

In recent years, an increasing number of studies have discussed the need for adding a new dimension related to GHG production and emission to the traditional effluent quality and operational cost indices within the performance evaluation procedures of activated sludge control strategies (Flores-Alsina *et al.*, 2011, 2014; Guo *et al.*, 2012; Sweetapple *et al.*, 2015). In this chapter, an extended version of the International Water Association (IWA) Benchmark Simulation Model No 2 (BSM2), that is BSM2G, is used to show how decision making about the most suitable control/operational strategies may change when a GHG emission dimension is added. The model based methodology includes all major contributions to assess the carbon footprint of the plant under study. Two case studies (case study#1 and #2) are presented involving changes in the following operational variables: (i) the dissolved oxygen (DO) set-point of the aeration system in the activated sludge section; (ii) the removal efficiency of the total suspended solids (TSS) in the primary clarifier; (iii) the temperature in the anaerobic digester (AD); and (iv) the control of the flow of anaerobic digester supernatants from the sludge treatment section of the plant. Furthermore, we consider the main interactions between the water and sludge line. Finally, changes in effluent quality index (EQI), operational cost index (OCI) and CO<sub>2</sub>, CH<sub>4</sub> and N<sub>2</sub>O emissions are analysed by means of different graphical representations. As a side effect, synergies and trade-offs between local energy optimization and the overall GHG production are studied in detail.

### 9.2 BENCHMARK PLANT DESCRIPTION

The WWTP under study has the same layout as the IWA Benchmark Simulation Model No 2 platform proposed by Gernaey *et al.* (2014) (see Figure 9.1). The BSM2 was initially conceived for unbiased

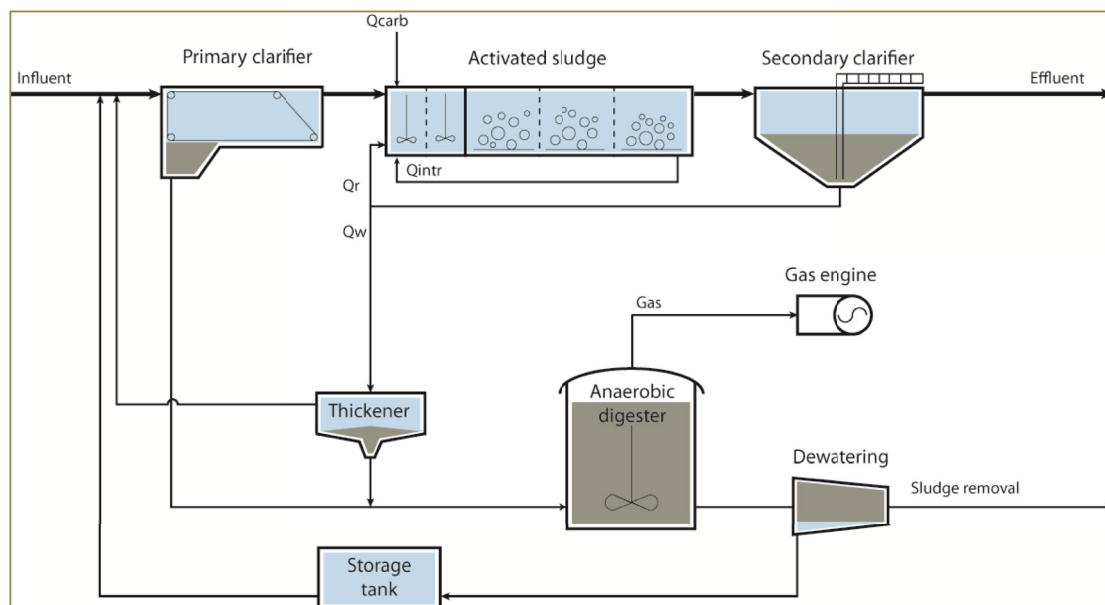

**Figure 9.1** Schematic representation of the BSM2 plant layout.

comparison of control strategies based on predefined process and sensor models, influent disturbances and evaluation criteria. More specifically, the plant treats an influent flow rate of  $20\,648\text{ m}^3\cdot\text{day}^{-1}$  and total COD and N loads of  $12\,240$  and  $1\,140\text{ kg}\cdot\text{day}^{-1}$ , respectively. Influent characteristics are generated following the principles stated in [Gerney et al. \(2011\)](#). The activated sludge (AS) unit is a modified Ludzack-Ettinger configuration consisting of five tanks in series. Tanks 1 (ANOX1) and 2 (ANOX2) are anoxic (total volume =  $3\,000\text{ m}^3$ ), while tanks 3 (AER1), 4 (AER2) and 5 (AER3) are aerobic (total volume =  $9\,000\text{ m}^3$ ). AER3 and ANOX1 are linked by means of an internal recycle with the purpose of nitrate recycle for pre-denitrification. The BSM2 plant further contains a primary (PRIM,  $900\text{ m}^3$ ) and a secondary (SEC,  $6\,000\text{ m}^3$ ) clarifier, a sludge thickener (THK), an anaerobic digester (AD,  $3\,400\text{ m}^3$ ), a storage tank ( $160\text{ m}^3$ ) and a dewatering unit (DW). Additional information about the plant design and operational conditions can be found in [Gerney et al. \(2014\)](#).

## 9.3 BENCHMARK MODEL UPGRADES AND MODIFICATIONS

### 9.3.1 Activated sludge model (ASM)

The Activated Sludge Model No. 1 (ASM1) ([Henze et al., 2000](#)) has been expanded based on the principles proposed by [Hiatt and Grady \(2008\)](#) and [Mampaey et al. \(2013\)](#). The Hiatt and Grady model incorporates two nitrifying populations: ammonia oxidizing bacteria (AOB) and nitrite oxidizing bacteria (NOB) using free ammonia (FA) and free nitrous acid (FNA) as nitrogen substrate, respectively. The model also considers sequential reduction of nitrate ( $\text{NO}_3^-$ ) to nitrogen gas ( $\text{N}_2$ ) via nitrite ( $\text{NO}_2^-$ ), nitric oxide (NO) and nitrous oxide ( $\text{N}_2\text{O}$ ) using individual reaction-specific parameters. Additionally, the ideas summarized in [Mampaey et al. \(2013\)](#) are used to consider NO and  $\text{N}_2\text{O}$  formation from the nitrification pathway assuming ammonia ( $\text{NH}_3$ ) as the electron donor. Parameter values were adjusted according to [Guo and Vanrolleghem \(2014\)](#).

### 9.3.2 ASM/ADM interface

The interfaces presented in [Nopens \*et al.\* \(2010\)](#) have been modified to link the upgraded ASM and the default Anaerobic Digestion Model No. 1 (ADM1), by considering chemical oxygen demand (COD) and N balances for all oxidized nitrogen compounds. This is especially critical in Step 1 of the ASM–ADM interface where all negative COD (i.e. oxygen, nitrate, nitrite, nitrous oxide and nitrogen monoxide) is subtracted from the COD pool with an associated loss of substrate ( $S_s$ ,  $X_s$ ,  $X_{BH}$ ,  $X_{BA}$  in that order). The last step, where inorganic carbon ( $S_{IC}$ ) is calculated as part of the assumption of charge conservation at both sides of the interface is upgraded with the new (oxidized) nitrogen species, that is  $S_{NO_3}$  and  $S_{NO_2}$ . There are no modifications to the original formulation of the ADM–ASM interface.

### 9.3.3 Mass transfer

Mass transfer between the liquid and the gas phase in the ASM is modelled for selected compounds ( $S_{N_2}$ ,  $S_{NO}$  and  $S_{N_2O}$ ). Specific transfer coefficients ( $K_L a_{N_2}$ ,  $K_L a_{NO}$  and  $K_L a_{N_2O}$ ) are estimated using the ratio of the squared roots of diffusivities ([Foley \*et al.\*, 2011](#)). The transport rates are formulated as a function of the difference between the saturation concentration and the actual concentration of the gas dissolved in the liquid ([Batstone \*et al.\* 2012](#)). The saturation concentration of the gas in the liquid is given by Henry's law of dissolution, which states that the saturation concentration is equal to the product of Henry's constant ( $K_H$ ) multiplied by the partial pressure of the gas ( $P_i$ ).

### 9.3.4 Temperature correction

To account for seasonal variability, liquid-gas saturation constants, kinetic parameters, transfer coefficients and equilibrium reactions are temperature dependent. More specifically, growth and decay rates are modelled according to the Ratkowsky equations. Equilibrium constants to calculate FA and FNA are adjusted using Van't Hoff corrections. Finally,  $K_L a$  is kinetically adjusted with temperature changes ([Gernaey \*et al.\*, 2014](#)).

### 9.3.5 Other ancillary models

The other models have not been modified from their original description in [Gernaey \*et al.\* \(2014\)](#). The primary clarifier is modelled in accordance with [Otterpohl and Freund \(1992\)](#). The double exponential settling velocity function of [Takács \*et al.\* \(1991\)](#) is used to model the secondary settling process through a one-dimensional model consisting of 10 layers. Regarding the thickener and dewatering units, these are modelled as ideal, continuous processes with no biological activity, and with a constant percentage of TSS in the concentrated sludge flows leaving the thickening and dewatering units. The widely recognized ADM1 ([Batstone \*et al.\*, 2002](#)) is the dynamic anaerobic digestion model implemented.

## 9.4 EVALUATION CRITERIA

### 9.4.1 Effluent quality (EQI) and operational cost (OCI) indices

The overall pollution removal efficiency is obtained using the effluent quality index (EQI) from the standard BSM2 ([Nopens \*et al.\*, 2010](#)). EQI is an aggregated weighted index of all pollution loads: TSS, COD, 5-day biochemical oxygen demand (BOD<sub>5</sub>), total Kjeldahl nitrogen (TKN) and the oxidized forms of nitrogen (NO<sub>x</sub>), leaving the plant. The economic objectives are evaluated using the operational cost index (OCI) ([Gernaey \*et al.\*, 2014](#)). It consists of the sum of all major operating costs in the plant: aeration energy (AE), pumping energy (PE), mixing energy (ME), sludge production (SP), external carbon addition (EC), methane production (MP) and the net heating energy (HE<sup>net</sup>). EQI and OCI are based on simulation results with the 609 days of dynamic influent data generated following the principles outlined in [Gernaey \*et al.\* \(2011\)](#). Only the last 364 days are used for the evaluation itself.

#### 9.4.2 On-site/off-site GHG emissions

The comprehensive approach suggested by Flores-Alsina *et al.* (2011, 2014) is used to estimate all potential GHG emissions from the studied WWTP that cannot be obtained from the explicit results of the modified BSM2. The overall GHG evaluation comprises the estimation of GHG emissions from the following sources: (i) direct secondary treatment, (ii) sludge processing, (iii) net power and chemical use, (iv) sludge disposal and reuse, and (v) receiving waters. It is important to highlight that the GHGs are converted into units of CO<sub>2</sub> equivalent (CO<sub>2</sub>e) to properly deal with the different natures of the generated GHGs (CO<sub>2</sub>, CH<sub>4</sub> and N<sub>2</sub>O). Further information can be found in Flores-Alsina *et al.* (2011, 2014) and Corominas *et al.* (2012).

##### 9.4.2.1 Direct secondary treatment emissions

Direct emissions from the activated sludge process are calculated in the bioprocess model, including CO<sub>2</sub> generation from microbial respiration, and production and emission of N<sub>2</sub>O. The CO<sub>2</sub> is credited for growth of autotrophic nitrifying organisms with a factor of 0.31 kg CO<sub>2</sub>/kg N<sub>nitri</sub> (Tchobanoglous *et al.*, 2003). Most of the produced N<sub>2</sub>O will be stripped to the surrounding gas phase in reactors with forced aeration and only a small fraction remains in solution. In the BSM2G, the dissolved N<sub>2</sub>O is assumed to follow the plant effluent to the receiving waters.

##### 9.4.2.2 Sludge processing emissions

The GHG emissions from sludge treatment are mainly generated in the anaerobic digester. Direct biogas CO<sub>2</sub> and CH<sub>4</sub> emissions are quantified using the ADM1. In this case it is assumed that the biogas is fed directly into a gas-fired combustion turbine converting the CH<sub>4</sub> into CO<sub>2</sub> and generating electricity and heat (in turn used to heat the anaerobic digester). The CO<sub>2</sub> generated during anaerobic digestion and the CO<sub>2</sub> produced in the combustion are assumed to be released to the atmosphere.

In addition, direct emissions of CO<sub>2</sub>, CH<sub>4</sub> and N<sub>2</sub>O from the sludge train of the BSM2G plant (i.e. thickener, digester, dewatering and sludge storage) are accounted for. From the AD and the gas system a leakage of 1% of the raw biogas is assumed (Avfall Sverige Utveckling, 2009). The gas flow available for utilization is therefore reduced by the corresponding amount. The CH<sub>4</sub> that remains dissolved in the sludge after digestion is assumed to be stripped at the dewatering unit and adds to the emissions.

Based on common practice in countries applying dewatered sludge as fertilizer on productive land (e.g. crops or forest), it is assumed that the sludge is stored uncovered at the plant for 12 months (for hygienic purposes) before use. During storage, post digestion occurs, leading to GHG emissions. The emissions of CH<sub>4</sub> and N<sub>2</sub>O are set to 8.7 g CH<sub>4</sub>/kg volatile solids (VS) and 0.36% of total nitrogen (TN) as N<sub>2</sub>O-N (Jönsson *et al.*, 2015). Corresponding amounts of carbon and nitrogen are subtracted from the sludge (S<sub>S</sub>, X<sub>S</sub> and S<sub>NH</sub>).

In the gas engine, the CH<sub>4</sub> in the biogas is combusted and converted to CO<sub>2</sub> which is emitted with the fumes along with a fraction of the gas that passes through the engine un-combusted. The emission factor (EF) for un-combusted biogas is set to 1.7% of the gas fed to the gas engine (Liebetau *et al.*, 2010). Consequently, the energy production is reduced by the same factor.

##### 9.4.2.3 Net power and chemical use emissions

Net energy is calculated as the difference between energy consumption (aeration, pumping, mixing and heating) and energy production. The electricity generated by the turbine is calculated by using a factor for the energy content of the methane gas (50 014 MJ/kg CH<sub>4</sub>) and assuming a 43% efficiency for electricity generation. For external electricity required, a value of 0.359 kg CO<sub>2</sub>e/kWh is assumed (Arnell *et al.*, 2017).

It is assumed that methanol is used as external carbon source for denitrification. A common type of methanol, sourced from fossil resources, is assumed with an emission factor of 1.54 kg CO<sub>2</sub>e/kg MeOH. Methanol is the only chemical included in the BSM2G (Dong & Steinberg, 1997).

#### 9.4.2.4 Sludge disposal and reuse emissions

After 12 months of storage, the sludge is transported for final disposal or reuse. While reuse options, transport distance and specific emissions vary widely with location, the following mix of disposal options is chosen (Arnell *et al.*, 2017):

- (i) Crop land – 38% of the sludge; 150 km transport; N<sub>2</sub>O Emission Factor (EF): 0.01 kg N<sub>2</sub>O-N/kg TN.
- (ii) Composting – 45% of the sludge; 20 km transport; N<sub>2</sub>O EF: 0.01 kg N<sub>2</sub>O-N/kg TN CH<sub>4</sub> EF: 0.0075 kg CH<sub>4</sub>/kg total organic carbon (TOC)
- (iii) Forest – 17% of the sludge; 144 km transport; N<sub>2</sub>O EF: 0.01 kg N<sub>2</sub>O-N/kg TN

GHG emissions resulting from transport of sludge are calculated with an emission factor for Euro 4 class trucks running on diesel for all disposal options, where unloaded return trips are assumed.

#### 9.4.2.5 Receiving water emissions

Indirect emissions of N<sub>2</sub>O from the recipient due to residual nitrogen in the effluent are calculated and presented (Arnell *et al.*, 2017). Studies of N<sub>2</sub>O emissions from natural waters show a large variability depending on climate and type of water system (lake, river, sea, etc.). For BSM2G, an emission factor corresponding to an inland lake or river was included, 0.0003 kg N<sub>2</sub>O-N/kg TN<sub>effluent</sub> (IPCC, 2013).

### 9.4.3 Sustainability indicators

Additional indicators can be calculated for economic and environmental aspects of sustainability – these are inspired by the work of Molinos-Senante *et al.* (2014) and detailed fully by Sweetapple *et al.* (2014a, 2015). Societal aspects are not considered since typical indicators (such as noise, odour and visual impact) cannot be determined from the model, and are not expected to be subject to any perceivable change as a result of adjusting control strategies.

Operational costs, represented by the *OCI*, are considered within economic sustainability. Capital/investment costs associated with implementation of a new control strategy cannot be quantified from the model, but are expected to be small relative to the long-term operational costs.

Environmental sustainability is assessed based on (i) treatment efficiency, (ii) net energy consumption, (iii) sludge production, and (iv) GHG emissions. The percentage of influent COD, TSS and total nitrogen removed (or not removed), based on the modelled influent and effluent concentrations, provide three indicators for treatment efficiency. Net energy consumption is quantified as in the calculation of GHG emissions, based on energy uses included in the *OCI* and credit from the energy content of recovered methane (Section 9.4.2). Sludge production is calculated as in the *OCI* (Gernaey *et al.*, 2014), and emissions from secondary treatment, sludge processing, net power, chemical use and sludge disposal and reuse are included in the calculation of total GHG emissions, as detailed in Section 9.4.2.

## 9.5 EXAMPLES/CASE STUDIES

### 9.5.1 Case study #1: evaluation of plant-wide control strategies

In the first case study, the BSM2G is simulated in a closed loop regime, which includes two defined proportional integral (PI) control loops. The first loop controls the dissolved oxygen (DO) concentration in AER2 by manipulating the air supply rate, here implemented as the oxygen transfer coefficient  $K_L a_4$  (set-point = 2 g O<sub>2</sub>·m<sup>-3</sup>).  $K_L a_3$  is set equal to  $K_L a_4$  and  $K_L a_5$  is set to half its value. The second loop controls the nitrate concentration in ANOX2 by manipulating the internal recycle flow rate ( $Q_{intr}$ ). Two different waste sludge flow rates ( $Q_{W,winter} = 300 \text{ m}^3 \cdot \text{day}^{-1}$  //  $Q_{W,summer} = 450 \text{ m}^3 \cdot \text{day}^{-1}$ ) are imposed in SEC depending on temperature (above or below 15°C) in order to sustain the nitrifying biomass in

the system during the winter period. Noise and delays are applied to sensor and actuator models to give the simulations more realism. The external recirculation flow rate ( $Q_r$ ) and carbon source addition ( $Q_{\text{carb}}$ ) remain constant throughout the simulations. Additional details about the default operational strategy can be found in Flores-Alsina *et al.* (2011). The selection of the different scenarios is intended to demonstrate the relative effects of logical control strategies that may be implemented by operators to increase energy efficiency and/or improve overall plant performance. The following four control scenarios are simulated in the previously predefined case study:

- (i) *Impact of DO control* (commonly used to reduce aeration costs) by varying the set-point value between 1 and 3 g O<sub>2</sub>·m<sup>-3</sup> (default value 2 g O<sub>2</sub>·m<sup>-3</sup>).
- (ii) *Impact of primary clarifier efficiency* by varying the TSS removal efficiency in PRIM from 33% to 66% (default value 50%). Although in reality this does not happen without chemical addition, the effect of improving TSS removal, such as through chemical addition, is the change of interest.
- (iii) *Impact of the anaerobic digester operating mode* by changing the temperature in the anaerobic digester from mesophilic (35°C) to thermophilic (55°C) (default value 35°C).
- (iv) *Impact of anaerobic digester supernatants* by controlling the return flow rate originating from the DW unit. This timer-based control strategy stores the dewatering liquor during daytime (when the plant is experiencing high load) and returns it at night (when the plant is at low load). Note that the default BSM2 strategy does not use this control approach and liquors from dewatering are simply returned as they are generated.

*EQI*, *OCI* and GHG values for the different simulated scenarios are shown in Figure 9.2. Hence, it is possible to see how the overall picture changes when: (i) *EQI* and *OCI* are considered only (Figure 9.2a, b); or (ii) when adding the total quantity of CO<sub>2</sub>, N<sub>2</sub>O and CH<sub>4</sub> emissions (quantified in kg CO<sub>2</sub>e. m<sup>-3</sup> of treated wastewater) (Figure 9.2c, d). From the generated results one can see that: (i) the DO set-point in the activated sludge section is of paramount importance to the plant's total GHG emissions (*z*-axis) next to the well-known impacts on effluent quality and operating costs; (ii) better TSS removal efficiency in PRIM mainly improves effluent quality and operational cost (*x*- and *y*-axis), but the total GHG emissions remain almost equal; (iii) thermophilic conditions in the anaerobic digester reveal that a higher operating temperature appears to be a more expensive way to operate the plant (with higher operational cost, *y*-axis) without having substantial benefits in terms of increased gas production; and (iv) control of the anaerobic digester supernatants return flow rate improves effluent quality, slightly increases cost but does not have an effect on the GHG emissions unless DO is very low (see dotted lines in Figure 9.2b).

The study presents an important result to the wastewater community by demonstrating the potential impacts of *energy optimization*, particularly in the aeration/anaerobic digester system, and by showing the importance of *plant-wide evaluation*. For example, based on the reported results, operating a plant at low DO concentrations cannot be recommended due to the decrease in effluent quality despite the substantial savings in *OCI* (see Figure 9.2a, b). The situation becomes even worse when GHG emissions are included in the analysis (Figure 9.2c, d) and the substantial contribution of N<sub>2</sub>O in the total plant's global warming potential would rank that alternative even lower. Another example in Figure 9.2 illustrates the potential of improving the % TSS removal in the PRIM. Firstly, the load to the activated sludge section is substantially reduced (and thus the off-site CO<sub>2</sub> emissions due to aeration) when the % TSS removal in PRIM increases. Secondly, there is an increase in energy recovery from the anaerobic digestion (higher CO<sub>2</sub> credit). However, in terms of total quantity of GHG emissions the strategy does not seem to pay off since there is a substantial increase in N<sub>2</sub>O emissions due to the inadequate C/N ratios that result (poor denitrification). These two examples demonstrate the usefulness of a third GHG dimension for deciding on the optimum operational setting to meet a specific plant's objectives.



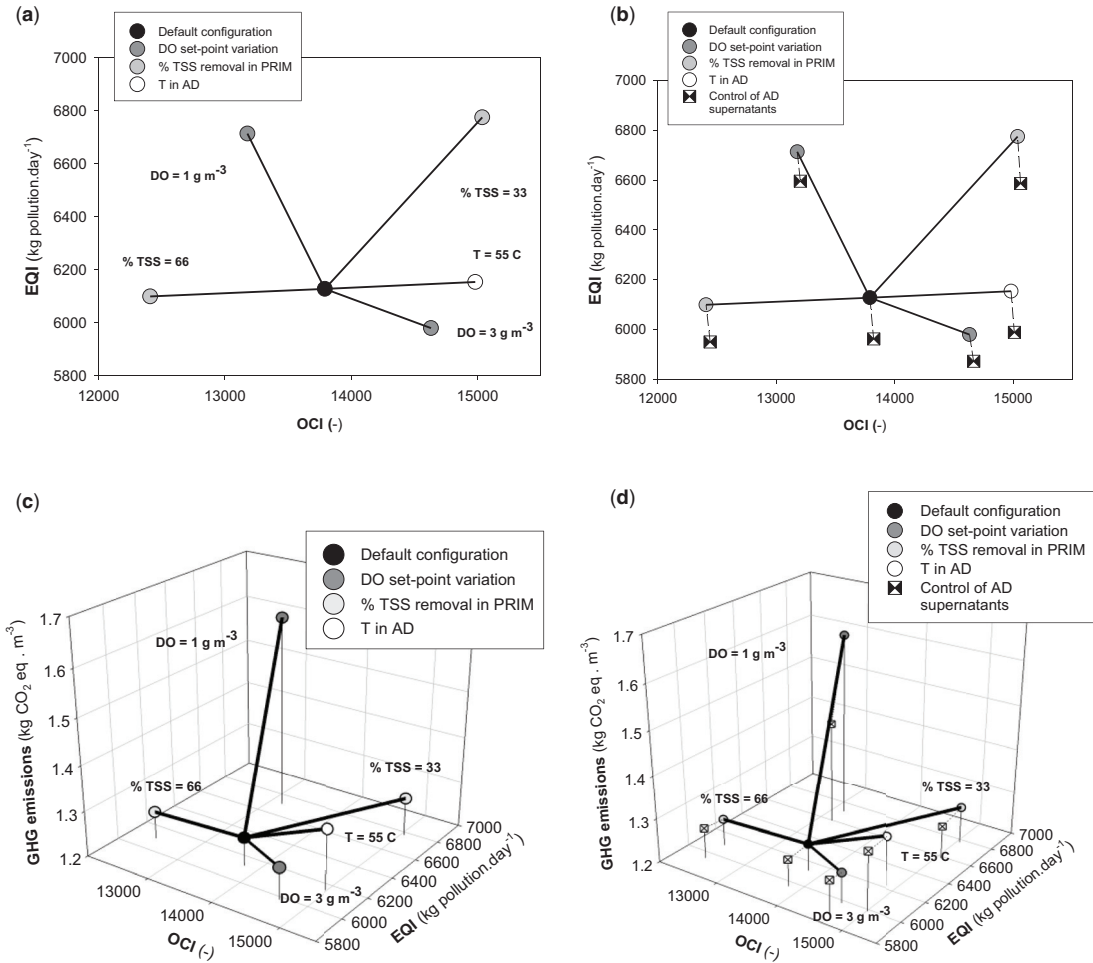


Figure 9.2 Effluent, cost and emission criteria for all the evaluated strategies. (a), (b) EQI & OCI, (c), (d) EQI, OCI & GHG.

### 9.5.2 Case study #2: investigating the impact of net energy reduction on sustainability

This case study aims to more broadly investigate the effect on sustainability of modifying the plant control system to reduce net energy use. It considers both economic and environmental aspects of sustainability (including GHG emissions), using the indicators presented in Section 9.4.3.

Two different control strategies are considered, each with multiple variants. In the first control strategy (CL1), DO is controlled using a single PI control loop, as described for Case Study #1. In the second (CL2), three independent PI control loops are used to control the DO spatial distribution, with oxygen transfer coefficients  $K_La_3$ ,  $K_La_4$  and  $K_La_5$  manipulated to control the DO concentration in AER1, AER2 and AER3 respectively (based on previous findings by Jeppsson *et al.* (2007) that this uses less energy for aeration than a range of other alternatives). In both control strategies, an additional PI control loop controls the nitrate concentration in ANOX2 by manipulating the internal recycle flow rate and different waste sludge flow rates are imposed depending on the time of year. This controller was not included in case study #1.

Factorial sampling is used to generate sets of waste sludge flow rates and DO set-points to implement in these control strategies (within the range 240–360 m<sup>3</sup>.day<sup>-1</sup> for winter waste sludge flow rate, 360–540 m<sup>3</sup>.day<sup>-1</sup> for summer waste sludge flow rate, 1–3 g O<sub>2</sub>.m<sup>-3</sup> for the DO set-point in CL1, and 0.5–2.0 g O<sub>2</sub>.m<sup>-3</sup> for the DO set-point in CL2). This provides a total of 315 control options for evaluation. CL1 with waste sludge flow rates and DO set-point as in Case Study #1 represents the base case option. Further details on the control options can be found in [Sweetapple et al. \(2015\)](#).

A pair-wise comparison of sustainability indicators for control options which provide a reduction in net energy (with respect to the base case) and a compliant effluent is shown in [Figure 9.3](#). Whilst


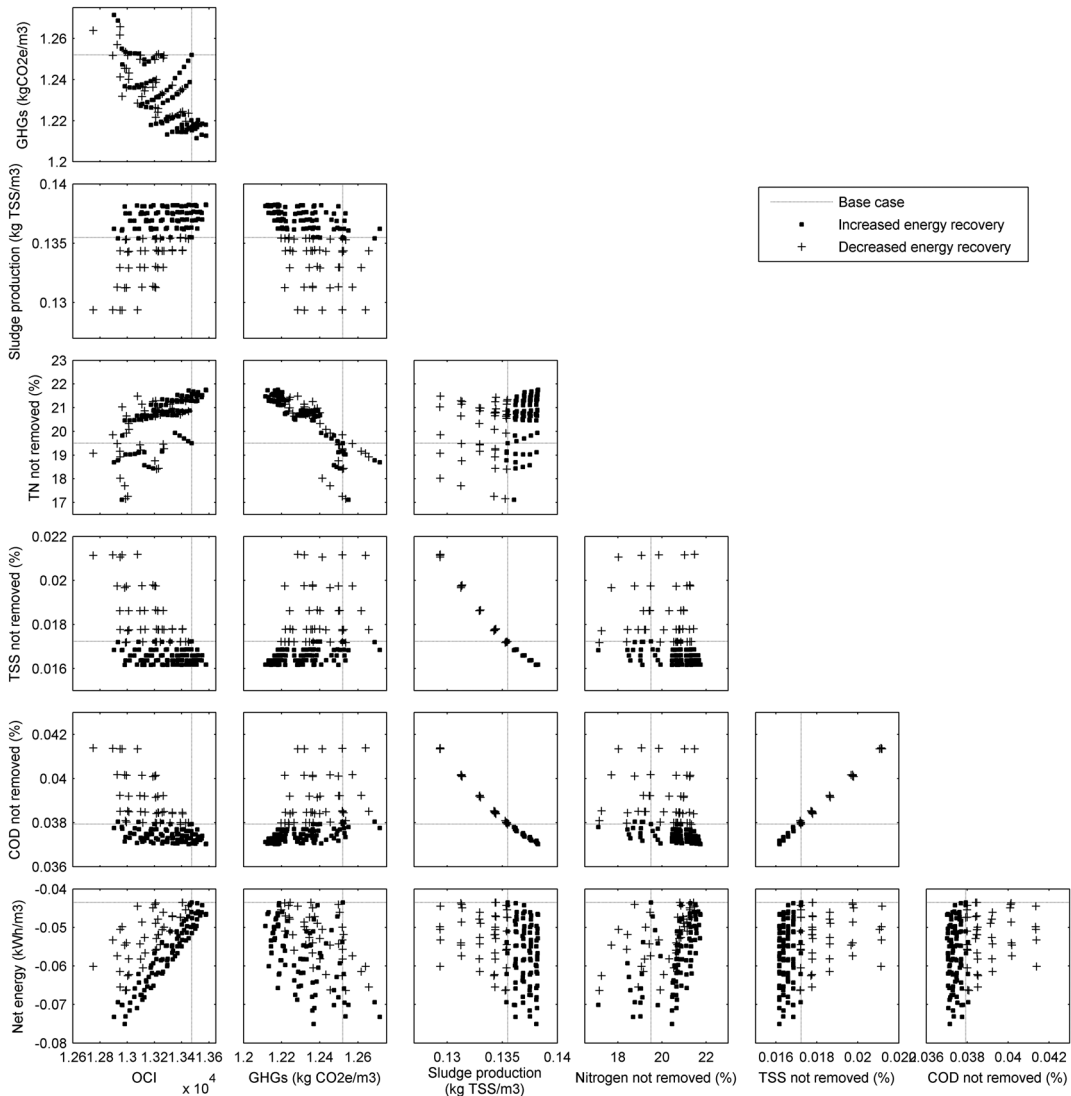


Figure 9.3 Sustainability indicator values for control options providing a reduction in net energy and a compliant effluent.

this shows that control options selected to reduce net energy use also reduce GHG emissions in a high proportion of cases, it also highlights that increased GHG emissions are a potential adverse side effect (as observed in 10% of cases). This may be attributed to lower DO set-points providing lower energy consumption but increased  $\text{N}_2\text{O}$  formation (Flores-Alsina *et al.*, 2014), and raises the important issue that reducing energy use cannot be seen as a reliable approach for reducing total GHG emissions. These results also show that few of the considered solutions (11%) both maintain/improve nitrogen removal and reduce GHG emissions. This highlights a particular challenge since  $\text{N}_2\text{O}$  is emitted during nitrification and denitrification and, whilst these emissions can be curbed to some extent by ensuring sufficient DO (Kampschreur *et al.*, 2009), this will have implications on energy use.

The best solution with respect to energy reduction is the CL2 control strategy with a 20% increase in the waste flow rates and DO set-points of 1, 1, and  $0.5 \text{ g O}_2\text{-m}^{-3}$  in AER1, AER2 and AER3 respectively, which uses 73% less energy than the base case. However, this does not provide a universal improvement in sustainability, with both nitrogen removal and sludge production worsened. None of the control options evaluated in fact provides an improvement in all of the sustainability indicators, although seven provide an improvement in all but one. The performance of these control options, alongside the solution that provides the minimum net energy use are shown in Figure 9.4.

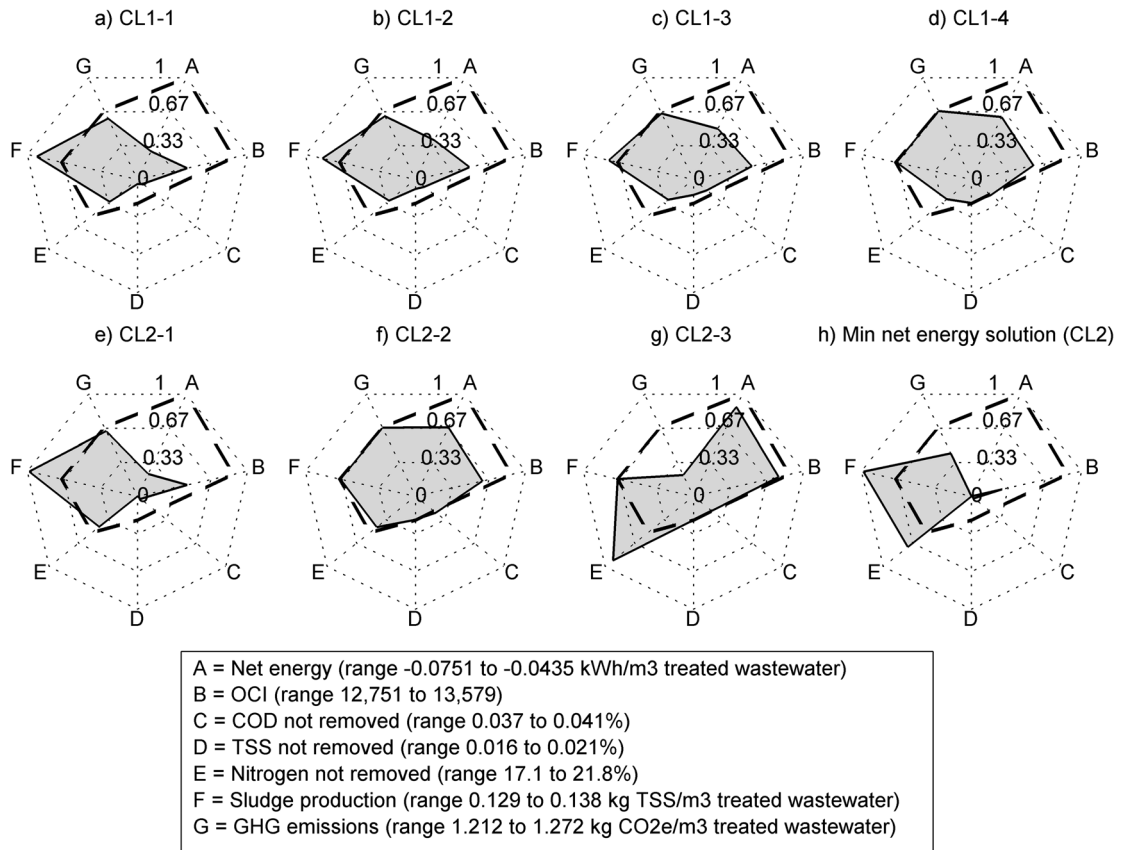

**Figure 9.4** Sustainability indicator values for selected solutions, with the dashed lines representing the base case and values closer to the centre of the plot being preferable. (a) CL1-1, (b) CL1-2, (c) CL1-3, (d) CL1-4, (e) CL2-1, (f) CL2-2, (g) CL2-3, (h) Min net energy solution (CL2).

This illustrates that, although each solution reduces net energy use, the type and magnitude of their sustainability impacts vary considerably and trade-offs must be considered.

The results of this case study are of importance because they highlight that, whilst improving both DO control and waste flow rate selection can provide substantial energy savings and increase economic sustainability, the impacts on environmental sustainability are not universally beneficial. Trade-offs are identified and it is shown that nitrogen removal and sludge production in particular are likely to be detrimentally affected in the lowest energy solutions. The ability to model and include both on-site and off-site GHG emissions is particularly valuable since solutions are identified in which a significant reduction in net energy corresponds with an increase in total GHG emissions; in the absence of emissions modelling, such solutions might be assumed to have a more beneficial environmental impact than is the case in reality.

### 9.5.3 Other relevant case studies

Besides case study #1 and #2 presented in this chapter, there have been many other investigations where the BSM2G has been applied to evaluate control strategies with different purposes, for example, the evaluation of control strategies in further studies using multi-objective optimization (Sweetapple *et al.*, 2015). Control strategies have also been developed which are particularly focused on reducing N<sub>2</sub>O emissions (Boiocchi *et al.*, 2017a, 2017b; Santin *et al.*, 2017). It is important to mention the different types of sensitivity analysis that have been implemented in the platform in order to gain understanding of the main interactions amongst model parameters (Boiocchi *et al.*, 2017b; Sweetapple *et al.*, 2014b). Finally, the original WWTP layout has been modified by including sewer and catchment models to also account for CH<sub>4</sub> emissions within the sewer network (Guo *et al.*, 2012). Additional modifications consist of adding two extra anaerobic tanks to allow for biological phosphorus removal (Solis *et al.*, 2019).

## 9.6 LIMITATIONS

It is important to highlight that the N<sub>2</sub>O models used in the study are still under development and are in the process of being validated with full-scale data. Results thus far have been promising (Lindblom *et al.*, 2016). In this paper, the N<sub>2</sub>O production by AOB is based on denitrification with NH<sub>4</sub><sup>+</sup> as the electron donor. Other possible mechanisms, such as the formation of N<sub>2</sub>O as a by-product of incomplete oxidation of hydroxylamine (NH<sub>2</sub>OH) to NO<sub>2</sub><sup>-</sup>, are not considered (Wunderlin *et al.*, 2013). Recent investigations demonstrate that both the autotrophic denitrification and the NH<sub>2</sub>OH oxidation are involved in N<sub>2</sub>O production, although the latter to only a minor degree (Domingo-Felez *et al.*, 2017; Ni & Yuan, 2015; Poquet *et al.*, 2016). Therefore, the results reflect the assumptions built into the N<sub>2</sub>O model structure of Mampaey *et al.* (2013), and Guo and Vanrolleghem (2014).

The recent advances when modelling physicochemical processes (Batstone *et al.*, 2012; Flores-Alsina *et al.*, 2015) would allow: (i) pH calculation according to influent conditions and process conditions; and (ii) FA and FNA calculation accounting for ion strength and ion pairing. Indeed, several investigations showed the substantial impact that weak acid chemistry might have on N<sub>2</sub>O emissions (Su *et al.*, 2019). Another important aspect would be the quantification of biogenic CO<sub>2</sub> emissions and their inclusion in the overall carbon balance within the plant. Preliminary results can be found in Solis *et al.* (2022).

## 9.7 CONCLUSIONS AND PERSPECTIVES

The key observations of the presented study can be summarized in the following points:

- The inclusion of GHG emissions provides an additional criterion when evaluating control/operational strategies in a WWTP, offering a better idea about the overall 'sustainability' of plant control/operational strategies.

- Simulation results show the risk of energy-related (aeration energy in AS/energy recovery from AD) optimization procedures, and the opposite effect that N<sub>2</sub>O and its 300-fold stronger GHG effect (compared to CO<sub>2</sub>) might have on the overall global warming potential (GWP) of the WWTP.
- The importance of considering the water and sludge lines together and their impact on the total quantity of GHG emissions are shown when the temperature regime is modified and the anaerobic digester supernatants return flows are controlled.
- While these observations are WWTP specific, the use of the developed tools is demonstrated and can be applied to other systems.

## REFERENCES

- Arnell M., Rahmberg M., Oliveira F. and Jeppsson U. (2017). Multi-objective performance assessment of wastewater treatment plants combining plant-wide process models and life cycle assessment. *Journal of Water and Climate Change*, 8(4), 715–729, <https://doi.org/10.2166/wcc.2017.179>
- Avfall Sverige Utveckling (2009). Voluntary commitment – survey of methane losses from biogas plants 2007–2008 (In Swedish: frivilligt åtagande – kartläggning av metanförluster från biogasanläggningar 2007–2008). Avfall Sverige AB, Stockholm, Sweden. ISSN 1103-4092.
- Ayasa E., De la Sota A., Grau P., Sagarna J. M., Salterain A. and Suescun J. (2006). Supervisory control strategies for the new WWTP of Galindo-Bilbao: the long run from the conceptual design to the full-scale experimental validation. *Water Science & Technology*, 53(4–5), 193–201, <https://doi.org/10.2166/wst.2006.124>
- Batstone D. J., Keller J., Angelidaki I., Kayuznyi S. V., Pavlostathis S. G., Rozzi A., Sanders W. T. M., Siegrist H. and Vavilin V. A. (2002). Anaerobic Digestion Model No 1, IWA Scientific and Technical Report No. 13, IWA Publishing, London, UK.
- Batstone D. J., Amerlinck Y., Ekama G., Goel R., Grau P., Johnson B., Kaya I., Steyer J.-P., Tait S., Takács I. and Vanrolleghem P. A. (2012). Towards a generalized physicochemical framework. *Water Science & Technology*, 66(6), 1147–1161, <https://doi.org/10.2166/wst.2012.300>
- Boiocchi R., Gernaey K. V. and Sin G. (2017a). A novel fuzzy-logic control strategy minimizing N<sub>2</sub>O emissions. *Water Research*, 123, 479–494, <https://doi.org/10.1016/j.watres.2017.06.074>
- Boiocchi R., Gernaey K. V. and Sin G. (2017b). Understanding N<sub>2</sub>O formation mechanisms through sensitivity analyses using a plant-wide benchmark simulation model. *Chemical Engineering Journal*, 317, 935–951, <https://doi.org/10.1016/j.cej.2017.02.091>
- Corominas L., Flores-Alsina X., Snip L. and Vanrolleghem P. A. (2012). Comparison of different modelling approaches to better understand greenhouse gas emissions from wastewater treatment plants. *Biotechnology and Bioengineering*, 109(11), 2855–2863, <https://doi.org/10.1002/bit.24544>
- Domingo-Felez C., Calderó-Pascual M., Sin G., Plósz B. G. and Smets B. F. (2017). Calibration of the comprehensive NDHA-N<sub>2</sub>O dynamics model for nitrifier-enriched biomass using targeted respirometric assays. *Water Research*, 126, 29–39, <https://doi.org/10.1016/j.watres.2017.09.013>
- Dong Y. and Steinberg M. (1997). Hynol: an economical process for methanol production from biomass and natural gas with reduced CO<sub>2</sub> emission. *International Journal of Hydrogen Energy*, 22(10–11), 971–977, [https://doi.org/10.1016/S0360-3199\(96\)00198-X](https://doi.org/10.1016/S0360-3199(96)00198-X)
- Feldman H., Flores-Alsina X., Ramin P., Kjellberg K., Batstone D. J., Jeppsson U. and Gernaey K. V. (2018). Optimization of full-scale anaerobic granular sludge reactor using a model based approach. *Biotechnology Bioengineering*, 115(11), 2726–2739, <https://doi.org/10.1002/bit.26807>
- Flores-Alsina X., Corominas L., Snip L. and Vanrolleghem P. A. (2011). Including greenhouse gas emissions during benchmarking of wastewater treatment plant control strategies. *Water Research*, 45(16), 4700–4710, <https://doi.org/10.1016/j.watres.2011.04.040>
- Flores-Alsina X., Corominas L., Neumann M. B. and Vanrolleghem P. A. (2012). Assessing the use of activated sludge process design guidelines in wastewater treatment plant projects. *Environmental Modelling & Software*, 38, 50–58, <https://doi.org/10.1016/j.envsoft.2012.04.005>
- Flores-Alsina X., Arnell M., Amerlinck Y., Corominas L., Gernaey K. V., Guo L., Lindblom E., Nopens I., Porro J., Shaw A., Snip L., Vanrolleghem P. A. and Jeppsson U. (2014). Balancing effluent quality, economical cost and greenhouse gas emissions during the evaluation of plant-wide wastewater treatment plant control strategies. *Science of the Total Environment*, 466–467, 616–624, <https://doi.org/10.1016/j.scitotenv.2013.07.046>

- Flores-Alsina X., Kazadi-Mbama C., Solon K., Vrecko D., Tait S., Batstone D., Jeppsson U. and Gernaey K. V. (2015). A plant wide aqueous phase chemistry module describing pH variations and ion speciation/pairing in wastewater treatment models. *Water Research*, **85**, 255–265, <https://doi.org/10.1016/j.watres.2015.07.014>
- Foley J., Yuan Z., Keller J., Senante E., Chandran K., Willis J., van Loosdrecht M. and van Voorthuizen E. (2011). N<sub>2</sub>O and CH<sub>4</sub> Emission From Wastewater Collection and Treatment Systems, Technical report, Global Water Research Coalition, London, UK.
- Gernaey K. V., Flores-Alsina X., Rosen C., Benedetti L. and Jeppsson U. (2011). Dynamic influent pollutant disturbance scenario generation using a phenomenological modelling approach. *Environmental Modelling & Software*, **26**(11), 1255–1267, <https://doi.org/10.1016/j.envsoft.2011.06.001>
- Gernaey K. V., Jeppsson U., Vanrolleghem P. A. and Copp J. B. (2014). Benchmarking of Control Strategies for Wastewater Treatment Plants, IWA Scientific and Technical Report No. 23, IWA Publishing, London, UK.
- Guo L. and Vanrolleghem P. A. (2014). Calibration and validation of an Activated Sludge Model for Greenhouse Gases no. 1 (ASMG1): prediction of temperature-dependent N<sub>2</sub>O emission dynamics. *Bioprocess and Biosystems Engineering*, **37**, 151–163, <https://doi.org/10.1007/s00449-013-0978-3>
- Guo L., Porro J., Sharma K. R., Amerlinck Y., Benedetti L., Nopens I., Shaw A., Van Hulle S. W. H., Yuan Z. and Vanrolleghem P. A. (2012). Towards a benchmarking tool for minimizing wastewater utility greenhouse gas footprints. *Water Science & Technology*, **66**(11), 2483–2495, <https://doi.org/10.2166/wst.2012.495>
- Gustavsson D. J. I. and Tumlin S. (2013). Carbon footprints of Scandinavian wastewater treatment plants. *Water Science & Technology*, **68**(4) 887–893, <https://doi.org/10.2166/wst.2013.318>
- Henze M., Gujer W., Mino T. and van Loosdrecht M. C. M. (2000). Activated Sludge Models ASM1, ASM2, ASM2d and ASM3, IWA Scientific and Technical Report No. 9, IWA Publishing, London, UK.
- Hiatt W. C. and Grady C. P. L., Jr. (2008). An updated process model for carbon oxidation, nitrification, and denitrification. *Water Environment Research*, **80**(11), 2145–2156, <https://doi.org/10.2175/106143008X304776>
- Hug T., Benedetti L., Hall E. R., Johnson B. R., Morgenroth E., Nopens I., Rieger L., Shaw A. and Vanrolleghem P. A. (2009). Wastewater treatment models in teaching and training: The mismatch between education and requirements for jobs. *Water Science & Technology*, **59**(4), 745–753, <https://doi.org/10.2166/wst.2009.595>
- IPCC (2013). Climate change 2013: The physical science basis. In: Contribution of Working Group I to the Fifth Assessment Report of the Intergovernmental Panel on Climate Change, T. F. Stocker, D. Qin, G.-K. Plattner, M. Tignor, S. K. Allen, J. Boschung, A. Nauels, Y. Xia, V. Bex and P. M. Midgley (eds.), Cambridge University Press, Cambridge, England and New York, NY, USA.
- Jeppsson U., Pons M. N., Nopens I., Alex J., Copp J. B., Gernaey K. V., Rosen C., Steyer J. P. and Vanrolleghem P. A. (2007). Benchmark simulation model no. 2: general protocol and exploratory case studies. *Water Science & Technology*, **56**(8), 67–78, <https://doi.org/10.2166/wst.2007.604>
- Jönsson H., Junestedt C., Willén A., Yang J., Tjus K., Baresel C., Rodhe L., Trela J., Pell M. and Andersson S. (2015). Reduce greenhouse gas emissions from wastewater treatment and sewage sludge (In Swedish: Minska utsläpp av växthusgaser från rening av avlopp och hantering av avloppsslam), Report SVU 2015-02, The Swedish Water and Wastewater Association, Stockholm, Sweden.
- Kampschreur M. J., Temmink H., Kleerebezem R., Jetten M. S. M. and van Loosdrecht M. C. M. (2009). Nitrous oxide emission during wastewater treatment. *Water Research*, **43**(17), 4093–4103, <https://doi.org/10.1016/j.watres.2009.03.001>
- Liebetrau J., Clemens J., Cuhls C., Hafermann C., Friehe J., Weiland P. and Daniel-Gromke J. (2010). Methane emissions from biogas-producing facilities within the agricultural sector. *Engineering in Life Sciences* **10**(6), 595–599, <https://doi.org/10.1002/elsc.201000070>
- Lindblom E., Arnell M., Flores-Alsina X., Stenström F., Gustavsson D. J. I. and Jeppsson U. (2016). Dynamic modelling of nitrous oxide emissions from three Swedish full-scale reject water treatment systems. *Water Science & Technology*, **73**(4), 798–806, <https://doi.org/10.2166/wst.2015.534>
- Mampaey K. E., Beuckels B., Kampschreur M. J., Kleerebezem R., van Loosdrecht M. C. M. and Volcke E. I. P. (2013). Modelling nitrous and nitric oxide emissions by autotrophic ammonia-oxidizing bacteria. *Environmental Technology*, **34**(12), 1555–1566, <https://doi.org/10.1080/09593330.2012.758666>
- Mannina G., Ekama G., Caniani D., Cosenza A., Esposito G., Gori R., Garrido-Baserba M., Rosso D. and Olsson G. (2016). Greenhouse gases from wastewater treatment – a review of modelling tools. *Science of the Total Environment*, **551–552**, 254–270, <https://doi.org/10.1016/j.scitotenv.2016.01.163>
- Meng F., Fu G. and Butler D. (2016). Water quality permitting: from end-of-pipe to operational strategies. *Water Research*, **101**, 114–126, <https://doi.org/10.1016/j.watres.2016.05.078>

- Meng F, Fu G. and Butler D. (2020). Regulatory implications of integrated real-time control technology under environmental uncertainty. *Environmental Science & Technology*, **54**(3), 1314–1325, <https://doi.org/10.1021/acs.est.9b05106>
- Molinos-Senante M., Gomez T., Garrido-Baserba M., Caballero R. and Sala-Garrido R. (2014). Assessing the sustainability of small wastewater treatment systems: a composite indicator approach. *Science of the Total Environment*, **497–498**, 607–617, <https://doi.org/10.1016/j.scitotenv.2014.08.026>
- Nopens I., Benedetti L., Jeppsson U., Pons M. N., Alex J., Copp J. B., Gernaey K. V., Rosen C., Steyer J. P. and Vanrolleghem P. A. (2010). Benchmark Simulation Model No 2: Finalisation of plant layout and default control strategy. *Water Science & Technology*, **62**, 1967–1974. <https://doi.org/10.2166/wst.2010.044>
- Ni B. J. and Yuan Z. (2015). Recent advances in mathematical modeling of nitrous oxides emissions from wastewater treatment processes. *Water Research*, **87**, 336–346, <https://doi.org/10.1016/j.watres.2015.09.049>
- Nopens I., Batstone D. J., Copp J. B., Jeppsson U., Volcke E., Alex J. and Vanrolleghem P. A. (2009). An ASM/ADM model interface for dynamic plant-wide simulation. *Water Research*, **43**(7), 1913–1923, <https://doi.org/10.1016/j.watres.2009.01.012>
- Olsson G. (2012). ICA And me: a subjective review. *Water Research*, **46**(6), 1586–1624, <https://doi.org/10.1016/j.watres.2011.12.054>
- Otterpohl R. and Freund M. (1992). Dynamic models for clarifiers of activated sludge plants with dry and wet weather flows. *Water Science and Technology*, **26**, 1391–1400, <https://doi.org/10.2166/wst.1992.0582>
- Pocquet M., Wu Z., Queinnec I. and Spérandio M. (2016). A two pathway model for N<sub>2</sub>O emissions by ammonium oxidizing bacteria supported by the NO/N<sub>2</sub>O variation. *Water Research*, **88**(1), 948–959, <https://doi.org/10.1016/j.watres.2015.11.029>
- Rivas A., Irizar I. and Ayesa E. (2008). Model-based optimisation of wastewater treatment plants design. *Environmental Modelling & Software*, **23**(4), 435–450, <https://doi.org/10.1016/j.envsoft.2007.06.009>
- Rodriguez-Roda I., Sánchez-Marrè M., Comas J., Baeza J., Colprim J., Lafuente J., Cortes U. and Poch M. (2002). A hybrid supervisory system to support WWTP operation: implementation and validation. *Water Science & Technology*, **45**(4–5), 289–297, <https://doi.org/10.2166/wst.2002.0608>
- Santin I., Barbu M., Pedret C. and Vilanova R. (2017). Control strategies for nitrous oxide emissions reduction on wastewater treatment plants operation. *Water Research*, **125**, 466–477, <https://doi.org/10.1016/j.watres.2017.08.056>
- Solis B., Guisasaola A., Flores-Alsina X., Jeppsson U. and Baeza A. (2019). A Plant-Wide Model Describing Energy/Nutrient Recovery Options and GHG Emissions for Water Resource Recovery Facilities. In: Proceedings of 10th IWA Symposium on Modelling and Integrate Assessment. IWA Publishing.
- Solis B., Guisasaola A., Flores-Alsina X., Jeppsson U. and Baeza J. A. (2022). A plant wide model describing GHG emissions and nutrient recovery options for water resource recovery facilities. *Water Research*. Accepted. <https://doi.org/10.1016/j.watres.2022.118223>
- Solon K., Flores-Alsina X., Kazadi-Mbama C., Ikumi D., Volcke E. I. P., Vaneekhaute C., Ekama G., Vanrolleghem P. A., Batstone D. J., Gernaey K. V. and Jeppsson U. (2017). Plant-wide modelling of phosphorus transformations in biological nutrient removal wastewater treatment systems: impacts of control and operational strategies. *Water Research*, **113**, 97–110, <https://doi.org/10.1016/j.watres.2017.02.007>
- Su Q., Domingo Felez C., Zhang Z., Blum J. M., Jensen M. M. and Smets B. F. (2019). The effect of pH on N<sub>2</sub>O production in intermittently-fed nitrification reactors. *Water Research*, **156**, 223–231, <https://doi.org/10.1016/j.watres.2019.03.015>
- Sweetapple C., Fu G. and Butler D. (2014a). Multi-objective optimisation of wastewater treatment plant control to reduce greenhouse gas emissions. *Water Research*, **55**, 52–62, <https://doi.org/10.1016/j.watres.2014.02.018>
- Sweetapple C., Fu G. and Butler D. (2014b). Identifying key sources of uncertainty in the modelling of greenhouse gas emissions from wastewater treatment. *Water Research*, **47**(13), 4652–4665, <https://doi.org/10.1016/j.watres.2013.05.021>
- Sweetapple C., Fu G. and Butler D. (2015). Does carbon reduction increase sustainability? A study in wastewater treatment. *Water Research*, **87**, 522–530, <https://doi.org/10.1016/j.watres.2015.06.047>
- Takács I., Patry G.G. and Nolasco D. (1991). A dynamic model of the clarification-thickening process. *Water Research*, **25**, 1263–1271, [https://doi.org/10.1016/0043-1354\(91\)90066-Y](https://doi.org/10.1016/0043-1354(91)90066-Y)
- Tchobanoglous G., Burton F. L. and Stensel H. D. (2003). *Wastewater Engineering: Treatment, Disposal and Reuse*. McGraw-Hill, New York, USA.

Wunderlin P., Lehmann M. F., Siegrist H., Tuzson B., Joss A., Emmenegger L. and Mohn J. (2013). Isotope signatures of N<sub>2</sub>O in a mixed microbial population system: constraints on N<sub>2</sub>O producing pathways in wastewater treatment. *Environmental Science and Technology*, **47**(3), 1339–1348.

## NOMENCLATURE

AD	Anaerobic digester
ADM	Anaerobic digestion model
AE	Aeration energy (kWh·day <sup>-1</sup> )
AER	Aerobic section
AOB	Ammonium oxidizing bacteria
ANOX	Anoxic section
ASM	Activated sludge model
BOD	Biochemical oxygen demand (g·m <sup>-3</sup> )
BSM2	Benchmark Simulation Model No 2
CH <sub>4</sub>	Methane (kg CH <sub>4</sub> ·day <sup>-1</sup> )
CO <sub>2</sub>	Carbon dioxide (kg CO <sub>2</sub> ·day <sup>-1</sup> )
CO <sub>2e</sub>	Equivalent carbon dioxide (kg CO <sub>2e</sub> ·day <sup>-1</sup> )
COD	Chemical oxygen demand (g·m <sup>-3</sup> )
DO	Dissolved oxygen concentration (g·m <sup>-3</sup> )
DW	Dewatering unit
EC	Consumption of external carbon source (kg COD·day <sup>-1</sup> )
EQI	Effluent quality index (kg pollution·day <sup>-1</sup> )
GHG	Greenhouse gas
GWP	Global warming potential
HE	Heating energy (kWh·day <sup>-1</sup> )
K <sub>L</sub> a	Volumetric oxygen transfer coefficient (day <sup>-1</sup> )
ME	Mixing energy (kWh·day <sup>-1</sup> )
MP	Methane production (kgCH <sub>4</sub> ·day <sup>-1</sup> )
N	Nitrogen
NH <sub>4</sub> <sup>+</sup>	Ammonium nitrogen (g N·m <sup>-3</sup> )
NO	Nitric oxide nitrogen (g N·m <sup>-3</sup> )
N <sub>2</sub> O	Nitrous oxide nitrogen (kg N·day <sup>-1</sup> )
NOB	Nitrite oxidizing bacteria
NO <sub>2</sub> <sup>-</sup>	Nitrite nitrogen (g N·m <sup>-3</sup> )
NO <sub>3</sub> <sup>-</sup>	Nitrate nitrogen (g N·m <sup>-3</sup> )
NO	Oxidized forms of nitrogen (g N m <sup>-3</sup> )
OCI	Operational cost index (-)
PE	Pumping energy (kWh·day <sup>-1</sup> )



PRIM	Primary clarifier
PI	Proportional integral controller
$Q_e$	Effluent flow rate ( $\text{m}^3 \cdot \text{day}^{-1}$ )
$Q_{\text{carb}}$	External carbon source flow rate ( $\text{m}^3 \cdot \text{day}^{-1}$ )
$Q_{\text{intr}}$	Internal recycle flow rate ( $\text{m}^3 \cdot \text{day}^{-1}$ )
$Q_r$	External recirculation flow rate ( $\text{m}^3 \cdot \text{day}^{-1}$ )
$Q_w$	Waste sludge flow rate ( $\text{m}^3 \cdot \text{day}^{-1}$ )
SEC	Secondary clarifier
SP	Sludge production ( $\text{kg TSS} \cdot \text{day}^{-1}$ )
ST	Storage tank
SRT	Sludge retention time (days)
TKN	Total Kjeldahl nitrogen ( $\text{g} \cdot \text{m}^{-3}$ )
TN	Total nitrogen ( $\text{g} \cdot \text{m}^{-3}$ )
THK	Thickener
TOC	Total organic carbon ( $\text{g} \cdot \text{m}^{-3}$ )
TSS	Total suspended solids ( $\text{g} \cdot \text{m}^{-3}$ )
VS	Volatile solids ( $\text{g} \cdot \text{m}^{-3}$ )
WWTP	Wastewater treatment plant