



Review on numerical modeling of active magnetic regenerators for room temperature applications

Nielsen, Kaspar Kirstein; Tusek, Jaka; Engelbrecht, Kurt; Schopfer, Sandro; Kitanovski, Andrej; Bahl, Christian Robert Haffenden; Smith, Anders; Pryds, Nini; Poredos, Alojz

Published in:
International Journal of Refrigeration

Link to article, DOI:
[10.1016/j.ijrefrig.2010.12.026](https://doi.org/10.1016/j.ijrefrig.2010.12.026)

Publication date:
2011

[Link back to DTU Orbit](#)

Citation (APA):
Nielsen, K. K., Tusek, J., Engelbrecht, K., Schopfer, S., Kitanovski, A., Bahl, C. R. H., Smith, A., Pryds, N., & Poredos, A. (2011). Review on numerical modeling of active magnetic regenerators for room temperature applications. *International Journal of Refrigeration*, 34(3), 603-616. <https://doi.org/10.1016/j.ijrefrig.2010.12.026>

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Manuscript Number: IJIR-D-10-00230R2

Title: Review on numerical modeling of active magnetic regenerators for room temperature applications

Article Type: Review Paper

Keywords: Magnetic refrigerator; Gadolinium; Regeneration; Modelling

Corresponding Author: Mr Kaspar Kirstein Nielsen, M.Sc

Corresponding Author's Institution: Technical University of Denmark

First Author: Kaspar Kirstein Nielsen, M.Sc

Order of Authors: Kaspar Kirstein Nielsen, M.Sc; Jaka Tusek, MSc; Kurt Engelbrecht, PhD; Sandro Schopfer, MSc; Andrej Kitanovski, PhD; Christian Bahl, PhD; Anders Smith, PhD; Nini Pryds, PhD; Alojz Poredos, PhD

Abstract: The active magnetic regenerator (AMR) is an alternative refrigeration cycle with a potential gain of energy efficiency compared to conventional refrigeration techniques. The AMR poses a complex problem of heat transfer, fluid dynamics and magnetic fields, which requires detailed and robust modeling. This paper reviews the existing numerical modeling of room temperature AMR to date. The governing equations, implementation of the magnetocaloric effect (MCE), fluid flow and magnetic field profiles, thermal conduction etc. are discussed in detail as is their impact on the AMR cycle. Flow channeling effects, hysteresis, thermal losses and demagnetizing fields are discussed and it is concluded that more detailed modeling of these phenomena is required to obtain a better understanding of the AMR cycle.

Response to Reviewers: Dear Dr. Ziegler,

We have increased the font size in Fig. 5 of the manuscript according to your requirements. We gratefully thank you for accepting the manuscript and wish you a merry Christmas.

On behalf of the authors,
Kaspar K. Nielsen, PhD.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

Review on numerical modeling of active magnetic regenerators for room temperature applications

K.K. Nielsen^{a,b}, J. Tusek^c, K. Engelbrecht^b, S. Schopfer^d, A. Kitanovski^c,
C.R.H. Bahl^b, A. Smith^b, N. Pryds^b, A. Poredos^c

^a*Department of Mechanical Engineering, Technical University of Denmark
Building 425, Niels Koppels Alle, DK-2800 Kgs. Lyngby, Denmark*

^b*Fuel Cells and Solid State Chemistry Division
Risø National Laboratory for Sustainable Energy
Technical University of Denmark, Frederiksborgvej 399, DK-4000 Roskilde, Denmark*

^c*University of Ljubljana
Faculty of Mechanical Engineering
Askerceva c. 6, 1000 Ljubljana, Slovenia*

^d*University of Victoria
Institute of Integrated Energy Systems
ELW B126, PO Box 3055 STN CSC
Victoria BC, V8W 3P6, Canada*

Abstract

The active magnetic regenerator (AMR) is an alternative refrigeration cycle with a potential gain of energy efficiency compared to conventional refrigeration techniques. The AMR poses a complex problem of heat transfer, fluid dynamics and magnetic field, which requires detailed and robust modeling. This paper reviews the existing numerical modeling of room temperature AMR to date. The governing equations, implementation of the magnetocaloric effect (MCE), fluid flow and magnetic field profiles, thermal conduction etc. are discussed in detail as is their impact on the AMR cycle. Flow channeling effects, hysteresis, thermal losses and demagnetizing

Email address: e-mail: kaki@risoe.dtu.dk (K.K. Nielsen)

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

fields are discussed and it is concluded that more detailed modeling of these phenomena is required to obtain a better understanding of the AMR cycle.

Keywords: Magnetic refrigerator, Gadolinium, Regeneration, Modelling

Nomenclature

<i>Variables</i>	
T	Temperature [K]
T_C	Curie temperature [K]
T_∞	Ambient temperature [K]
ΔT_{ad}	Adiabatic temperature change [K]
$\mathbf{u} = (u_x, u_y, u_z)$	Velocity vector [ms^{-1}]
A_{HT}	Wetted area per unit cell [m^2m^{-3}]
c	Specific heat capacity [$\text{Jkg}^{-1}\text{K}^{-1}$]
ρ	Mass density [kgm^{-3}]
k	Thermal conductivity [$\text{Wm}^{-1}\text{K}^{-1}$]
h	Convective heat transfer coefficient [$\text{Wm}^{-2}\text{K}^{-1}$]
τ_1	Timing of magnetization part of the AMR cycle [s]
τ_2	Timing of hot blow part of the AMR cycle [s]
τ_3	Timing of demagnetization part of the AMR cycle [s]
τ_4	Timing of cold blow part of the AMR cycle [s]
τ_{rel}	Equal to $\tau_1/\tau_2 = \tau_3/\tau_4$ [-]
τ_{tot}	Equal to $2(\tau_1 + \tau_2)$ [s]
μ_0	Vacuum permeability equal to $4\pi 10^{-7}\text{NA}^{-2}$
$\mu_0 H$	Magnetic field [T]
M	Magnetization [Am^{-1}]
D_p	Dispersion coefficient [-]
Pe	Peclet number [-]
d_p	Particle diameter [m]
d_r	Regenerator diameter [m]
L	Length [m]
V	Volume [m^3]
\dot{m}	Mass flow rate [kg s^{-1}]
f	Frequency [Hz]
φ	Utilization [-]
ϵ	Porosity [-]
Q_c	Cooling power [Wkg^{-1}]
Δp	Pressure drop [Pa]
μ_f	Dynamic viscosity [$\text{Pa}\cdot\text{s}$]
$K(r)$	Particle bed permeability [m^2]

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

<i>Abbreviations</i>	
AMR	Active Magnetic Regeneration
MCE	Magnetocaloric effect
MCM	Magnetocaloric material
MFM	Mean field model
HHEX	Hot heat exchanger
CHEX	Cold heat exchanger
HTF	Heat transfer fluid
COP	Coefficient of Performance

<i>Sub- and super scripts</i>	
f	Fluid
s	Solid
<i>i</i>	Initial
<i>f</i>	Final
HT	Heat transfer
Cold	Refers to the cold side reservoir
Hot	Refers to the hot side reservoir
Stat	Static
Eff	Effective
Appl	Applied

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

1. Introduction

For several decades the active magnetic regenerator (AMR) has been a research topic within the magnetic refrigeration community, as it is a potential alternative to vapor compression technology at room temperature. Such an AMR is based on the magnetocaloric effect (MCE), which manifests itself as a temperature change of a magnetocaloric material (MCM) upon adiabatically changing the magnetic field of the material. Since the maximum adiabatic temperature change of any known MCMs is no more than a few degrees in a magnetic field of one tesla (Pecharsky & Gschneidner, 2006), the regenerative cycle has to be applied in order to create temperature spans comparable to e.g. those of vapor-compression based cooling systems (Barclay, 1983). Recently, a range of experimental AMR devices have been built and a review of these can be found in Gschneidner & Pecharsky (2008); Yu et al. (2010). In Yu et al. (2003); Engelbrecht et al. (2007b) general reviews of room temperature magnetic refrigeration are given. Although improvements in AMR performance have been realized, there are currently no commercial devices available, and additional technology development is necessary. Therefore, it is critical to understand the fundamental loss mechanisms, performance limits, and optimal design of AMR systems using detailed models.

Since the AMR involves solid state physics, thermodynamics, fluid dynamics and magnetism a broad range of physical effects influences the performance of such a system. It is therefore quite important to have reliable numerical models such that the performance trends may be mapped out. A range of such models have been made already, however, a comprehensive review of these models is not available at present. This paper provides such

1
2
3
4
5
6
7
8
9 a review, which not only include a discussion of the various models but also
10 discusses in detail the various components of an AMR model and how they
11 affect the model results.
12
13
14

15 *1.1. The AMR cycle*

16
17
18 The AMR cycle consists of four processes, which can overlap. First there
19 is magnetization, where the field applied to the solid regenerator material
20 is increased causing a temperature increase. Magnetization is followed by
21 a fluid flow from the cold fluid reservoir to the hot fluid reservoir, rejecting
22 heat to the ambient. During demagnetization the applied field is then re-
23 duced causing the temperature of the regenerator solid to drop and, finally,
24 there is fluid flow from the hot reservoir to the cold, and a cooling load is
25 accepted. The flow processes are governed by the same governing equations
26 as for passive regenerators, which have been studied in detail by, for example,
27 Hausen (1983); Dragutinovic & Baclic (1998); Willmott (1964). The major
28 difference between passive regenerator models and AMR models is the im-
29 plementation of the MCE and the timing between the magnetic field profile
30 and the fluid flow profile.
31
32
33
34
35
36
37
38
39
40
41
42

43 Several approaches to the overall AMR modeling are applied. Steady-
44 state models are simple models, which may provide an estimate of the per-
45 formance in terms of cooling power versus temperature span as a function
46 of e.g. the geometry of the AMR. Time-dependent models provide a more
47 complex description of the AMR. Since the change of the magnetic field and
48 the fluid flow is inherently time dependent and is coupled with heat transfer
49 between a fluid and a solid, these models capture the physics on a more fun-
50 damental level. Both types of models are discussed in the following, although
51
52
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9 the emphasis is put on the time-dependent models, which are dominant in
10 the more recent literature. In Section 2 the specifics of these models are
11 discussed in detail. The remainder of this section gives an overview of the
12 overall development of AMR models.
13
14
15
16

17 18 *1.2. Steady-State AMR Models* 19

20 There are several time independent models of AMR systems; these mod-
21 els are sometimes referred to as zero-period or steady-state models. The
22 models generally start from an ideal AMR cycle and reduce the performance
23 individually for estimated losses to axial conduction, heat transfer losses, etc.
24 Steady state models are useful for qualitative investigations of AMR cycle
25 characteristics; for example, the evaluation of the magnetocaloric properties
26 of various materials in the context of an AMR cycle or the parametric in-
27 vestigation of the impact of a particular cycle parameter. The major benefit
28 of these steady-state models is their computational efficiency; however, the
29 predictive capability of a steady state model is limited as they are unable
30 to capture interactions between loss mechanisms. Zhang et al. (2000); He
31 et al. (2003); Zhang et al. (1993) and papers by Yan & Chen (1991, 1992)
32 all present steady state models that can be used to understand the charac-
33 teristics of various AMR cycle configurations. Shir et al. (2003) use a time
34 independent model to show how magnetic nanocomposites may be used to
35 obtain an ideal magnetic refrigerant, one in which the local adiabatic tem-
36 perature change is proportional to the local absolute temperature. Rowe &
37 Barclay (2003) presents a model based on entropy minimization that predicts
38 the ideal MCE along the length of the regenerator bed. The major short-
39 comings of all steady state models are their approach to capturing the effect
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9 of material properties and their macroscopic approach to estimating losses.
10

11 *1.3. Time Dependent AMR Models*

12
13

14 Researchers at Astronautics Corp. of America have presented the Fi-
15 nite Reduced Period (FRP) model; this AMR model is one-dimensional and
16 time dependent, but it requires that the heat capacity of the entrained fluid
17 in the regenerator be negligible compared to that of the magnetic material
18 (DeGregoria et al., 1990; DeGregoria, 1991). In this limit, the conventional
19 regenerator equations are solved during the flow portions of the cycle and
20 instantaneous temperature changes are imposed at the conclusion of these
21 processes. These temperature changes represent the magnetization and de-
22 magnetization processes, which are assumed to occur reversibly and adia-
23 batically. The pumping loss, axial conduction, and dispersion losses are
24 calculated separately and then subtracted from the predicted refrigeration
25 power (Johnson & Zimm, 1996).
26
27
28
29
30
31
32
33
34
35
36

37 The FRP model has been applied primarily to the design of low temper-
38 ature AMR systems that use a gas as the heat transfer fluid, as described
39 by Janda et al. (1989), and therefore the assumption of negligible entrained
40 fluid heat capacity is not overly restrictive.
41
42
43
44

45 Kirol & Mills (1984) describe a one-dimensional transient model of a mag-
46 netic cycle that assumes perfect regeneration. Smaili & Chahine (1998) de-
47 scribe a one dimensional transient model in which only the flow processes are
48 considered; the magnetization and demagnetization processes are assumed to
49 happen instantaneously and reversibly. The heat transfer coefficient is as-
50 sumed to be constant throughout the regenerator, and the impact of axial
51 conduction and entrained heat capacity is not considered. Hu & Xiao (1995)
52
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

present an analysis of AMR systems that is based on small perturbation theory; a technique that is used for pulse-tube type refrigeration systems, as described by several researchers including Hooijkaas & Benschop (1999). The governing equations are linearized and the fluctuating parameters are written in complex form, implying a sinusoidal variation of all such quantities.

These models consider regenerator geometries where the heat transfer between the solid and the fluid is described via a Nusselt number, i.e. the physical domain on which the heat transfer takes place is not resolved. Most geometries, such as packed spheres, wire mesh screens etc. make it quite difficult if not impossible to model the physical situation directly. However, a two-dimensional model of a flat plate AMR is described by Petersen et al. (2008b). The model uses a finite element (FEM) approach to solve for fluid flow profiles and temperature gradients in the solid and the liquid. Because of the increased complexity of the model, the computation time is much higher for the two-dimensional model than equivalent one-dimensional models. The geometry is fixed as a flat plate regenerator and modeling other regenerator geometries would require significant modifications to the existing model. See Appendix A for a summary of the published AMR models to date.

The overall goal of an AMR model is to predict the cooling power versus the temperature span, i.e. the difference in temperature between the hot and cold reservoirs. Including the work performed during the AMR cycle the coefficient of performance (COP) is also available. In this way the theoretical performance of an AMR may be mapped out using a numerical model.

2. Components in a numerical AMR model

This section describes the various aspects of an AMR model. These include the basic equations that are solved, how fluid flow and magnetic field profiles are implemented, how the MCE is addressed etc.

2.1. Basic energy balance equations

All numerical models of the AMR are based on a mathematical model describing heat transfer in a solid matrix structure, the MCE in the solid due to the changing magnetic field, and the coupling to the convective heat transfer of a fluid. Thus, the most general energy equation for the regenerator solid may be expressed as

$$\rho_s c_s \frac{\partial T_s}{\partial t} = \nabla \cdot (k_s \nabla T_s) + \dot{Q}_{\text{MCE}} + \dot{Q}_{\text{loss}} + \dot{Q}_{\text{HT}}, \quad (1)$$

which describes the heat transfer on the macroscopic scale thus taking into account the intrinsic thermal conductivity of the solid. Subscript s is for solid, the mass density is denoted by ρ_s , the specific heat is c_s , temperature is T_s , time is t , thermal conductivity is k_s , the MCE term \dot{Q}_{MCE} , irreversible losses are denoted by \dot{Q}_{loss} and finally the heat transfer between solid and fluid is denoted \dot{Q}_{HT} . In the case of a 1D model this will be given through a Nusselt-Reynolds correlation whereas for a 2D or 3D model the boundary interface between solid and fluid is usually spatially resolved and the term is thus expressing an internal boundary condition. However, 2D or 3D models may apply Nusselt-Reynolds correlations as well. The energy equation for

the heat transfer fluid may be written as

$$\rho_f c_f \left(\frac{\partial T_f}{\partial t} + (\mathbf{u} \cdot \nabla) T_f \right) = \nabla \cdot (k_f \nabla T_f) + \dot{Q}_{\text{loss}} - \dot{Q}_{\text{HT}} \quad (2)$$

Here the subscript f denotes fluid and $\mathbf{u} = (u_x, u_y, u_z)$ is the fluid velocity vector. The energy balance equations are assumed valid over the length scale of the regenerator.

The problem intrinsically also involves fluid dynamics and thus the Navier-Stokes equations must also be solved

$$\frac{\partial \mathbf{u}}{\partial t} + (\mathbf{u} \cdot \nabla) \mathbf{u} = \frac{\mu_f}{\rho_f} \nabla^2 \mathbf{u} - \frac{1}{\rho_f} \nabla p \quad (3)$$

$$\nabla \cdot \mathbf{u} = 0, \quad (4)$$

where μ_f is the dynamic viscosity and p is pressure. Now, Eqs. 3-4 represent a Newtonian incompressible flow. If, e.g., a gas is used as heat transfer fluid (HTF), the compressible Navier-Stokes equations may be necessary. In most cases Eqs. 3-4 are simplified into analytical expressions, which is the case in the 1D and 2D models (e.g. Nielsen et al. (2009a)) or solved numerically (e.g. Petersen et al. (2008b)).

In general, AMR mathematical models include the following assumptions, also used for passive heat regenerator analysis (Shah & Sekulic, 2003)

- No phase change in the fluid occurs. As long as water with anti-freeze is used as HTF, this is a fully valid assumption.
- The fluid is incompressible and thus no compression/expansion of the fluid and no pressure oscillations occur during the flow periods. Again,

1
2
3
4
5
6
7
8
9 when a water/anti-freeze HTF is used this is valid.

- 10
11 • No flow leakage or flow bypassing occurs. This is definitely a simplifying
12 assumption. Experimentally it may be very difficult to control flow
13 bypassing properly.
- 14
15 • Heat transfer caused by radiation within the regenerator is negligible
16 compared to the convective and conductive heat transfer. For near
17 room-temperature applications this is a good approximation since very
18 little heat transfer occurs through radiation.
- 19
20 • The solid within the regenerator is uniformly distributed with no edge
21 effects. This is a simplifying assumption that is notoriously difficult to
22 control in experiments.
23
24
25
26
27
28
29
30
31
32

33 2.2. One-dimensional models

34 Many AMR models are one-dimensional and thus assume a Nusselt num-
35 ber correlation as a function of the Reynolds number in order to describe
36 the convective heat transfer between the solid and the fluid. Expressing Eqs.
37 1–2 in one dimension, the equations for the solid and the fluid in the 1D case
38 can be defined as:
39
40
41
42
43
44

$$45 \rho_s c_s \frac{\partial T_s}{\partial t} = \frac{\partial}{\partial x} \left(k_s \frac{\partial T_s}{\partial x} \right) + \dot{Q}_{\text{MCE}} + \dot{Q}_{\text{loss}} + \dot{Q}_{\text{HT}} \quad (5)$$

$$46 \rho_f c_f \left(\frac{\partial T_f}{\partial t} + u_x \frac{\partial T_f}{\partial x} \right) = \frac{\partial}{\partial x} \left(k_f \frac{\partial T_f}{\partial x} \right) + \dot{Q}_{\text{loss}} - \dot{Q}_{\text{HT}} \quad (6)$$

1
2
3
4
5
6
7
8
9 *2.3. Implementation of the heat transfer between the fluid and the solid*

10
11 In all 1D models a heat transfer coefficient, h , describing the heat transfer
12 between the fluid and the solid must be used. The heat transfer rate can be
13 written as
14

$$15 \dot{Q}_{\text{HT}}(x) = hA_{\text{HT}} (T_{\text{s}}(x) - T_{\text{f}}(x)) \quad (7)$$

16
17 where the wetted area per unit cell of the solid material is denoted A_{HT} .
18 Perhaps the most crucial parameter in a 1D model is the heat transfer coef-
19 ficient. This parameter presents a correlation for the convective heat trans-
20 fer between the solid and the fluid and the most crucial part of the AMR
21 model thus relies on it. In general, correlations for h are presented in lit-
22 erature (Nusselt-Reynolds correlations). However, often the correlations do
23 not cover the total operational range in terms of the Reynolds number and
24 various correlations exist making it difficult to decide which is the “most
25 correct” to use in a given situation. According to Sarlah & Poredos (2010)
26 a 10 percent higher heat transfer coefficient yields about 4 percent higher
27 temperature span of the AMR.
28
29
30
31
32
33
34
35
36
37
38
39
40

41 The equations for the fluid and the solid in 2D models are usually not
42 coupled through a heat transfer coefficient, but rather an internal bound-
43 ary condition, which defines thermal contact between the fluid and the solid
44 (Petersen et al., 2008b; Nielsen et al., 2009a; Oliveira et al., 2009). As ex-
45 pected, and as was shown in Petersen et al. (2008a) 1D models may in fact
46 yield very similar results to 2D models given certain circumstances; espe-
47 cially when the fluid channels and solid plates are thin and thus the internal
48 thermal gradients perpendicular to the direction of the flow are negligible.
49
50
51
52
53
54
55

56 Sarlah & Poredos (2005) developed a partial 2D model of the AMR based
57
58

on parallel plates. They used a one-dimensional equation for the heat transfer in the fluid and a two-dimensional heat transfer equation for the solid. Thus, they calculated the temperature distribution in the solid (in the flow direction and a perpendicular direction), but they used a correlation for the heat transfer coefficient for the heat transfer between the fluid and solid (very similar to the regular 1D approach) on the form:

$$k_s \left. \frac{\partial T_s}{\partial y} \right|_{y=H}(x) = h (T_s(x, y = H) - T_f(x, y = H)) \quad (8)$$

where the position in the y -direction denoted H refers to the contact point between the solid and fluid.

Since 1D models do not directly account for temperature gradients in the solid material, it has been suggested to reduce the heat transfer coefficient between solid and fluid to account for the losses (Jeffreson, 1972; Engelbrecht et al., 2006). Both Engelbrecht (2008) and Sarlah (2008) used a correction factor for the heat transfer coefficient making it into an effective heat transfer coefficient and thus, to a certain extent, took into account the effect of a non-uniform temperature distribution in the solid perpendicular to the flow direction.

2.4. Two-dimensional models

Petersen et al. (2008b) were the first to implement a complete 2D model of a parallel-plate based AMR at room temperature. In their model the spatially resolved dimensions are the x - and y -directions, i.e. the direction along the flow and the direction perpendicular to the flow and along the thickness of the solid plate. The equations for the solid and fluid used in the

Petersen et al. 2D model may be written as

$$\rho_s c_s \frac{\partial T_s}{\partial t} = k_s \left(\frac{\partial^2 T_s}{\partial x^2} + \frac{\partial^2 T_s}{\partial y^2} \right) \quad (9)$$

$$\rho_f c_f \left(\frac{\partial T_f}{\partial t} + u \frac{\partial T_f}{\partial x} \right) = k_f \left(\frac{\partial^2 T_f}{\partial x^2} + \frac{\partial^2 T_f}{\partial y^2} \right) \quad (10)$$

$$\rho_f \left(\frac{\partial \mathbf{u}}{\partial t} + (\mathbf{u} \cdot \nabla) \mathbf{u} \right) = \mu_f \nabla^2 \mathbf{u} - \nabla p \quad (11)$$

$$\nabla \cdot \mathbf{u} = 0 \quad (12)$$

assuming constant thermal conductivity and that $\mathbf{u} = (u_x, u_y, 0)$. The heat transfer between the solid and fluid domains is modeled through an internal boundary condition, which can be expressed as

$$k_s \frac{\partial T_s}{\partial y} = k_f \frac{\partial T_f}{\partial y} \quad (13)$$

which is valid on the boundary between the two domains only. Oliveira et al. (2009) formulated the 2D AMR problem in a very similar way, albeit using non-dimensional variables.

Very recently, Liu & Yu (2010) presented a 2D model of a porous structure. The authors show that it is possible to track the 2-dimensional temperature distribution in the regenerator bed. In this way internal temperature gradients orthogonal to the flow direction may be resolved.

The equations presented above (1 and 2) (for both 1D and 2D models) include the effect of thermal conduction in the solid and the fluid, convective heat transfer, viscous losses, heat losses to the surroundings and, of course, the MCE. These effects have varying influence on the operation of an AMR and different models thus include various effects, which are discussed below

1
2
3
4
5
6
7
8
9 in detail.

10 11 *2.5. Three-dimensional models*

12
13
14 Bouchard et al. (2009) presented a three-dimensional model of the AMR
15 with a regenerator comprised of particles of spherical and elliptical nature.
16 Their model solves the fully coupled problem with the governing equations
17 including Eqs. 1-2, the incompressible Navier-Stokes equations and the rel-
18 evant magnetostatic equations describing the coupling between the applied
19 magnetic field, magnetization and internal magnetic field. The model of
20 Bouchard et al. (2009) is of great interest since it is the first (published) at-
21 tempt to model the full geometry of an AMR including magnetostatics. Such
22 a model may provide deeper insights into the actual ongoing physics in the re-
23 generator. The results are so far of a limited nature, however, improvements
24 and further results are expected.
25
26
27
28
29
30
31
32
33
34

35 36 *2.6. Other mathematical models*

37
38 Kitanovski et al. (2005) developed a numerical steady state model for a
39 rotary AMR. The model was described in cylindrical coordinates. The radial
40 dimension was neglected. Because of the higher frequency the longitudinal
41 heat conduction was neglected as well. Results of the analysis provided a 2D
42 map of temperature gradients in the solid and fluid, respectively.
43
44
45
46
47

48 49 *2.7. Boundary conditions*

50
51 Initial and boundary conditions have to be specified in order for any AMR
52 model to be solved. These conditions include hot and cold side fluid inlet
53 temperatures and boundary conditions towards the ambient. The common
54 way of defining the boundary conditions is given in Tab. A.1.
55
56
57
58

1
2
3
4
5
6
7
8
9 TABLE 1

10 In the 2D and 3D cases an internal boundary condition similar to that
11 given in Eq. 13 is needed to describe heat transfer between the fluid and the
12 solid. Steady state operation is specified by setting the temperature of the
13 fluid and solid at the beginning of the cycle to the temperature at the end
14 of the previous cycle.
15
16
17
18
19

20
21 *2.8. Implementation of the magnetocaloric effect*
22

23 In order to analyze the operation of the AMR, magnetic properties need
24 to be included in the model. The adiabatic temperature change, ΔT_{ad} , and
25 specific heat of the solid is generally a function of both temperature and
26 magnetic field and appropriate look-up tables should be applied. The MCE
27 is generally implemented in one of two ways.
28
29
30
31

32 The simplest and most straightforward way of including the MCE in
33 the model is to apply the adiabatic temperature change to the solid during
34 the processes of magnetization or demagnetization directly. This may be
35 formulated mathematically as
36
37
38
39
40

$$T = T_i + \Delta T_{\text{ad}}(T_i, \mu_0 H_i, \mu_0 H_f) \quad (14)$$

41 where the initial temperature is denoted T_i , the initial magnetic field H_i and
42 the final magnetic field is H_f .
43
44
45

46 The adiabatic temperature change as a function of temperature, initial
47 and final magnetic field can be derived from experimental data tables or using
48 the mean field model (MFM) (Morrish, 1965) and many authors have used
49 the MFM in their AMR numerical models (Petersen et al., 2008b; Nielsen
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

1
2
3
4
5
6
7
8
9 et al., 2009a; Smailli & Chahine, 1998; Li et al., 2006; Allab et al., 2005;
10 Siddikov et al., 2005; Oliveira et al., 2009; Aprea et al., 2009; Tagliafico
11 et al., 2010; Sarlah & Poredos, 2005; Kitanovski et al., 2005).

12
13
14
15 The following equation may be used to describe the energy release in
16 the magnetocaloric material during magnetization or demagnetization over
17 a period of time

$$18 \dot{Q}_{\text{MCE}} = -T_s \frac{\partial M}{\partial T} \mu_0 \frac{\partial H}{\partial t} \quad (15)$$

19
20
21
22
23 with the volumetric magnetization denoted M . This equation is simply de-
24 rived from the basic thermodynamics of the MCE using the Maxwell relation
25 between the derivative with respect to magnetic field of the entropy and the
26 derivative of the magnetization with respect to temperature. This expression
27 was employed in the models published by e.g. Shir et al. (2004); Engelbrecht
28 et al. (2007a); Nielsen et al. (2009a). This way of implementing the MCE is
29 a so-called built-in method.
30
31
32
33
34
35

36
37 The built-in method for including the MCE in the model presupposes
38 a continuous change of the magnetic field, which will certainly always be
39 the case in an experiment. However, this method requires detailed, and
40 numerically differentiable data sets of the magnetization and specific heat as
41 functions of both temperature and magnetic field. These may not always be
42 available from experimentally obtained data for MCMs.
43
44
45
46
47

48 The processes of magnetization and demagnetization in an AMR can be
49 simulated by both methods. However, the selection of the most suitable
50 method in general depends on the purpose of the simulations. If the main
51 goal of the numerical model is to simulate actual experimental AMRs with
52 high accuracy, it is crucial to use the experimentally obtained magnetocaloric
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9 properties of the chosen magnetocaloric material. However, in the case that
10 sufficient experimental data is not available, the direct application of the
11 adiabatic temperature change may be the best method of applying the MCE.
12
13
14

15 2.9. Effect of longitudinal thermal conduction

16 Longitudinal thermal conduction is included in most models. It has a
17 large influence on the operation of the AMR under certain geometric and
18 operational circumstances, especially for regenerators with a relatively short
19 length and a structure continuously connected along the flow direction (e.g.
20 parallel plates) and/or for small values of the utilization, where the fluid is, of
21 course, moved a short distance. The utilization is defined as the ratio of the
22 thermal mass of the HTF moved to the total thermal mass of the regenerator
23 solid
24
25
26
27
28
29
30
31
32

$$33 \varphi = \frac{\dot{m}_f c_f \tau_2}{m_s c_s}, \quad (16)$$

34 where the mass flow rate is denoted \dot{m}_f and the duration of the blow period is
35 τ_2 . This is also related to the frequency of the operation. A lower frequency
36 means a larger influence of the longitudinal thermal conduction.
37
38
39
40

41 Figure A.1 shows the impact of the longitudinal thermal conduction at
42 different mass flow rates and at two different operating frequencies. It should
43 be noted that the thermal conduction is extremely important to consider at
44 low mass flow rates (low utilizations) and low cycle frequency, since under
45 these conditions the convective heat transfer due to fluid movement is of the
46 same order as the thermal conduction of the fluid and does thus not dominate
47 the heat transfer of the fluid as it does for larger mass flow rates.
48
49
50
51
52
53
54

55 FIGURE 1

1
2
3
4
5
6
7
8
9 Among the published AMR numerical models, some include longitudinal
10 thermal conduction in the solid as well as in the fluid (Petersen et al., 2008b;
11 Nielsen et al., 2009a; Kawanami et al., 2006; Siddikov et al., 2005; Tagli-
12 afico et al., 2010; Legait et al., 2009; Dikeos et al., 2006), which is physically
13 the most correct. Engelbrecht (2008); Sarlah (2008); Dikeos et al. (2006)
14 included longitudinal thermal conduction in the system through an effective
15 longitudinal thermal conduction. In porous media, such as a packed sphere
16 regenerator, the conduction path through the solid and fluid is complex and
17 difficult to separate and model independently. Therefore, the fluid/solid ma-
18 trix is modeled as a single entity regarding longitudinal thermal conduction,
19 which is expressed in the parameter k_{eff} . Such a measure not only simplifies
20 the equation for the fluid, but may also improve the stability of the numerical
21 simulation (Sarlah, 2008). The effective longitudinal thermal conduction of
22 the solid and the fluid may be expressed as
23
24
25
26
27
28
29
30
31
32
33
34
35
36

$$k_{\text{eff}} = k_{\text{stat}} + k_f D_p(\text{Pe}) \quad (17)$$

37
38
39
40 where D_p is the dispersion coefficient, which is a function of the Peclet num-
41 ber, Pe . Correlations for the static conduction, k_{stat} , and the dispersion
42 coefficient may be found in e.g. Hadley (1986).
43
44
45
46

47 Thermal dispersion is a complex phenomenon and may be understood as
48 thermal conduction due to hydrodynamic mixing in the fluid. This mixing
49 occurs due to the geometry of the solid structure and is thus much more
50 complicated to derive in a packed sphere based regenerator than in, e.g.,
51 parallel-plate based regenerators. A continuously connected solid as, e.g.,
52 parallel plates may have a significant dispersion due to higher longitudinal
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9 thermal conductivity.

10
11
12 *2.10. Effect of viscous dissipation*
13

14 Viscous dissipation in the fluid is the irreversible degradation of mechan-
15 ical energy into heat and may have a large impact on the thermal analysis of
16 the regenerator. The impact of the viscous losses is included in most models
17 using a friction factor correlation as presented in e.g. Engelbrecht (2008);
18 Sarlah (2008); Dikeos et al. (2006). Viscous dissipation is generally low for
19 most prototype AMRs and is often neglected in models of AMRs and other
20 regenerators. However, as regenerator geometries reduce in size and AMRs
21 operate at higher frequency, which requires higher fluid flow to maintain an
22 equal utilization, viscous dissipation will increase and may become significant
23 for future AMR configurations or operating conditions.
24
25
26
27
28
29
30
31
32

33 Figure A.2 shows the impact of the pressure drop on the COP of packed
34 spheres AMR with water as a heat transfer fluid at different mass flow rates.
35 Note that pressure drop (viscous losses) affects the COP through irreversible
36 viscous losses as well as through the work needed to pump the fluid through
37 the AMR. The impact on the COP is seen to be most profound at higher
38 mass flow rates (higher utilizations) as expected.
39
40
41
42
43
44

45 FIGURE 2

46
47
48 *2.11. Heat losses*
49

50 Most AMR models assume perfect insulation to the ambient and ignore
51 thermal interactions with the regenerator housing. That means that para-
52 sitic losses due to inevitable temperature gradients between the regenerator
53
54
55
56
57
58
59
60
61
62
63
64
65

1
2
3
4
5
6
7
8
9 and the surroundings are neglected. Only one model has included a formula-
10 tion of the parasitic losses to ambient through the concept of an extra “half”
11 dimension (Nielsen et al., 2009a). This extra spatial dimension is not nu-
12 merically resolved but a lumped heat loss term is applied and found through
13 analyzing the thermal resistance from the regenerator core to the ambient.
14 Results show that this effect may have a significant impact on the AMR per-
15 formance (Nielsen et al., 2009a,c). Figure A.3 shows an example of including
16 the thermal losses in a numerical AMR model.
17
18

19 Frischmann et al. (2009) present a model that considers the thermal in-
20 teraction between the fluid and regenerator housing using a dispersion model
21 that considers radial temperature gradients within the regenerator. Experi-
22 mental single blow data showed that the regenerator housing significantly
23 reduced the apparent heat transfer in the regenerator, especially at low
24 Reynolds numbers (Frischmann et al., 2009). Thermal interactions with the
25 regenerator housing and with the ambient can be a significant loss mecha-
26 nism for AMRs. However, the authors are not aware of work that studies
27 these losses in detail.
28
29

30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

FIGURE 3

2.12. *Magnetic field change*

In general, the magnetic field change can be distinguished between discrete “on-off” and a continuous change (Fig. A.4). If the discrete magnetic field change is assumed, the inclusion of the MCE is limited to the application of the adiabatic temperature change directly since the built-in method is meaningful only with continuous magnetic field changes. However, if the purpose of the numerical model is to simulate the experimental operation

1
2
3
4
5
6
7
8
9 of an AMR, it may be important to implement the time-dependent change
10 of the magnetic field as the magnetic field change and fluid flow processes
11 often overlap in real AMR devices. The time-dependent change of the mag-
12 netic field can generally be handled with both methods of including the MCE
13 presented in Sec. 2.8.
14
15
16
17

18 FIGURE 4

19
20 Most AMR models neglect spatial-dependent magnetic field changes and
21 assume that each piece of magnetocaloric material in the AMR is subject
22 to the same magnetic field change at a given point in time. In Nielsen
23 et al. (2009a) an experimental AMR device was modeled with a spatially
24 resolved applied magnetic field. Bjørk & Engelbrecht (2011) show that the
25 synchronization and width of the magnetic field can be of great importance
26 to the AMR performance. The effect of the demagnetizing field, presented in
27 Sec. 2.8, may have a strong influence on the spatial variation of the internal
28 magnetic field in an AMR. The demagnetizing field is generally a function
29 of geometry, temperature and the material properties of the MCM (Smith
30 et al., 2010; Brug & Wolf, 1985).
31
32
33
34
35
36
37
38
39
40
41

42 *2.13. Materials properties*

43
44 The physical properties of the fluid and the solid are important to in-
45 clude in a physically realistic way. The heat transfer fluid most commonly
46 assumed when modeling AMRs is water perhaps with added anti-corrosives
47 and anti-freeze (Engelbrecht, 2008; Aprea et al., 2009; Tagliafico et al., 2010;
48 Petersen et al., 2008b; Nielsen et al., 2009a). In this case the fluid may safely
49 be assumed to be incompressible and most authors also assume constant
50 fluid properties, i.e. viscosity, mass density and specific heat (Petersen et al.,
51
52
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9 2008b; Nielsen et al., 2009a; Li et al., 2006; Allab et al., 2005; Oliveira et al.,
10 2009; Aprea et al., 2009; Dikeos et al., 2006), whereas a few have imple-
11 mented models with temperature-dependent properties (Engelbrecht, 2008;
12 Engelbrecht et al., 2007a; Siddikov et al., 2005). When the temperature of
13 water is changed, for example, from 0 to 40 °C the mass density and specific
14 heat are consequently changed by less than 1 percent, while the dynamic
15 viscosity may depend on temperature but has less effect on the performance
16 of the AMR. If, for example, a gas is used as the heat transfer fluid, the as-
17 sumption of constant physical properties would lead to a much greater error
18 since mass density, specific heat, thermal conductivity and dynamic viscos-
19 ity of gasses depend significantly on temperature and pressure. Also, an
20 equation of state is needed if the flow cannot be considered incompressible.
21 However, the effect on the AMR performance due to temperature-dependent
22 fluid properties has not been investigated in great detail yet.
23
24
25
26
27
28
29
30
31
32
33
34
35

36 Many authors assume temperature independence of mass density and
37 thermal conductivity of the MCM (see Table A.2). This assumption depends
38 highly on the MCM considered. Considering e.g. gadolinium the thermal
39 conductivity and the mass density do not change significantly around room
40 temperature (see e.g. Jacobsson & Sundqvist (1989) for details) whereas
41 at both lower and higher temperatures the thermal conductivity is depen-
42 dent on temperature. The specific heat of the MCM varies significantly with
43 temperature and magnetic field – especially around the magnetic transition
44 temperature of the material – and should thus not be assumed to be con-
45 stant. Also, some materials (usually exhibiting a 1st order transition) have
46 a structural transition close to the magnetic phase transition temperature.
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

This often induces changes in the volume of the material and thus also the mass density and perhaps even the thermal conductivity.

It is important that the thermodynamic MCM properties are consistent. If care is not taken when determining specific heat and the corresponding entropy change with magnetization or adiabatic temperature change, model predictions can become unrealistic. An example of inconsistent thermodynamic properties is the assumption of a specific heat that is independent of magnetic field combined with a constant adiabatic temperature change with magnetization. If the specific heat of the material is used to calculate the entropy curves for zero field and a high magnetic field, the two will be equal because the specific heat is constant. This means that the entropy change with magnetization, and therefore adiabatic temperature change, is zero, which contradicts the assumption of a constant non-zero adiabatic temperature change. Using a material with constant specific heat with an assumed adiabatic temperature change will result in an over prediction of cooling power, and a cycle that does not obey the 2nd law of thermodynamics.

2.14. Flow conditions

A periodic fluid flow is present in all numerical AMR models. It is of great importance to implement the fluid flow correctly and several approaches for this have been made. Two main considerations should be done carefully.

- The assumptions about the actual flow include whether the flow is laminar, incompressible, fully developed, temperature dependent etc.
- The representations of the change in input velocity can be a discrete

1
2
3
4
5
6
7
8
9 step function, following a sinusoidal curve or whichever profile an ex-
10 perimental AMR device uses.
11

12
13
14 In models where the flow is transversally resolved (in one or two dimensions
15 perpendicular to the flow direction) a flow-profile is needed. If the geometry
16 is simple the profile may be derived analytically as is the case for models of
17 parallel plate regenerators (Nielsen et al., 2009a) or in more advanced cases a
18 numerical solution to the Navier-Stokes equation for the fluid velocity profile
19 may be needed (Bouchard et al., 2009).
20
21
22
23
24

25 The determination of the mean fluid velocity is usually done through a
26 fixed mass flow rate or similar; however, the temporal change of the mean
27 fluid velocity is implemented differently. Some authors assume a discrete
28 velocity profile as a function of time such that the flow is either on or off
29 (Li et al., 2006; Allab et al., 2005; Siddikov et al., 2005; Aprea et al., 2009;
30 Petersen et al., 2008a; Nielsen et al., 2009a), perhaps through a ramping
31 method (Petersen et al., 2008b; Nielsen et al., 2009a) and some models as-
32 sume a more realistic continuous flow curve as a function of time (Dikeos
33 et al., 2006; Nielsen et al., 2009a; Engelbrecht, 2008; Oliveira et al., 2009). It
34 was argued in Nielsen et al. (2010) that for the general purpose of theoretical
35 evaluation of the AMR performance discrete velocity profiles may be the best
36 option since it removes the possible impact of specific experimental devices.
37 In Nielsen et al. (2009a) and Nielsen et al. (2010) it was argued that when
38 modeling experimental devices it is of great importance to actually make the
39 flow profile in the numerical model resemble that of the experiment, which
40 may seem obvious but is not necessarily always how models are implemented.
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

1
2
3
4
5
6
7
8
9 *2.15. Channeling effects*

10
11 Flow channelling is caused by a non uniform porosity distribution in the
12 transverse bed direction. For a packed particle bed the porosity at the wall
13 is typically greater than the porosity at the center position of the regener-
14 ator. As a consequence, the pore velocity near the wall will be larger than
15 the center velocity due to the lower pressure drop close to the wall (Kaviany,
16 1995; Achenbach, 1995). Flow channelling will result in cold or hot bypasses
17 that will lower the effectiveness of the regenerator (Chang & Chen, 1998).
18 The amount of flow channeling depends greatly on the ratio of regenerator
19 diameter, d_r , to particle diameter, d_p . The flow channeling becomes more
20 important with decreasing ratio d_r/d_p (Nemec & Levec, 2005). In order to
21 resolve the radial velocity distribution the volume averaged transport equa-
22 tions for the momentum transport may be used (Hsu, 2005).
23
24
25
26
27
28
29
30
31
32
33
34

$$35 \quad \epsilon(r) \frac{dp}{dz} = \mu \left(\frac{d^2 u_z}{dr^2} + \frac{1}{r} \frac{du_z}{dr} \right) - \frac{\mu u_z}{K(r)} - F \rho \frac{|u_z| u_z}{\sqrt{K(r)}} \quad (18)$$

36
37
38
39 Here u_z is understood as the superficial velocity, i.e. the velocity the flow
40 would have if the bed was empty, in the axial direction. The permeability for
41 a particle bed is $K = \epsilon^3 d_p^2 / (a(1-\epsilon)^2)$ and the Forchheimer factor $F = b / \sqrt{a\epsilon^3}$
42 with $a = 150$, $b = 1.75$ and ϵ being the porosity. In this sense the regenerator
43 is understood as a continuum described by a radial porosity distribution. An
44 extensive review on porosity distributions for packed beds can be found in
45 du Toit (2008). They strongly recommend the use of the following correlation
46 for the porosity
47
48
49
50
51
52
53

$$54 \quad \epsilon(r) = \epsilon_\infty + (1 - \epsilon_\infty) \exp \left[-\frac{N}{d_p} r \right] \quad (19)$$

1
2
3
4
5
6
7
8
9 with $N = 6000$ and $\epsilon_\infty = V_f/(V_f + V_s)$ being the bulk porosity. Equation
10 (18) can be solved with standard solvers in, e.g., Matlab using the boundary
11 conditions $dv_z(r = 0)/dr = 0$ and $v_z(r = R) = 0$. The pressure gradient is
12 assumed to be constant (i.e. obtained from experiments).
13
14

15 16 17 FIGURE 5

18
19 Figure A.5 shows the radial velocity profile close to the wall. A significant
20 departure of the radial velocity adjacent to the wall from the center velocity
21 is observable. There are two ways to resolve flow channeling in an actual
22 model for a magnetic refrigerator device: resolve the regenerator on a 2D
23 computational domain or account for a modified pressure drop and heat
24 transfer correlation that takes flow channeling (and therewith the ratio d_r/d_p)
25 into account (Achenbach, 1995). So far the channeling effect has not been
26 studied in detail in terms of its impact on the AMR cycle. This may certainly
27 pose a significant issue to address.
28
29
30
31
32
33
34
35

36 37 *2.16. Modeling of graded AMRs*

38
39 It has been experimentally shown that grading the regenerator along the
40 flow direction with a range of MCMs each with a different Curie temperature
41 increases the AMR performance (Rowe & Tura, 2006). This is an area of the
42 magnetic refrigeration research where numerical models may prove to have
43 the most significant impact. The optimal performance of the AMR as a func-
44 tion of multiple MCMs, i.e. through a variation of the Curie temperatures of
45 each material, the number of materials and perhaps even the amount of each
46 material, pose a very large problem due to the many free parameters. In this
47 area only a few models have been applied (Jacobs, 2009; Engelbrecht et al.,
48 2007b; Nielsen et al., 2009b) and further work to understand the grading
49
50
51
52
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9 effect is urgently needed. Layered regenerators are generally modeled by as-
10 signing solid material properties as a function of position in the regenerator.
11 Several problems arise when considering the modeling of graded regenera-
12 tors. Apart from the vast parameter space, magnetocaloric data for each of
13 the individual materials may not yet be available to such a degree that it is
14 usable for this kind of modeling. Also, the interface between each material
15 should be considered. This could demand spatially varying thermal conduc-
16 tivity, mass density etc. It is noted that knowledge of whether the amount
17 of each individual MCM should be the same for optimal performance of the
18 AMR or if it could be beneficial to have an asymmetrical distribution of the
19 materials. The definition of the problem inherently also includes the intended
20 application. Figure A.6 shows a schematic of the concept of layering an AMR
21 bed.
22
23
24
25
26
27
28
29
30
31
32
33

34 FIGURE 6

35 36 37 *2.17. Implementing the effect of demagnetization*

38
39 It is well-known that the internal magnetic field of a magnetic material
40 in a homogeneously applied magnetic field can be highly inhomogeneous,
41 an effect known as geometric demagnetization (Bouchard et al., 2005, 2009;
42 Smith et al., 2010; Joseph & Schloemann, 1965; Brug & Wolf, 1985; Peksoy &
43 Rowe, 2005). In fact, the internal magnetic field may be reduced to as little
44 as a few percent of the applied field dependent on the temperature of the
45 sample, the sample's geometry, and direction and magnitude of the applied
46 magnetic field (Smith et al., 2010). This effect may be understood through
47 the demagnetizing field, which is generally dependent on the geometry of
48 the magnetic material and the orientation of the applied magnetic field as
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

well as the spatially non-constant magnetization, which is a function of both the internal magnetic field and temperature in turn. This emphasizes the highly non-linear nature of the demagnetization problem and it is basically impossible to simplify it into e.g. an extra source term in the energy equation of the solid. A fully coupled numerical model for calculating the internal magnetic field is thus needed and should be solved simultaneously with the heat transfer model.

It is emphasized that the MCE, whether expressed as the isothermal entropy change or the adiabatic temperature change, should be considered as a function of the internal magnetic field. Of course, measurements may be reported as a function of applied magnetic field, but in order to compare materials properties of different materials between different experimental setups the internal magnetic field is the proper independent variable (and, of course, so is also the temperature).

So far only a few published numerical AMR models have included this effect (Bouchard et al., 2005, 2009; Nielsen et al., 2010; Peksoy & Rowe, 2005). In Bouchard et al. (2005, 2009) the effect of demagnetization was included as an extra coupled equation to be solved together with the thermal equations. However, the results were not discussed in detail in terms of the impact of this on the AMR cycle. It was shown, however, that the adiabatic temperature change may be considerably affected when accounting for demagnetization (Bouchard et al., 2005), which is consistent with the recent results from Christensen et al. (2010) and Bahl & Nielsen (2009).

In Peksoy & Rowe (2005) the demagnetization was investigated for a symmetric regenerator setup and the resulting magnetization showed as a

1
2
3
4
5
6
7
8
9 function of position in the regenerator under various conditions. The results
10 showed that care should indeed be taken when deciding how to align the
11 applied magnetic field with respect to the regenerator material when consid-
12 ering thermal gradients in the system etc.
13
14

15
16 In other extreme cases, such as described in Bahl & Nielsen (2009), the
17 effect may be significant. An example of the resulting internal magnetic field
18 is shown in Fig. A.7. It is apparent that there is a vast difference between the
19 resulting internal magnetic field dependent on the orientation of the applied
20 magnetic field and the temperature of the MCM. The more ferromagnetic
21 the material is the more significant the effect is. In the case of applying the
22 field perpendicular to the largest surface of the plate (Fig. A.7b) the internal
23 field may be decreased with up to 80 percent for the cases considered here.
24
25
26
27
28
29
30
31

32 FIGURE 7
33

34 35 *2.18. Hysteresis effect in AMR modeling* 36

37 In literature it is often argued that with a 1st order magnetic transition
38 MCMs are among the most promising candidates as refrigerants in an AMR
39 device due to their large MCE. However, at least three very important aspects
40 of this assumption have not yet to our knowledge been investigated in detail.
41 Firstly, the MCE is usually confined to a quite narrow temperature interval
42 for 1st order materials compared to 2nd order materials. Secondly, the specific
43 heat usually has a high but narrow peak around the Curie temperature and
44 the peak temperature changes as a function of magnetic field (e.g. Palacios
45 et al. (2010)). Thirdly, the inherent hysteretic effects present in most 1st
46 order materials (e.g. Pecharsky & Gschneidner (2006) and Tocado et al.
47 (2009)) have not yet been considered in any published AMR model.
48
49
50
51
52
53
54
55
56
57
58

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

In Basso et al. (2005, 2006) the fundamentals of hysteresis were considered for magnetic materials and to some extent that analysis covered initial steps to evaluate the impact on the AMR cycle. In Kitanovski & Egolf (2009) the hysteretic losses were implemented as a scalar quantity expressing a degradation of the efficiency of an AMR device. However, this efficiency was estimated and not found through a rigorous analysis. At present the hysteresis effect has not been implemented in any AMR model. Generally, an analysis of the impact of the special behavior of the magnetocaloric properties of 1st order materials should certainly be performed. The operating frequency of the AMR cycle may be limited by e.g. the inherently slower 1st order transition (Gschneidner et al., 2005). See Kuz'min (2007) for other examples of limiting factors to the AMR frequency.

3. Conclusion

A large range of numerical AMR models were discussed. The individual components of a general AMR model were described in detail and their impacts were discussed. The rank, or dimensionality, of the individual AMR models ranges from 1D to 3D. Most models published are 1D of nature and thus include a heat transfer correlation to describe the heat transfer between the solid regenerator matrix and the heat transfer fluid. It was also argued, on the other hand, that 2- or 3D models are difficult to realistically implement to model complex structures different from e.g. parallel plates, even though a first attempt of full 3D-modeling of a particle bed has been published. It is therefore concluded that each kind of model is relevant to consider and that the requirements of the particular case modeled should be carefully analyzed

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

when choosing which kind of model to use.

The various components of an AMR model, such as the implementation of the MCE, flow profiles etc., were discussed in detail. It may generally be concluded that it is important to ensure that the 2nd law of thermodynamics is not violated. Furthermore, each component should be implemented as detailed as possible, which includes the use of proper experimental data, consideration of the resulting internal magnetic field, proper applied magnetic field and flow profiles in accordance with any experiment modeled etc. It should be stressed, however, that simpler models are usually much easier to interpret and, especially, to ensure to be numerically well-behaved. It may therefore be recommended to use a simple model to try to identify the most important physical processes of a given geometry and configuration, and to build on that to implement more sophisticated models.

The modeling of AMR cannot be said to be sufficient as is. Several very interesting physical aspects have not been considered yet, at least not in detail. The hysteresis inherent in most 1st order materials should be the topic of detailed future investigations as should the special specific heat curves that such materials exhibit. The effect of demagnetization on the performance of the AMR should also be the topic of detailed future investigations.

Appendix A. Summary of published AMR models

TABLE A.1

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

Acknowledgements

K.K. Nielsen, K. Engelbrecht, C.R.H. Bahl, A. Smith and N. Pryds thank the support of the Programme Commission on Energy and Environment (EnMi) (Contract no. 2104-06-0032) which is part of the Danish Council for Strategic Research. K. K. Nielsen also thanks the Danish Agency for Science, Technology and Innovation under the Danish Ministry for Science, Technology and Innovation.

References

References

Achenbach, E. (1995). Heat and flow characteristics of packed beds. *Experimental Thermal and Fluid Science*, 10(1):17–27.

Allab, F., Kedous-Lebouc, A., Fournier, J., and Yonnet, J. (2005). Numerical modeling for active magnetic regenerative refrigeration. *IEEE Transactions on Magnetics*, 41(10):3757–3759.

Apra, C., Greco, A., and Maiorino, A. (2009). A numerical analysis of an active magnetic regenerative cascade system. In Egolf, P. W., editor, *Third International Conference on Magnetic Refrigeration at Room Temperature*, pages 259–265. International Institute of Refrigeration.

Bahl, C. R. H. and Nielsen, K. K. (2009). The effect of demagnetization on the magnetocaloric properties of gadolinium. *Journal of Applied Physics*, 105(1):013916 (5 pp.).

- 1
2
3
4
5
6
7
8
9 Bahl, C. R. H., Petersen, T. F., Pryds, N., and Smith, A. (2008). A versa-
10 tile magnetic refrigeration test device. *Review of Scientific Instruments*,
11 79(9):093906.
12
13
14
15 Barclay, J. A. (1983). Theory of an active magnetic regenerative refrigerator.
16 *NASA Conference Publication*, pages 375–387.
17
18
19
20 Basso, V., Bertotti, G., LoBue, M., and Sasso, C. (2005). Theoretical ap-
21 proach to the magnetocaloric effect with hysteresis. *Journal of Magnetism*
22 *and Magnetic Materials*, 290-291(Part 1):654–657.
23
24
25
26 Basso, V., Sasso, C. P., Bertotti, G., and LoBue, M. (2006). Effect of ma-
27 terial hysteresis in magnetic refrigeration cycles. *International Journal of*
28 *Refrigeration*, 29(8):1358–1365.
29
30
31
32
33 Bjørk, R. and Engelbrecht, K. (2011). The influence of the magnetic field on
34 the performance of an active magnetic regenerator (AMR). *International*
35 *Journal of Refrigeration*, 34:192–203.
36
37
38
39 Bouchard, J., Nesreddine, H., and Chahine, R. (2005). Impact of demag-
40 netization on magnetocaloric effect in pure gadolinium. *1st International*
41 *Conference on Magnetic Refrigeration at Room Temperature*, pages 93–
42 101.
43
44
45
46
47
48 Bouchard, J., Nesreddine, H., and Galanis, N. (2009). Model of a porous
49 regenerator used for magnetic refrigeration at room temperature. *Interna-*
50 *tional Journal of Heat and Mass Transfer*, 52(5-6):1223–1229.
51
52
53
54 Brug, J. and Wolf, W. (1985). Demagnetizing fields in magnetic measure-
55 ments i. thin discs. *Journal of Applied Physics*, 57(10):4685–4694.
56
57
58

- 1
2
3
4
5
6
7
8
9 Chang, Z.-C. and Chen, P.-H. (1998). Flow channeling effect on a regenera-
10 tor's thermal performance. *Cryogenics*, 38(2):191–196.
11
12
13
14 Christensen, D. V., Bjørk, R., Nielsen, K. K., Bahl, C. R. H., Smith, A., and
15 Clausen, S. (2010). Spatially resolved measurements of the magnetocaloric
16 effect and the local magnetic field using thermography. *Journal of Applied*
17 *Physics*, 108(6):063913.
18
19
20
21
22 DeGregoria, A. (1991). Modeling the active magnetic regenerator. *Advances*
23 *in Cryogenic Engineering*, 37(pt B):867–873.
24
25
26
27 DeGregoria, A. J., Barclay, J. A., Claybaker, P. J., Jaeger, S. R., Kral, S. F.,
28 Pax, R. A., Rowe, R., and Zimm, C. B. (1990). Preliminary design of a 100
29 w 1.8 k to 4.7 k regenerative magnetic refrigerator. *Advances in Cryogenic*
30 *Engineering*, 35:1125–1131.
31
32
33
34
35
36 Dikeos, J., Rowe, A., and Tura, A. (2006). Numerical Analysis of an Ac-
37 tive Magnetic Regenerator (AMR) Refrigeration Cycle. *AIP Conference*
38 *Proceedings*, 823(1):993 – 1000.
39
40
41
42 Dragutinovic, G. D. and Baclic, B. S. (1998). *Operation of Counterflow*
43 *Regenerators*. Computational Mechanics Inc., Billerica, MA.
44
45
46
47 du Toit, C. (2008). Radial variation in porosity in annular packed beds.
48 *Nuclear Engineering and Design*, 238(11):3073–3079.
49
50
51
52 Engelbrecht, K. (2008). *A Numerical Model of an Active Magnetic Regen-*
53 *erator Refrigerator with Experimental Validation*. PhD thesis, University of
54 Wisconsin, Madison.
55
56
57
58

- 1
2
3
4
5
6
7
8
9 Engelbrecht, K., Nellis, G. F., and Klein, S. A. (2007a). Comparing modeling
10 predictions to experimental data for active magnetic regenerative refrig-
11 eraton systems. In Egolf, P. W., editor, *Second International Conference*
12 *on Magnetic Refrigeration at Room Temperature*, pages 349–357. Interna-
13 tional Institute of Refrigeration.
14
15
16
17
18
19 Engelbrecht, K. L., Nellis, G. F., and Klein, S. A. (2006). The effect of in-
20 ternal temperature gradients on regenerator matrix performance. *Journal*
21 *of Heat Transfer*, 128(10):1060–1069.
22
23
24
25
26 Engelbrecht, K. L., Nellis, G. F., Klein, S. A., and Zimm, C. H. (2007b).
27 Review article: Recent developments in room temperature active magnetic
28 regenerative refrigeration. *HVAC and R Research*, 13(4):525.
29
30
31
32
33 Frischmann, M., Jacobs, S., Nellis, G., and Klein, S. (2009). Measuring
34 nusselt number using a single-blow regenerator facility. In Egolf, P. W.,
35 editor, *Third International Conference on Magnetic Refrigeration at Room*,
36 pages 443–448. International Institute of Refrigeration.
37
38
39
40
41 Gschneidner, K A, J., Pecharsky, V. K., and Tsokol, A. O. (2005). Recent
42 developments in magnetocaloric materials. *Reports on Progress in Physics*,
43 68(6):1479–1539.
44
45
46
47
48 Gschneidner, K. and Pecharsky, V. (2008). Thirty years of near room tem-
49 perature magnetic cooling: Where we are today and future prospects.
50 *International Journal of Refrigeration*, 31:945–961.
51
52
53
54 Hadley, G. R. (1986). Thermal conductivity of packed metal powders. *In-*
55 *ternational Journal of Heat and Mass Transfer*, 29(6):909–919.
56
57
58

- 1
2
3
4
5
6
7
8
9 Hausen, H. (1983). *Heat Transfer in Counterflow, Parallel-Flow and Cross-*
10 *flow*. McGraw-Hill Co.
11
12
13
14 He, J., Chen, J., and Wu, C. (2003). The influence of heat-transfer laws on
15 the performance of a magnetic stirling refrigeration cycle. *International*
16 *Journal of Ambient Energy*, 24(2):75–82.
17
18
19
20 Hooijkaas, H. W. G. and Benschop, A. A. J. (1999). Pulse tube development
21 using harmonic. In Ross, R. G., editor, *Simulations, Proc. 10th Int. Cry-*
22 *ocooler Conf.*, pages 359–367, New York , NY. Kluwer Academic/Plenum
23 Publishers.
24
25
26
27
28 Hsu, C. H. (2005). *Dynamic Modeling of Convective Heat Transfer in Porous*
29 *Media*. Taylor&Francis, New York.
30
31
32
33
34 Hu, J. and Xiao, J. (1995). New method for analysis of active magnetic
35 regenerator in magnetic refrigeration at room temperature. *Cryogenics*,
36 35:10–104.
37
38
39
40 Jacobs, S. (2009). Modeling and optimal design of a multiplayer active mag-
41 netic refrigeration system. In Egolf, P. W., editor, *Third International*
42 *Conference on Magnetic Refrigeration at Room Temperature*. International
43 Institute of Refrigeration.
44
45
46
47
48 Jacobsson, P. and Sundqvist, B. (1989). Thermal conductivity and electrical
49 resistivity of gadolinium as functions of pressure and temperature. *Physical*
50 *Review B*, 40(14):9541–9551.
51
52
53
54
55 Janda, D., DeGregoria, A. J., Johnson, J., and Kral, S. (1989). Design of
56
57
58

1
2
3
4
5
6
7
8
9 an active magnetic regenerative hydrogen liquefier. *Advances in Cryogenic*
10 *Engineering*, 37:891–898.

11
12
13
14 Jeffreson, C. P. (1972). Prediction of breakthrough curves in packed beds.
15 *American Institute of Chemical Engineers*, 18(2):409–20.

16
17
18
19 Johnson, J. W. and Zimm, C. B. (1996). Performance modeling of a 4 k active
20 magnetic regenerative refrigerator. *Journal of Applied Physics*, 79:2171–
21 2175.

22
23
24
25 Joseph, R. and Schloemann, E. (1965). Demagnetizing field in nonellipsoidal
26 bodies. *Journal of Applied Physics*, 36(5):1579–1593.

27
28
29
30 Kaviany, M. (1995). *Principles of Heat Transfer in Porous Media*. Springer,
31 New York, 2nd edition.

32
33
34
35 Kawanami, T., Chiba, K., Sakurai, K., and Ikegawa, M. (2006). Optimization
36 of a magnetic refrigerator at room temperature for air cooling systems.
37 *International Journal of Refrigeration*, 29(8):1294–1301.

38
39
40
41 Kirol, L. D. and Mills, J. I. (1984). Numerical analysis of thermomagnetic
42 generators. *Journal of Applied Physics*, 56(3):824–828.

43
44
45
46 Kitanovski, A. and Egolf, P. (2009). Application of magnetic refrigera-
47 tion and its assessment. *Journal of Magnetism and Magnetic Materials*,
48 321(7):777–781.

49
50
51
52 Kitanovski, A., Egolf, P. W., Gendre, F., Sari, O., and Besson, C. (2005). A
53 rotary heat exchanger magnetic refrigerator. In Egolf, P. W., editor, *First*
54 *International Conference on Magnetic Refrigeration at Room Temperature*,

1
2
3
4
5
6
7
8
9 *International Institute of Refrigeration*, pages 297–307. International In-
10 stitute of Refrigeration.
11

12
13 Kuz'min, M. D. (2007). Factors limiting the operation frequency of magnetic
14 refrigerators. *Applied Physics Letters*, 90:251916 (3pp).
15
16

17
18 Legait, I., Kedous-Lebouc, A., and Rondot, L. (2009). Numerical simulation
19 and analysis of the refrigerant bed behavior using fluent software. In Egolf,
20 P. W., editor, *Third International Conference on Magnetic Refrigeration at*
21 *Room Temperature*, pages 295–302. International Institute of Refrigeration.
22
23
24

25
26 Li, P., Gong, M., Yao, G., and Wu, J. (2006). A practical model for analysis
27 of active magnetic regenerative refrigerators for room temperature appli-
28 cations. *International Journal of Refrigeration*, 29:1259–1266.
29
30
31

32
33 Liu, M. and Yu, B. (2010). Numerical investigations on internal temper-
34 ature distribution and refrigeration performance of reciprocating active
35 magnetic regenerator of room temperature magnetic refrigeration. *Inter-*
36 *national Journal of Refrigeration*, Accepted.
37
38
39

40
41 Morrish, A. H. (1965). *The Physical Principles of Magnetism*. John Wiley &
42 Sons, Inc.
43
44

45
46 Nemec, D. and Levec, J. (2005). Flow through packed bed reactors: 1.
47 single-phase flow. *Chemical Engineering Science*, 60(24):6947–6957.
48
49

50
51 Nielsen, K. K., Bahl, C. R. H., Smith, A., Bjørk, R., Pryds, N., and Hattel,
52 J. (2009a). Detailed numerical modeling of a linear parallel-plate active
53 magnetic regenerator. *International Journal of Refrigeration*, 32(6):1478–
54 1486.
55
56
57

- 1
2
3
4
5
6
7
8
9 Nielsen, K. K., Bahl, C. R. H., Smith, A., Pryds, N., and Hattel, J. (2010). A
10 comprehensive parameter study of an active magnetic regenerator using a
11 2d numerical model. *International Journal of Refrigeration*, 33(4):753–764.
12
13
14
15 Nielsen, K. K., Engelbrecht, K., Bahl, C. R. H., Smith, A., Pryds, N., and
16 Hattel, J. (2009b). Numerical modeling of multi-material active magnetic
17 regeneration. In *7th World Conference on Experimental Heat Transfer,*
18 *Fluid Mechanics and Thermodynamics.*
19
20
21
22
23
24 Nielsen, K. K., Pryds, N., Smith, A., Bahl, C. R. H., and Hattel, J. (2009c). 2-
25 dimensional numerical modeling of active magnetic regeneration. In Egolf,
26 P., editor, *Third International Conference on Magnetic Refrigeration at*
27 *Room Temperature*, pages 251–258. International Institute of Refrigeration.
28
29
30
31
32
33 Oliveira, P. A., Trevizoli, P., Jr., J. R. B., and Prata, A. T. (2009). Numerical
34 analysis of a reciprocating active magnetic regenerator - part I. In Egolf,
35 P. W., editor, *Third International Conference on Magnetic Refrigeration at*
36 *Room Temperature*, pages 283–288. International Institute of Refrigeration.
37
38
39
40
41 Palacios, E., Wang, G. F., Burriel, R., Provenzano, V., and Shull,
42 R. D. (2010). Direct measurement of the magnetocaloric effect in
43 $\text{Gd}_5\text{Si}_2\text{Ge}_{1.9}\text{Ga}_{0.1}$. *Journal of Physics: Conference Series*, 200(9):092011.
44
45
46
47
48 Pecharsky, V. K. and Gschneidner, K. (2006). Advanced magnetocaloric ma-
49 terials: What does the future hold? *International Journal of Refrigeration*,
50 29:1239–1249.
51
52
53
54 Peksoy, O. and Rowe, A. (2005). Demagnetizing effects in active magnetic
55 regenerators. *Journal of Magnetism and Magnetic Materials*, 288:424–432.
56
57
58

- 1
2
3
4
5
6
7
8
9 Petersen, T. F., Engelbrecht, K., Bahl, C. R. H., Elmegaard, B., Pryds, N.,
10 and Smith, A. (2008a). Comparison between a 1d and a 2d numerical
11 model of an active magnetic regenerative refrigerator. *Journal of Physics*
12 *D: Applied Physics*, 41(10):105002.
13
14
15
16
17 Petersen, T. F., Pryds, N., Smith, A., Hattel, J., Schmidt, H., and Knud-
18 sen, H. (2008b). Two-dimensional mathematical model of a reciprocating
19 room-temperature active magnetic regenerator. *International Journal of*
20 *Refrigeration*, 31:432–443.
21
22
23
24
25
26 Risser, M., Vasile, C., Engel, T., Keith, B., and Muller, C. (2010). Numerical
27 simulation of magnetocaloric system behavior for an industrial application.
28 *International Journal of Refrigeration*, 33(5):973–981.
29
30
31
32
33 Rowe, A. and Barclay, J. (2003). Ideal magnetocaloric effect for active mag-
34 netic regenerators. *Journal of Applied Physics*, 93(3):1672–1676.
35
36
37
38 Rowe, A. and Tura, A. (2006). Experimental investigation of a three-material
39 layered active magnetic regenerator. *International Journal of Refrigera-*
40 *tion*, 29:1286–1293.
41
42
43
44 Sarlah, A. (2008). *Thermohydraulic properties of heat regenerators in mag-*
45 *netic refrigerators*. PhD thesis, University of Ljubljana, Slovenia.
46
47
48
49 Sarlah, A. and Poredos, A. (2005). Regenerator for magnetic cooling in shape
50 of honeycomb. In Egolf, P. W., editor, *First International Conference on*
51 *Magnetic Refrigeration at Room Temperature*, International Institute of
52 *Refrigeration*, pages 283–290. International Institute of Refrigeration.
53
54
55
56
57
58

- 1
2
3
4
5
6
7
8
9 Sarlah, A. and Poredos, A. (2010). Dimensionless numerical model for sim-
10 ulation of active magnetic regenerator refrigerator. *International Journal*
11 *of Refrigeration*, 33 (6):1061–1067.
12
13
14
15 Shah, R. K. and Sekulic, D. P. (2003). *Fundamentals of Heat Exchanger*
16 *Design*. John Wiley & Sons, Inc., Hoboken, New Jersey.
17
18
19
20 Shir, F., Della Torre, E., Bennett, L. H., Della Torre, E., Bennett, L. H.,
21 Shull, R. D., and Mavriplis, C. (2004). Modeling of magnetization and de-
22 magnetization in magnetic regenerative refrigeration. *IEEE Transactions*
23 *on Magnetics*, 40(4):2098–2100.
24
25
26
27
28 Shir, F., Yanik, L., Bennet, L. H., Torre, E. D., and Shull, R. D. (2003).
29 Room temperature active regenerative magnetic refrigeration: Magnetic
30 nanocomposites. *Journal of Applied Physics*, 93(10):8295–8297.
31
32
33
34
35 Siddikov, B., Wade, B., and Schultz, D. (2005). Numerical simulation of the
36 active magnetic regenerator. *Computers and Mathematics with Applica-*
37 *tions*, 49:1525–1538.
38
39
40
41 Smailli, A. and Chahine, R. (1998). Thermodynamic investigations of opti-
42 mum active magnetic regenerators. *Cryogenics*, 38:247–252.
43
44
45
46 Smith, A., Nielsen, K. K., Christensen, D. V., Bahl, C. R. H., Bjørk, R., and
47 Hattel, J. (2010). The demagnetizing field of a nonuniform rectangular
48 prism. *Journal of Applied Physics*, 107(10):103910.
49
50
51
52 Tagliafico, G., Scarpa, F., and Canepa, F. (2010). A dynamic 1-d model for
53 a reciprocating active magnetic regenerator; influence of the main working
54 parameters. *International Journal of Refrigeration*, 33(2):286–293.
55
56
57
58

- 1
2
3
4
5
6
7
8
9 Tocado, L., Palacios, E., and Burriel, R. (2009). Entropy determinations and
10 magnetocaloric parameters in systems with first-order transitions: Study
11 of MnAs. *Journal of Applied Physics*, 105(9):093918.
12
13
14
15 Tusek, J., Sarla, A., Zupan, S., Prebil, I., Kitanovski, A., and Poredos,
16 A. (2010a). A numerical optimization of a packed bed AMR. In Egolf,
17 P. W., editor, *Fourth International Conference on Magnetic Refrigeration*
18 *at Room Temperature*. International Institute of Refrigeration.
19
20
21
22
23 Tusek, J., Zupan, S., Sarlah, A., Prebil, I., and Poredos, A. (2010b). Devel-
24 opment of a rotary magnetic refrigerator. *International Journal of Refrig-*
25 *eration*, 33(2):294–300.
26
27
28
29
30 Willmott, A. J. (1964). Digital computer simulation of a thermal regenerator.
31 *International Journal of Heat and Mass Transfer*, 7(11):1291–1302.
32
33
34
35 Yan, Z. and Chen, J. (1991). The characteristics of polytropic magnetic
36 refrigeration cycles. *Journal of Applied Physics*, 70(4):1911–1914.
37
38
39 Yan, Z. and Chen, J. (1992). The effect of field-dependent heat capacity
40 on the characteristics of the ferromagnetic Ericsson refrigeration cycle.
41 *Journal of Applied Physics*, 72(1):1–5.
42
43
44
45
46 Yu, B., Gao, Q., Zhang, B., Meng, X., and Chen, Z. (2003). Review on
47 research of room temperature magnetic refrigeration. *International Journal*
48 *of Refrigeration*, 26:622–636.
49
50
51
52 Yu, B., Liu, M., Egolf, P. W., and Kitanovski, A. (2010). A review of
53 magnetic refrigerator and heat pump prototypes built before the year 2010.
54 *International Journal of Refrigeration*, 33(6):1029–1060.
55
56
57
58

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

Zhang, L., Sherif, S. A., DeGregoria, A. J., Zimm, C. B., and Veziroglu, T. N. (2000). Design and optimization of a 0.1 ton/day active magnetic regenerative hydrogen liquifier. *Cryogenics*, 40:269–278.

Zhang, L., Sherif, S. A., Veziroglu, T. N., and Sheffield, J. W. (1993). Second law analysis of active magnetic regenerative hydrogen liquefier. *Cryogenics*, 33(7):667–674.

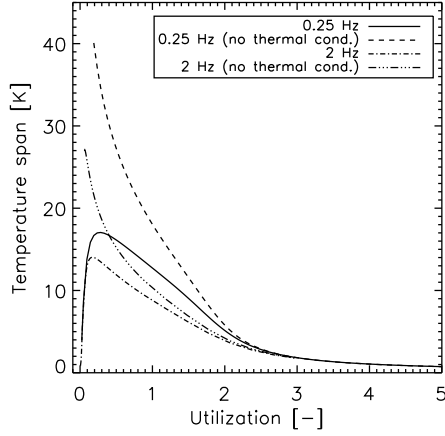


Figure A.1: The impact of the longitudinal thermal conduction on the predicted temperature span of the AMR at two different operating frequencies. The operating conditions in this case were an ambient temperature of 293 K and a regenerator of packed spheres with a diameter of 1 mm. The model is published in Tusek et al. (2010a).

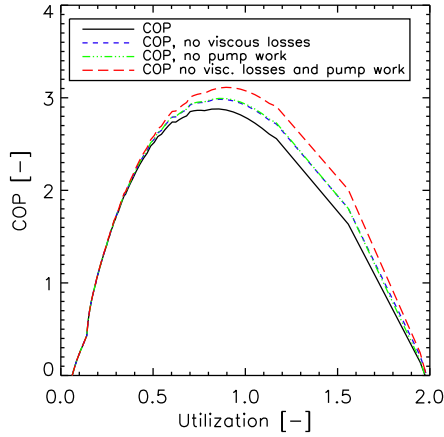


Figure A.2: The impact of the viscous losses on the COP of a packed spheres-based AMR. The model configuration was the same as that used for the results in Fig. A.1. The hot and cold side temperatures were set to 296 and 290 K, respectively.

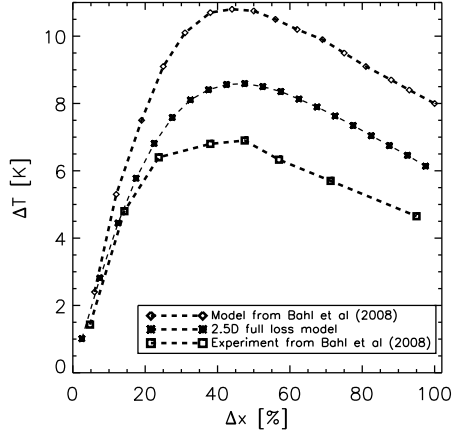


Figure A.3: Example of the impact of including the parasitic thermal losses. The two curves denoted “Model from Bahl et al. (2008)” and “Experiment from Bahl et al. (2008)” are based on data published in Bahl et al. (2008). The curve denoted “2.5D full loss model” is the model published in Nielsen et al. (2009a) with the parasitic losses enabled. The abscissa shows the fluid movement as a percentage of the total length of the regenerator and the ordinate shows the zero heat load temperature span of the regenerator. The figure is reproduced from Nielsen et al. (2009a).

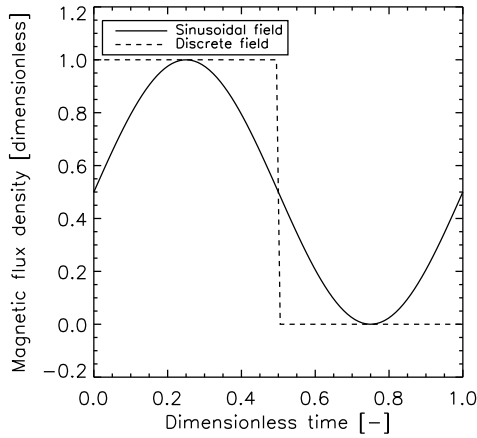


Figure A.4: Example of discrete on-off and continuous changing magnetic fields.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

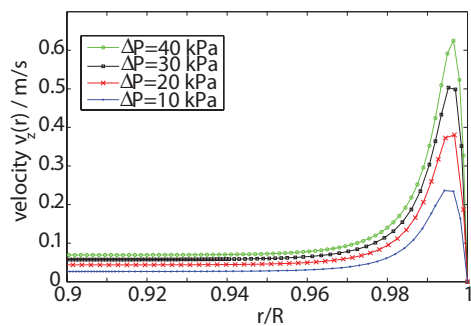


Figure A.5: Radial velocity distribution with $d_r = 3\text{cm}$, $d_p = 1\text{mm}$, $d_r/d_p = 30$, regenerator length $L = 7\text{cm}$

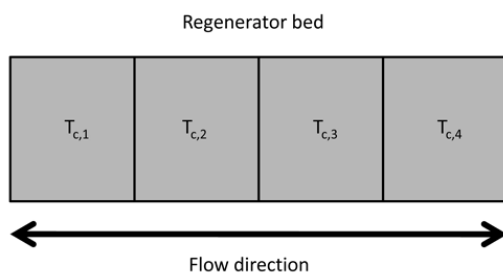


Figure A.6: Schematic of a layered regenerator. This case shows four different MCMs each with a specific Curie temperature denoted on the drawing. It is as yet not fully understood whether the optimum is an equal amount of each material, as shown here, or if the distribution of the materials should be asymmetric.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

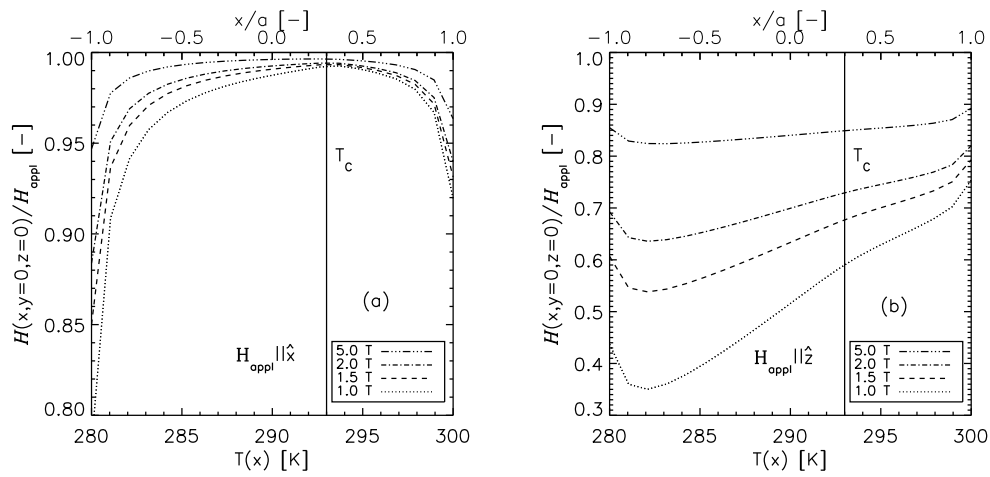


Figure A.7: Example of the internal magnetic field in a single-material magnetocaloric flat plate. A linear temperature profile is imposed from the cold end (280 K) to the hot end (300 K) and the internal magnetic field is calculated using the model from Smith et al. (2010). Left: the applied field is along the x -direction, i.e. the direction of the flow. Right: the applied field is along the z -direction, which is perpendicular to the flat plate. Four different applied fields are considered and the resulting internal magnetic field is plotted along the x -direction normalized to the applied field. The material used is Gd with a Curie temperature of 293 K (indicated on the figures). Reproduced from Smith et al. (2010).

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

Table A.1: The boundary conditions during AMR operation.

Period	Cold side	Hot side
Hot blow	$T_f = T_{\text{cold}}$	$\partial T_f / \partial x = 0$
Cold blow	$\partial T_f / \partial x = 0$	$T_f = T_{\text{hot}}$

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

Table A.2: Summary of the numerical AMR models published to date. The columns represent the following. The reference to the paper is given in Ref. The type of heat transfer fluid in HTF. Flow profile in F. prof. Flow properties in F. prop. Magnetic field profile in Mag. prof. Method for implementing the magnetocaloric effect in MCE. The rank or dimensionality in Rank. Whether the demagnetizing field is implemented in Dem. The functional dependency of the specific heat in c . Whether axial conduction is included in the model in Ax. cond. Whether thermal conduction is included in the solid in Sol. ther. cond. Whether the pressure drop / viscous losses is included in the model in Pres. drop. And finally, whether thermal dispersion is included in Ther. disp.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42
43
44
45
46
47
48
49
50
51
52
53
54
55
56
57
58
59
60
61
62
63
64
65

Ref.	HTF	F. prof.	F. prop.	Mag. prof.	MCE	Rank	Dem.	c	Ax. cond.	Sol. ther. cond.	Pres. drop	Ther. disp.
Smailli												
& Chahine (1998)	-	-	Cst.	Discr.	-	1D	No	T, H dep.	No	No	No	No
Shir et al. (2004)	He	Discr.	Cst.	Discr.	Built-in	1D	No	Cst.	No	No	No	No
Siddikov et al. (2005)	-	Discr.	T -dep.	Discr.	Built-in	1D	No	T, H dep.	Yes	Yes	Yes	Yes
Sarlah & Pore-dos (2005)	He	Discr.	Cst.	Time-dep.	Built-in	2D	No	T, H dep.	No	Yes	No	No



Felix Ziegler
Editor,
International Journal of Refrigeration

9 December 2010

Dear Dr. Ziegler,

The attached manuscript "Review on numerical modeling of active magnetic regenerators for room temperature applications", JIJR-D-10-00230 has been revised according to the reviewer's comments. We are most grateful for the comments and we believe they have contributed to improving the manuscript. In the following the changes are outlined in detail. We corrected minor errors in the manuscript and added a few new references as well.

The authors are: Kaspar K. Nielsen^{1,2}, Jaka Tusek³, Kurt Engelbrecht², Sandro Schopfer⁴, Andrej Kitanovski³, Christian Bahl², Anders Smith², Nini Pryds², Alojz Poredos³.

¹Department of Mechanical Engineering, Technical University of Denmark

²Fuel Cells and Solid State Chemistry Division, Risø DTU, Technical University of Denmark

³Faculty of Mechanical Engineering, University of Ljubljana, Slovenia

⁴Energy Systems Group, Department of Mechanical Engineering, University of Victoria, BC, Canada

Best regards,
Kaspar K. Nielsen (on behalf of the authors)

Detailed response to the reviewer's comments.

- *2.1 No statement about the length scale over which eq. (1) holds is made. Clearly this is assumed to hold over the regenerator length scale, i.e. one should clearly distinguish between intrinsic thermal conductivity and effective thermal conductivity (depends on geometrical configuration). Also 2D or 3D models can easily include Nusselt number correlations when the energy balance is treated as continuum that holds over the regenerator length. This requires feasible information of porosity and its gradient.*

These points have been addressed with explicitly stating the validity of the assumed equations and that 2 and 3D models may apply Nu-Re correlations as this is, of course, correct. We have furthermore written that the general heat transfer equation of the solid (Eq. 1) includes the intrinsic heat transfer of the system.

- *2.9 Dispersion is a macroscopic phenomena it arises from volume averaging of NSF equations. Of course this depends on the geometry. But in the first place it depends on the length scale over which the problem is considered. I.e. parallel plates can have high dispersion if the NSF equations are averaged over a repetitive domain.*

The text has been updated accordingly. We do agree with the reviewer and we also believe that our description of the dispersion and longitudinal thermal conduction is sound.

- *Conclusion: Statement "... it is obvious that each component should be implemented as detailed as possible..." is not necessarily true. A fully resolved physics model would be computational intensive and difficult to validate. They have their place; however, simplified models can be informative in that they can be tested and interpreted with ease.*

We do agree and have updated the manuscript accordingly.

- *It's too bad the review doesn't include all AMR modeling (high temp and low temp.) There are some informative papers at lower temperatures.*

Yes, this is true. However, the title does explicitly state "room temperature applications". The length of the manuscript is already considerable and we believe our supposed expertise to be in the realm of room temperature applications.



Felix Ziegler
Editor,
International Journal of Refrigeration

6 July 2010

Dear Dr. Ziegler,

These are our responses to the technical check results for the manuscript "Review on numerical modeling of active magnetic regenerators for room temperature applications".

1) Keywords provided should be selected from the given list
(http://www.elsevier.com/framework_products/promis_misc/30436keywords.pdf).

This has been addressed accordingly; one keyword was not on the list and has thus been removed.

2) Style for the unit should be m/s-1 and not m/s.

This has been changed accordingly

3) Vertical lines should not be used in tables.

These have been removed from the tables.

4) The text layout should be in double line spacing.

This has been changed such the "review" is used in the documentclass rather than "preprint" in complete accordance with the Elsevier tex template.

Best regards,
Kaspar K. Nielsen (on behalf of the authors)