



Combination of energy savings in buildings and renewable energy supply solutions

Svendsen, Svend ; Harrestrup, Maria

Publication date:
2013

[Link back to DTU Orbit](#)

Citation (APA):

Svendsen, S., & Harrestrup, M. (2013). Combination of energy savings in buildings and renewable energy supply solutions. Sound/Visual production (digital)
http://www.natlab.dtu.dk/Energikonferencer/DTU_International_Energy_Conference_2013

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.


- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

Combination of energy savings in buildings and renewable energy supply solutions

Svend Svendsen, DTU Civil Engineering
ss@byg.dtu.dk

Maria Harrestrup, DTU Civil Engineering
marih@byg.dtu.dk

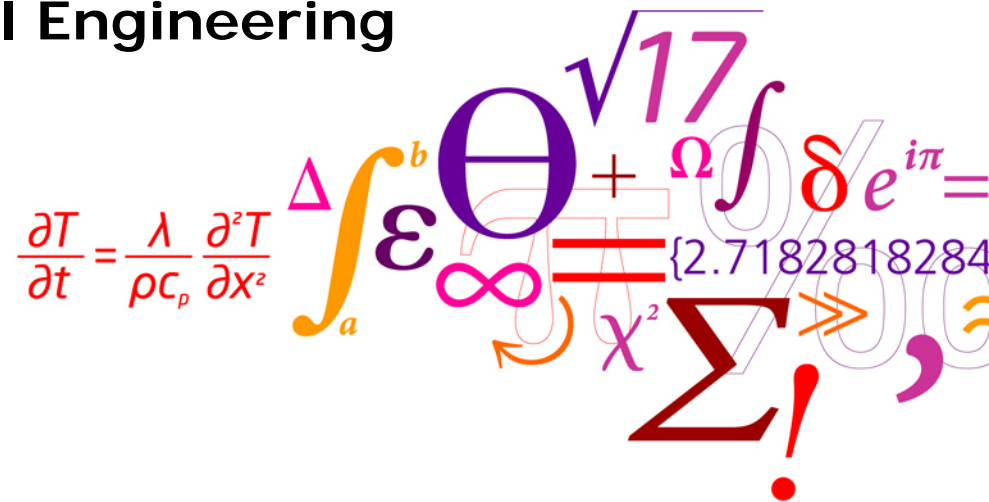

Introduction

Policies on energy and buildings in EU and DK

New buildings:

EPBD recast:

All new buildings in the EU as from December 2020 (2018 for public buildings) will have to be **nearly zero energy buildings**

the *nearly zero or very low amount of energy required* **should to** a very significant level be covered by energy from renewable sources

DK Building Code 2020:

Energy frame of 20-25kWh/m²

Introduction

Policies on energy and buildings in EU and DK

Existing buildings

Danish Energy Plan *

- **All buildings and electricity fossil fuel free by 2035**
- Transport and industry fossil fuel free by 2050

Based on:

- energy savings and
- renewable energy supply
- * [http://www.kemin.dk/Documents/Klima- og_Energipolitik/our future energy.pdf](http://www.kemin.dk/Documents/Klima- og_Energipolitik/our_future_energy.pdf)



Problems of realizing zero fossil energy buildings

Solutions based on:

- Energy savings and no energy supply
- Energy savings and use of 'on site' - renewable energy
- Renewable energy supply and no energy savings

Not possible or more costly than necessary

PS: Net zero energy buildings with renewable energy production from PV to the electrical grid shift the problem from buildings to electrical system
Compensating use of fossil fuels by production of RE does not stop global warming

Optimal solutions

No fossil energy by:

- Energy savings in buildings and
- Supply of renewable energy to buildings

Optimization of:

- Energy savings versus renewable energy supply
- Energy retrofitting or new low energy buildings
- Renewable energy supply on site or from energy system
- Integrated renewable energy system for buildings, transport and industrial processes
- Renewable energy system on global level and on long term

Optimal solutions For zero fossil energy buildings

Low energy buildings and Renewable energy supplying systems:

In areas with high building density

- **RE-based low temperature district heating from**
 - Solar heating plants with seasonal storage
 - Geothermal heating plant
 - Waste heat from RE-based processes of industry and energy system (power – fuels – storage – power)

In areas with low building density

- **Heat pumps using RE-based electrical energy from**
 - Hydro, Wind, PV

New low energy buildings (2020)

Single family houses

Low temperature district heating

Example: Type house improved to 2020 requirements

Area 200m² U-values of 0.06- 0.08 W/m²K

Energy for space heating 11 kWh/m²

Energy for domestic hot water 13 kWh/m²

Energy for pumps and fans 3 kWh/m²

Total - factors of 0.6 and 1.8 20 kWh/m²

Typical yearly heat supply 5000 kWh



New low energy buildings (2020)

Single family houses

Low temperature district heating

Example: RE district heating

Low temperatures: Supply 50C Return 20C

Twinpipes with small diameter pipes (14mm) in service pipes

Heat loss of 15 m service pipe: $3 \text{ W/m} \times 15\text{m} = 45\text{W}$

Heat loss of 10 m street pipe: $6 \text{ W/m} \times 10\text{m} = 60\text{W}$

Yearly heat loss of district heating pipes: 1000 kWh

**Heat loss of
district heating grid:
20% of delivered energy**




Demonstration of low temperature district heating in new LE-buildings –Lystrup Aarhus


- 40 row-houses 37 kWh/m²·yr
- DH design parameters: 50/25° C, 10 bar
- District heating network
 - AluFlex Twin pipes (insulation series 2)
 - reduced pipe sizes -> higher pressure drop
 - annual distribution heat loss approx. 15%-20%
- Substations: Domestic hot water heat exchanger
 - no problem with Legionella and comfort
- 2 years of operation , no complaints

Heat exchanger for DHW: 33kW 52/20 -10/45

www.mphe.danfoss.com



Micro Plate Heat Exchangers have a broad, flat brazing surface which adds stability to the construction.

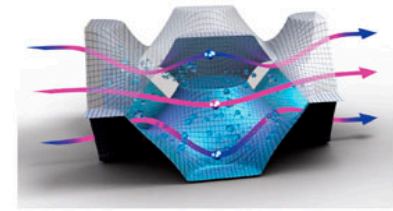

Actual measured annual consumption (28 June 2010 to 27 June 2011)

- Heat consumption* 6.2 MWh per house
- Heat loss from distribution network: 1.3 MWh per house
- Total district heating consumption**: 7.5 MWh per house

* Based on average consumption of 22 houses


** Based on main meter to the area.

- Measured electricity consumption for booster pump is
2.840 kWh per year or about: 69 kWh per house

Change of Existing buildings and existing district heating systems to RE-based low temperature district heating

Example: Building from 1906

Copenhagen - Duration curve for SH - Daily average values


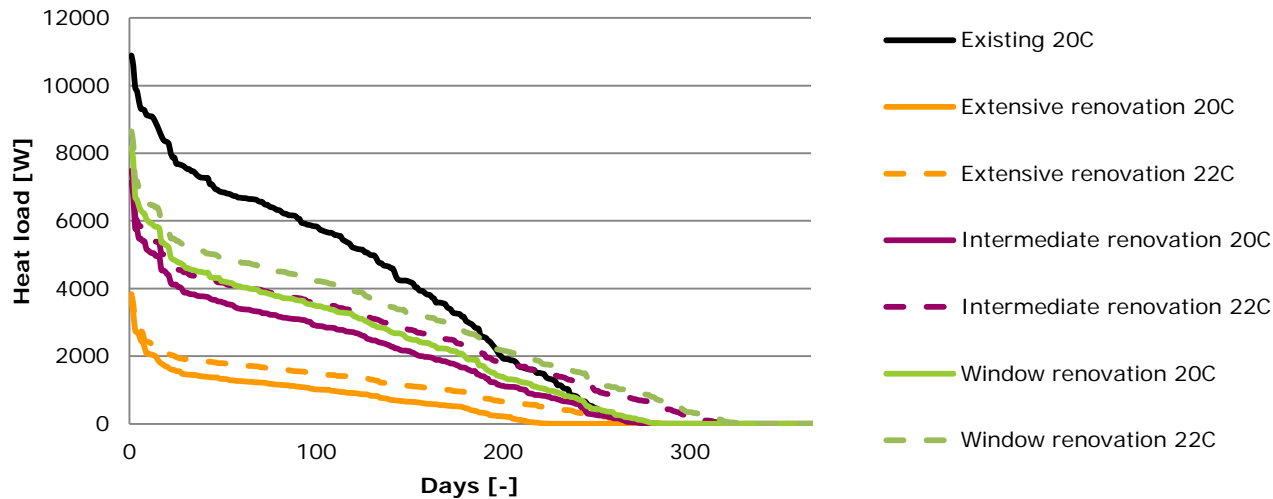


Example

Original size of radiators based on:

- constant temperatures at 20C and -12C
- no heat gain
- water temperatures of 70C-40C

New temperatures: 55C-25C and 60C in cold periods

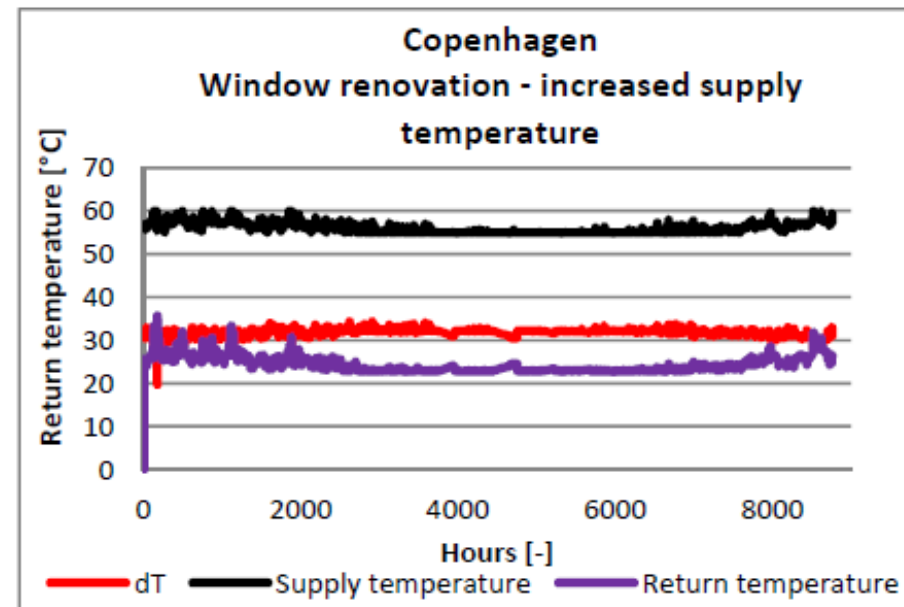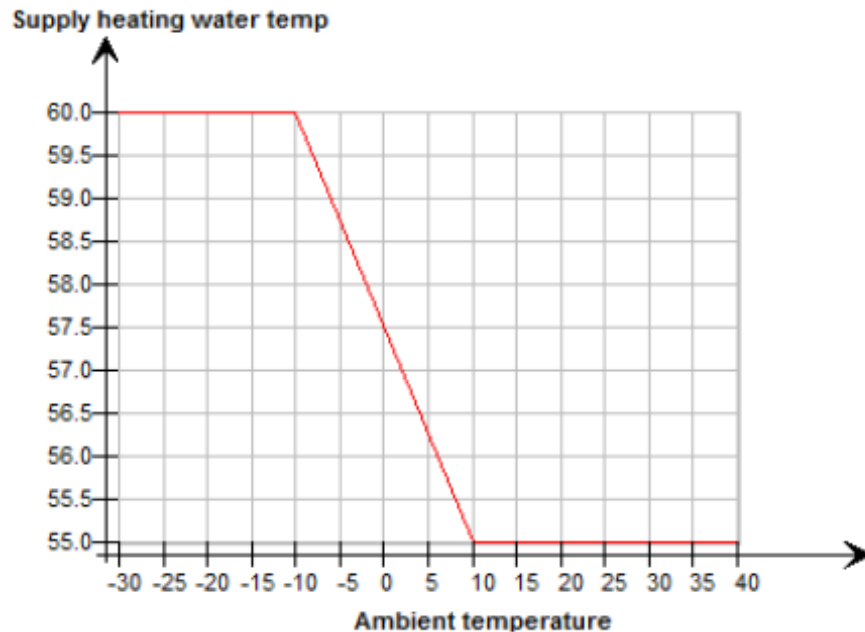

Hours with insufficient temperature in building with new windows and ventilation with heat recovery

Low temperature district heating can be used without change of radiators without discomfort

	Average of 5 days with highest daily average load	Living room 1	Living room 2	Living room 3	Bedroom 1a	Bedroom 2a	Bedroom 2b	Bedroom 3a	Bedroom 3b
Window renovation 20 °C	Ti_max [°C]	26.9	27.4	27.2	26.9	27.2	27.1	27.1	27.0
	Ti_min [°C]	18.2	18.3	18.1	19.0	19.1	18.8	18.1	18.5
	Ti<20°C	64	42	62	16	29	42	61	47
	Ti<19°C	16	13	15	0	0	5	15	10
	% hours below 20 °C	0.7	0.5	0.7	0.2	0.3	0.5	0.7	0.5
	% hours below 19 °C	0.2	0.2	0.2	0	0	0.1	0.2	0.1
	Ti<20°C with SH T _{set point} increased to 22C	0	0	0	0	0	0	0	0

Example: Copenhagen




Energy renovation of buildings and RE-based low temperature district heating

3 Scenarios




- All scenarios contain a natural replacement on 1% of the existing building mass with newly constructed buildings.
- **Reference scenario - No heat savings**
 - *Represents the extreme case where nothing is done. Supply for the full unchanged heat demand.*
- **Scenario 1 - Accelerated energy renovation from 2030-2070 (65 %)**
 - *Nothing is done in the near future due to low DH-supply prices. Investment in new capacity will increase the supply price and as a consequence heat savings are carried out.*
- **Scenario 2 - Accelerating energy renovations from today (65%)**
 - *Heat savings are implemented from today, resulting in decreased heat demand before investment in new capacity.*

Capacity – Peak loads

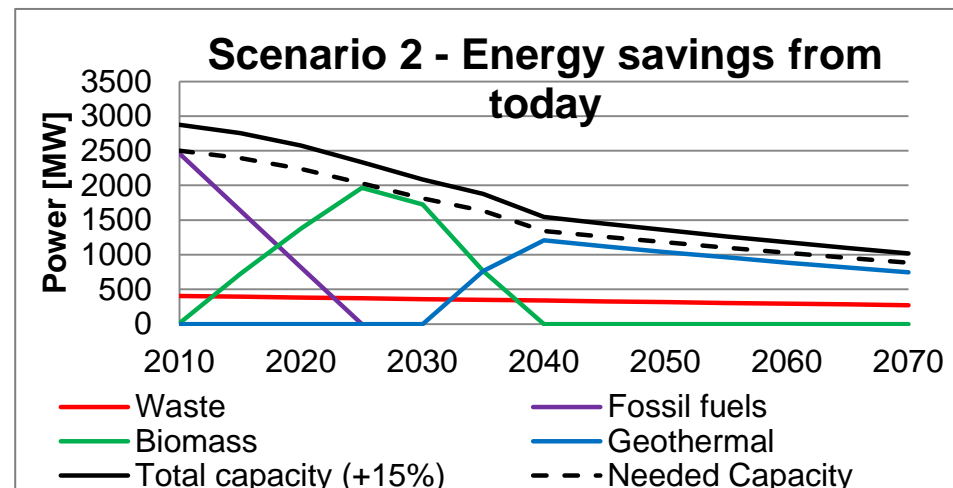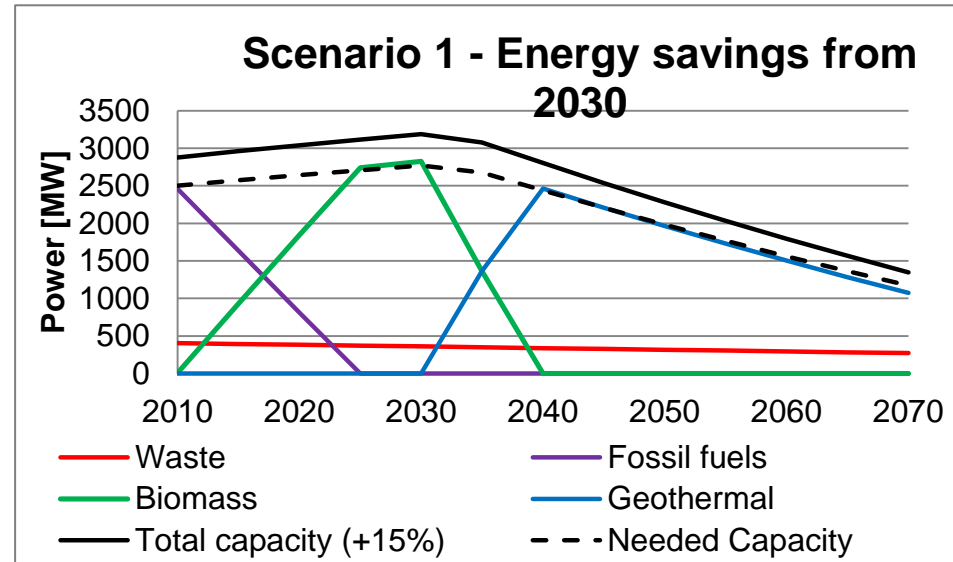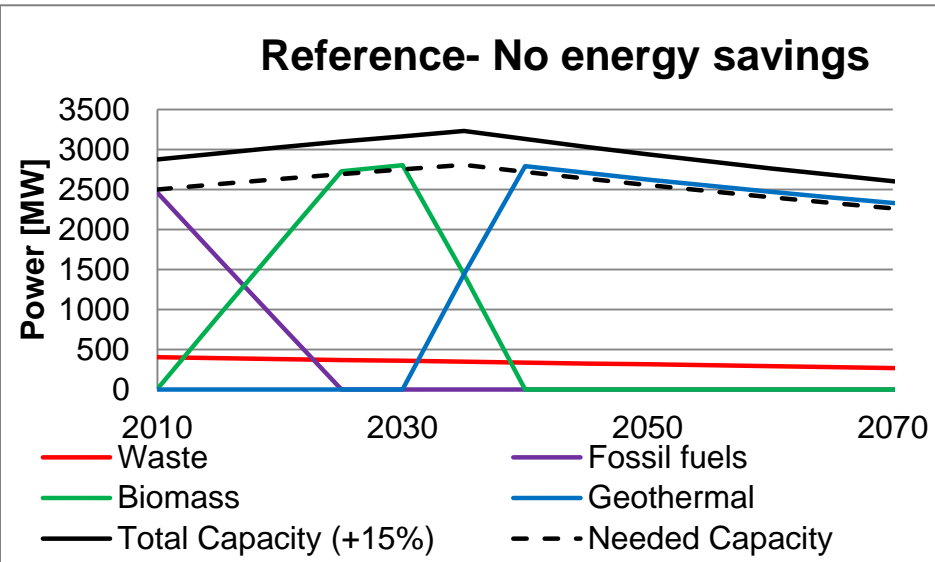


Yearly heat production 2010 - 2070


Reference – No energy savings

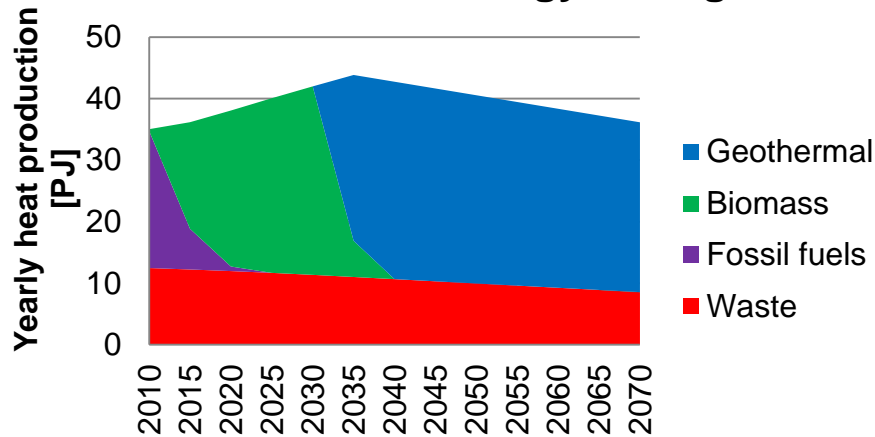

Scenario 1 – Energy savings from 2030

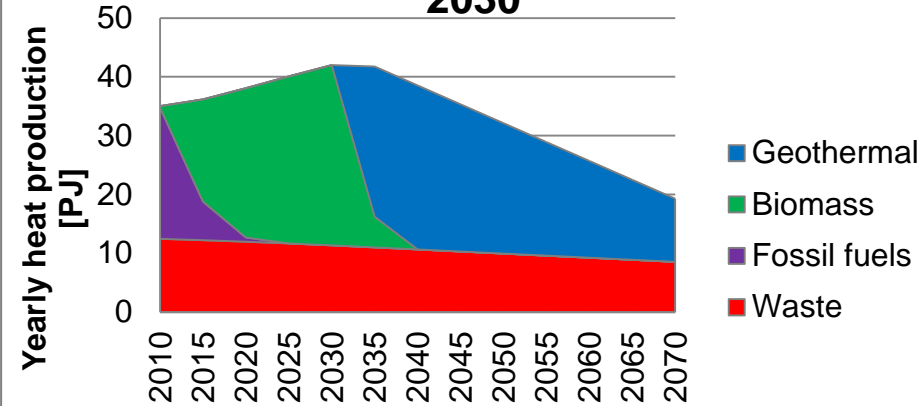

Scenario 2 – Energy savings from today

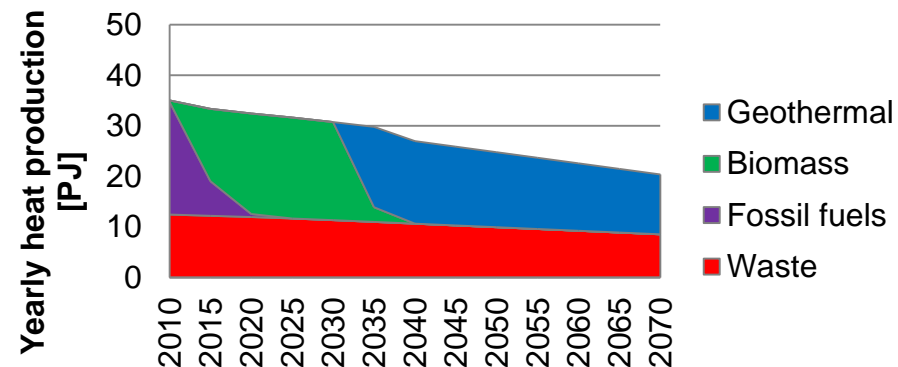

Economy for society neutral

Economy for district heating company better for scenario 2

NPV 2013-2070	Reference	Scenario 1	Scenario 2
Discount rate 0 %	[M €]	[M €]	[M €]
Investments			
<i>Geothermal plants</i>	8,736	7,644	3,744
<i>DH-net expansion</i>	187	187	187
<i>Renovations</i>	0	7,662	7,662
Salvage value	0	0	0
<i>Geothermal plants</i>	-983	-860	-421
<i>DH-net expansion</i>	-38	-38	-38
<i>Renovations</i>	0	-5,044	-1,877
Fuels	879	874	669
O&M	3,276	2,465	1,622
Total Discount rate 0 %	12,057	12,889	11,548

Economy for consumer

Table 4 Heating bill for a typical 60 m² apartment before and after energy renovation.

Heat consumption before renovation	7,980	kWh/year
Heat price 2013	0.094	€/kWh
Yearly heating bill before renovation	750	€/year
Heat consumption after renovation (65 % reduction)	2,793	kWh/year
Forecasted heat price	0.115	€/kWh
Yearly heating bill after renovation	318	€/year

Conclusion

**Energy savings in buildings first and
renewable energy supply next
replace fossil fuels
the cheapest way**