



## Design and Evaluation of a Protection Relay for a Wind Generator Based on the Positive- and Negative-Sequence Fault Components

Zheng, T. Y. ; Cha, Seung-Tae; Crossley, P. A.; Kang, Y. C.

*Published in:*  
Journal of Electrical Engineering & Technology

*Link to article, DOI:*  
[10.5370/JEET.2013.8.5.1029](https://doi.org/10.5370/JEET.2013.8.5.1029)

*Publication date:*  
2013

*Document Version*  
Early version, also known as pre-print

[Link back to DTU Orbit](#)

*Citation (APA):*  
Zheng, T. Y., Cha, S.-T., Crossley, P. A., & Kang, Y. C. (2013). Design and Evaluation of a Protection Relay for a Wind Generator Based on the Positive- and Negative-Sequence Fault Components. *Journal of Electrical Engineering & Technology*, 8(5), 1029-1039. <https://doi.org/10.5370/JEET.2013.8.5.1029>

---

### General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal

If you believe that this document breaches copyright please contact us providing details, and we will remove access to the work immediately and investigate your claim.

**Design and Evaluation of a Protection Relay for a Wind  
Generator based on the Positive- and Negative-Sequence  
Fault Components**

Journal:	<i>IEEE Transactions on Power Delivery</i>
Manuscript ID:	TPWRD-00566-2012
Manuscript Type:	Transactions
Date Submitted by the Author:	05-Jun-2012
Complete List of Authors:	Zheng, Taiying; Wind energy Grid-Adaptive Technology Research Center, Chonbuk National University Cha, Seung Tae; Dept. of Electrical Engineering, Technical University of Denmark Crossley, Peter; School of Electrical & Electronic Engineering, University of Manchester Kang, Yong Cheol; Wind energy Grid-Adaptive Technology Research Center, Chonbuk National University
Technical Topic Area :	Protection of electrical equipment < Power System Relaying, Adaptive protections < Power System Relaying
Key Words:	wind generator protection, outage zone minimization, instantaneous operation, delayed operation, non-operation, symmetrical components

# Design and Evaluation of a Protection Relay for a Wind Generator based on the Positive- and Negative-Sequence Fault Components

T. Y. Zheng, *Member, IEEE*, S. T. Cha, *Non-Member, IEEE*, P. A. Crossley and Y. C. Kang, *Members, IEEE*

**Abstract**—To avoid undesirable disconnection of healthy wind generators (WGs) or a wind power plant, a WG protection relay should discriminate among faults, so that it can operate instantaneously for WG, connected feeder or connection bus faults, it can operate after a delay for inter-tie or grid faults, and it can avoid operating for parallel WG or adjacent feeder faults. A WG protection relay based on the positive- and negative-sequence fault components is proposed in the paper. At stage 1, the proposed relay uses the magnitude of the positive-sequence component in the fault current to distinguish faults at a parallel WG connected to the same feeder or at an adjacent feeder, from other faults at a connected feeder, an inter-tie, or a grid. At stage 2, the fault type is first determined using the relationships between the positive- and negative-sequence fault components. Then, the relay differentiates between instantaneous operation and delayed operation based on the magnitude of the positive-sequence component in the fault current. Various fault scenarios involving changes in the position and type of fault and the faulted phases are used to verify the operating performance of the relay with EMTP-RV generated data. Results indicate that the relay can successfully distinguish the need for instantaneous, delayed, or non-operation.

**Index Terms**—wind generator protection, outage zone minimization, instantaneous operation, delayed operation, non-operation, and symmetrical components.

## I. INTRODUCTION

TO reduce the emission of greenhouse gases, the Kyoto Protocol on climate change represents a significant political and environmental international regimen [1]. Many countries are attempting to integrate increased amounts of renewable energy, such as wind, solar, bio-, and hydraulic energy, into their electrical networks, not only to meet the increasing demand for energy, but also to meet environmental

goals. In addition, the World Wide Fund for Nature has released “The Energy Report [2]” outlining how the world can be powered by 100% renewable energy by 2050.

Among these renewable energy resources, wind energy has become the most promising alternative due to its significant technical advances and demonstrated financial viability over the last decade. The installed capacity of wind generators (WGs) reached 196.6 GW at the end of 2010, producing 430 TWh to the worldwide electricity supply [3]. In addition, a large-scale off-shore wind power plant (WPP) has been built to minimize production cost and adverse effects on the power system operation and stability. Korea has begun construction of a 2.5 GW off-shore WPP on the western coast expected to complete in 2019.

As the penetration level of wind energy increases, more reliable protection systems for WGs and WPPs are required. Techniques for protecting a small WPP have been reported [4–6]. A source-based protection relay using a shaped directional operating characteristic was proposed in [4, 5]. The performance of a mho relay was quantitatively analyzed based on a sensitivity model for its operation margin [6]. These relays were installed at the point of common coupling, and with these if a fault occurred in the WPP, the entire plant would be disconnected.

Conventional protection relays for an individual WG were numerated [7, 8]. These methods employ over/under voltage, over/under frequency, instantaneous phase/neutral over-current for generator phase/ground faults, and inverse time phase over-current for generator overload. They can successfully protect a WG when an internal fault occurs. However, they are unable to detect a collector feeder fault or a collector bus fault and distinguish them from an inter-tie fault or a grid fault. In addition, they cannot distinguish between a connected feeder fault and an adjacent feeder fault. Thus, the outage zone can be wider than is necessary or desirable.

When a fault occurs, the outage zone should be minimized; this increases the availability of the WGs and reduces the negative impact on grid stability. To achieve this objective, the WG protection relay should operate instantaneously for a WG fault, connected feeder fault, or collection bus fault, and it should operate after a delay for an inter-tie fault or grid fault. In addition, the relay should remain stable for a fault on a parallel WG connected to the same feeder and for an adjacent feeder fault.

---

This research was supported by Basic Science Research Program through the National Research Foundation of Korea (NRF) funded by the Ministry of Education, Science and Technology (2011–0000891).

T. Y. Zheng is with the Wind energy Grid-Adaptive Technology (WeGAT) Research Centre, Chonbuk National University, Chonju, 561-756, Korea (email: huanxiong417@hotmail.com).

S. T. Cha is with the Dept. of Electrical Engineering, Technical University of Denmark, Lyngby, DK-2800, Denmark (email: stc1405@gmail.com).

P. A. Crossley is with the School of Electrical & Electronic Engineering, University of Manchester, UK (email: peter.crossley@manchester.ac.uk).

Y. C. Kang, corresponding author, is with the Dept. of Electrical Engineering and WeGAT Research Centre, and Smart Grid Research Centre, Chonbuk National University, Chonju, 561-756, Korea (e-mail: yckang@jbnu.ac.kr).

A WG protection relay based on positive- and negative-sequence fault components is proposed in this paper. The proposed relay is composed of two stages. At stage 1, the magnitude of the positive-sequence fault component is used to discriminate a fault on a parallel WG connected to the same feeder, or on an adjacent feeder, from the other faults requiring an instantaneous or delayed tripping response. At stage 2, the relay employs an instantaneous directional algorithm using the positive-sequence fault components to discriminate short-circuit faults internal to the generator from other faults. The type of fault is first evaluated using the relationships between the positive- and negative-sequence fault components. Then the magnitude of the positive-sequence fault component is used to decide between instantaneous or delayed operation. To verify the performance of the proposed relay, various fault scenarios involving changes in the position and type of fault and the phases involved in the fault are modelled using an EMTP-RV simulator.

## II. WPP MODEL AND WG RELAY FUNCTIONS

### A. Configuration of a WPP

Fig. 1 shows a model of the 100 MW WPP studied in this paper. Ten medium voltage (MV) power collection feeders (22.9 kV) are connected to a collector bus, which is connected to the strong grid (345 kV) through a main transformer, substation bus, and parallel inter-tie lines. Five induction generators, each rated at 2 MW, are connected to each feeder through step-up transformers. All WGs are fixed-speed asynchronous squirrel-cage induction generators.

In this paper, a fault current limiter (FCL) is assumed to be installed beside a circuit breaker (CB) on each feeder, as shown in Fig. 1. The reason is as follows. Although the grounding impedance of the main transformer can limit the fault current for a single line-to-ground (SLG) or double line-to-ground (DLG) fault, it is not effective for a line-line (LL) or three-phase (3P) fault. Therefore, FCLs are often used in a large WPP to limit the fault current [9, 10].

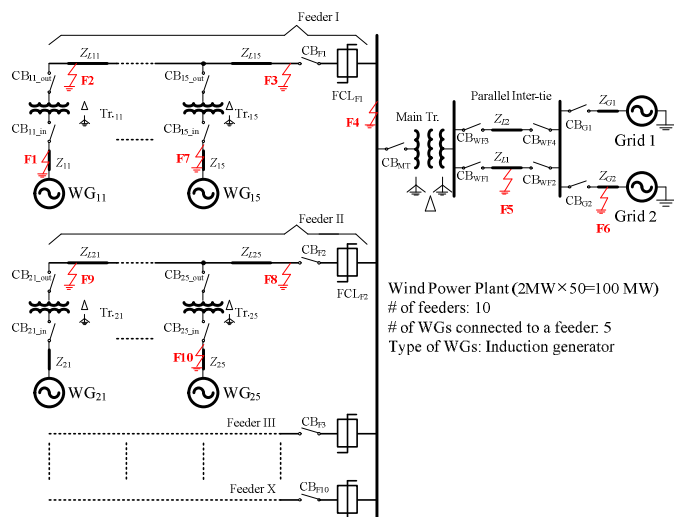


Fig. 1. WPP model.

The characteristics of a fault current depend on the winding connection of a step-up transformer and substation transformer. A grounded-ye-delta transformer is used as a step-up transformer in a WG. This is because the delta connection provides isolation of a WG from the zero-sequence behavior of the collector feeder, and the grounded-ye connection provides a solid ground for the low-voltage side of the WG [11]. A grounded-ye-grounded-ye transformer with a delta tertiary, which is mostly used as a substation transformer [12], is modeled in this paper.

### B. Required WG Relay Functions

This subsection describes the WG (i.e., WG<sub>11</sub>, connected to Feeder I) protection relay's functions to minimize an outage zone. Table I shows the functions that the WG protection relay should have. The cases F1–F10 illustrated in Fig. 1 show the fault positions.

F1 depicts a case of an internal fault of the WG<sub>11</sub>, while F2 and F3 depict cases of connected feeder faults. F4 depicts a collector bus fault. In the cases F1–F4, the relay for the WG<sub>11</sub> should operate instantaneously.

F5 depicts an inter-tie fault. In this case, the WG relay operation depends on the configuration of the inter-tie, single- or multiple-lines. The relay for WG<sub>11</sub> for a single-line should operate instantaneously. However, for multiple-lines, the relay should detect the fault and operate with a delay. In this paper, the configuration of the inter-tie assumes multiple-lines, which is necessary for a large WPP. Thus, the WG relay should operate with a delay. The delay time should be determined considering the coordination time between the corresponding relays.

F6 indicates a grid fault, which is located far from a WG. Modern grid codes in many countries require that a WG or WPP protection relay should have a low voltage ride-through (LVRT) capability in this case. Therefore, the WG relay should be carefully designed to have LVRT capability that considers the grid codes of each country.

F7 depicts an internal fault on another WG (WG<sub>15</sub>) connected to the same feeder. In this situation, the relay for WG<sub>15</sub> should operate instantaneously, while the relay for WG<sub>11</sub> should not operate. F8–F10 depict adjacent feeder faults, including an internal fault of a WG connected to an adjacent feeder, for which the relay for WG<sub>11</sub> should not operate.

## III. PROTECTION RELAY FOR A WG BASED ON POSITIVE- AND NEGATIVE-SEQUENCE FAULT COMPONENTS

This paper uses the fault component of the current at the relaying point, which is defined as the fault-generated current, instead of the measured current at the relaying point. The fault component of the current at the relaying point is obtained by

TABLE I  
REQUIRED RELAY FUNCTIONS FOR WG<sub>11</sub> TO MINIMIZE AN OUTAGE ZONE

Fault positions	Fault types	Required relay operation
F1–F4	SLG, LL, DLG, 3P	Instantaneous operation
F5–F6		Delayed operation
F7–F10		Non-operation

1 subtracting the load current from the measured current after  
 2 the fault inception. It can be assumed that the magnitude of the  
 3 load current during a very short period (e.g., two or three  
 4 cycles) after the fault inception remains the same as that prior  
 5 to the fault. In this paper, the fault component of the current is  
 6 calculated by subtracting the load current from the measured  
 7 current at the relaying point during the fault, as in [13].

8 The proposed algorithm is composed of two stages. At  
 9 stage 1, the magnitude of a positive-sequence fault component  
 10 is used to distinguish F7–F10 faults from F1–F4 and F5/F6  
 11 faults. At stage 2, F1–F4 faults are distinguished from F5/F6  
 12 faults. First, the fault direction is discriminated using an  
 13 instantaneous directional algorithm based on the positive-  
 14 sequence fault components to distinguish F1 faults (forward  
 15 faults) from F2–F4 and F5/F6 faults (backward faults). Then,  
 16 the type of fault, i.e., SLG, LL, DLG, or 3P, is evaluated using  
 17 the relationships between the positive- and negative-sequence  
 18 fault components, which depend on the type of fault. Finally,  
 19 the magnitude of the positive-sequence fault component is  
 20 used to decide on either instantaneous operation (F2–F4  
 21 faults) or delayed operation (F5/F6 faults).

#### 22 A. Stage 1: Distinguishing F7–F10 Faults (Non-Operation) 23 from F1–F4 and F5/F6 Faults (Instantaneous or Delayed 24 Operation)

25 In this stage, the magnitude of a positive-sequence fault  
 26 component is used to distinguish faults at F7–F10 from those  
 27 at F1–F4 and F5/F6. When a fault occurs at F7–F10, the relay  
 28 for a WG connected to the healthy feeder would “see” the  
 29 fault through its step-up transformer and the FCL installed at  
 30 the faulted feeder. The impedance seen for the fault from the  
 31 WG is so large that the fault current flowing out is limited to a  
 32 small value, which is similar to a normal load current. The  
 33 threshold  $K_{ini}$  can be decided based on fault analysis of the  
 34 studied system.

35 On the other hand, the relay for another WG connected to  
 36 the faulted feeder would “see” the fault only through its step-  
 37 up transformer. For this reason, the magnitude of a positive-  
 38 sequence fault component is increased significantly.

39 Consequently, an internal fault of another WG connected to  
 40 the same feeder or an adjacent feeder, for which the relay  
 41 should not operate, can be discriminated successfully based on  
 42 the magnitude of the positive-sequence fault component.

#### 43 B. Stage 2: Distinguishing F1–F4 Faults (Instantaneous 44 Operation) from F5/F6 Faults (Delayed Operation)

45 In this stage, the proposed relay discriminates F1–F4 faults  
 46 (instantaneous operation) from F5/F6 faults (delayed  
 47 operation). Among these faults, only F1 faults are forward  
 48 faults while the other faults, i.e., F2–F4 and F5/F6 faults, are  
 49 backward faults. To do this, a directional algorithm based on  
 50 the positive-sequence fault components [13] is used.

51 For a forward fault, the phase relationship between the  
 52 positive-sequence fault components at the relay location is:

$$53 \theta_{direction} = \angle V_{Raf}^{+-} - \angle I_{Raf}^{+} \approx -90^{\circ} \quad (1)$$

54 where  $V_{Raf}^{+}$  and  $I_{Raf}^{+}$  are the positive-sequence fault  
 55 components.

For a backward fault, the phase relationship is:

$$56 \theta_{direction} = \angle V_{Raf}^{+-} - \angle I_{Raf}^{+} \approx 90^{\circ} \quad (2)$$

Considering the errors involved in the measuring process  
 and the sensitivity of the relay, the criteria for a forward fault  
 and backward fault are set as:

$$57 -180^{\circ} + \delta \leq \theta_{direction} \leq -\delta \quad (3)$$

$$58 \delta \leq \theta_{direction} \leq 180^{\circ} - \delta, \quad (4)$$

where  $\delta$ , the blocking angle, is set to be  $30^{\circ}$  in this paper.

The magnitude of a fault current depends on the distance  
 from the relaying point for the same type of fault. However, a  
 fault current of a 3P fault at a distant location can be larger  
 than that of an LL fault at a closer position. For example, the  
 fault current for the F5\_3P fault can be larger than that of  
 F4\_LL fault. Thus, to decide whether the fault from the  
 relaying point is far or close, fault type classification is  
 necessary. In this paper, the fault type is evaluated first to  
 clearly discriminate F2–F4 faults (instantaneous operation)  
 from F5/F6 faults (delayed operation).

Conventionally, the zero-sequence current has been used to  
 distinguish the grounded fault and phase-to-phase fault.  
 However, it is unable to evaluate the four kinds of fault types,  
 i.e., SLG, LL, DLG, and 3P. In addition, the zero-sequence  
 current does not flow through the relaying point due to the  
 grounded-wye-delta connection of the step-up transformer of a  
 WG, as shown in Fig. 1.

Thus, in this paper, an algorithm to evaluate the type of  
 fault based on the positive- and negative-sequence fault  
 components at the relaying point is proposed. Fig. 2 shows the  
 sequence-network connections for four types of faults. In Fig.  
 2, a solid line indicates the corresponding WG and a dotted  
 line indicates the other WGs, collector feeder, and  
 transmission system.

#### 59 1) For an SLG fault

In Fig. 2a,  $I_{Raf}^{+}$  and  $I_{Raf}^{-}$  are the positive- and negative-  
 sequence fault components at the relaying point, respectively.  
 $I_{Faf}^{+}$ ,  $I_{Faf}^{-}$ , and  $I_{Faf}^0$  are the positive-, negative-, and zero-  
 sequence fault components at the fault point, respectively. It  
 is well known that the relationship between the symmetrical  
 components of the fault current at the fault point is:

$$60 I_{Faf}^{+} = I_{Faf}^{-} \times \mathbf{K} = I_{Faf}^0 \times \mathbf{K}^2, \quad (5)$$

where  $\mathbf{K}$  is 1,  $1 \angle -120^{\circ}$  or  $1 \angle 120^{\circ}$  for the faulted phase of  
 phase A, phase B, and phase C, respectively. Phase A is  
 selected as a reference frame [14].

From the positive- and negative-sequence networks, the  
 relationships between the fault components of the relaying  
 point and the fault point are:

$$61 I_{Raf}^{+} = \mathbf{K}_{+} \times I_{Faf}^{+} \quad (6)$$

$$62 I_{Raf}^{-} = \mathbf{K}_{-} \times I_{Faf}^{-}, \quad (7)$$

where both  $\mathbf{K}_+$  and  $\mathbf{K}_-$  are vector coefficients that depend on the positive- and negative-sequence networks. It can be assumed that  $\mathbf{K}_+$  equals  $\mathbf{K}_-$ , since the positive- and negative-sequence networks have the same topology.

From (5)–(7), the relationship between the positive- and negative-sequence fault components at the relaying point can be given as:


$$\mathbf{I}_{Raf}^+ = \mathbf{I}_{Raf}^- \times \mathbf{K} \quad (8)$$

Equation (8) can be rewritten in terms of magnitude and phase angle as:


$$|\mathbf{I}_{Raf}^+| = |\mathbf{I}_{Raf}^-| |\mathbf{K}| = |\mathbf{I}_{Raf}^-| \quad (9)$$

$$\angle \mathbf{I}_{Raf}^+ = \angle \mathbf{I}_{Raf}^- + \angle \mathbf{K} \quad (10)$$


Considering the phase angle shift ( $60^\circ$ ) of a step-up transformer, the phase angle difference ( $\theta_{diff}$ ) can be represented by:

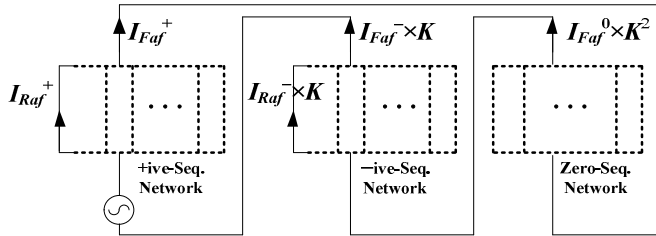


(a) Sequence-network connection for an SLG fault

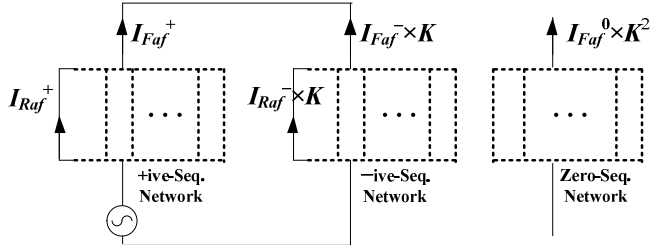

(b) Sequence-network connection for an LL fault

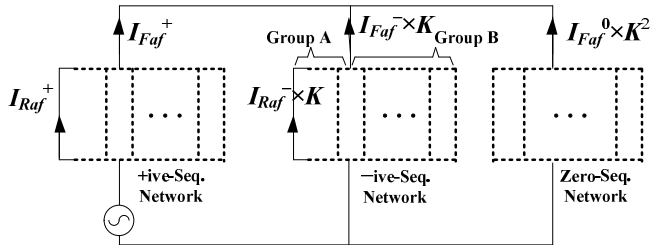

(c) Sequence-network connection for a DLG fault

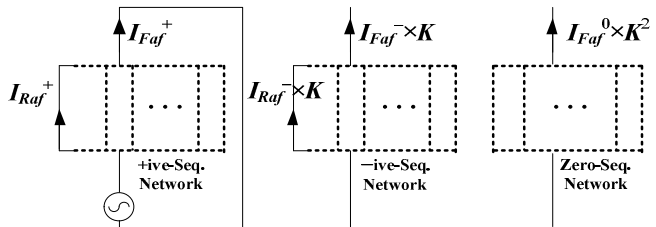

(d) Sequence-network connection for a 3P fault

Fig. 2. Sequence-network connections for four types of fault.

$$\theta_{diff} = \angle \mathbf{I}_{Raf}^+ - \angle \mathbf{I}_{Raf}^- = 60^\circ, -60^\circ \text{ or } 180^\circ \quad (11)$$

In conclusion, when an SLG fault occurs at F2–F6,  $|\mathbf{I}_{Raf}^+|$  is equal to  $|\mathbf{I}_{Raf}^-|$ , and  $\theta_{diff}$  is  $60^\circ$ ,  $-60^\circ$ , or  $180^\circ$ , depending on the faulted phase.

### 2) For an LL fault

In Fig. 2b, the relationship between the symmetrical components of the fault current for an LL fault is given by:

$$\mathbf{I}_{Faf}^+ + \mathbf{I}_{Faf}^- \times \mathbf{K} = 0 \quad (12)$$

where  $\mathbf{K}$  is 1,  $1\angle -120^\circ$ , or  $1\angle 120^\circ$  for a B-C-phase, C-A-phase, or A-B-phase LL fault, respectively.

The relationships between the fault components of the relaying point and the fault point are the same as (6) and (7). Substituting (6) and (7) into (12) gives:

$$\mathbf{I}_{Raf}^+ + \mathbf{I}_{Raf}^- \times \mathbf{K} = 0 \quad (13)$$

Equation (13) can be interpreted as:

$$|\mathbf{I}_{Raf}^+| = |\mathbf{I}_{Raf}^-| |\mathbf{K}| = |\mathbf{I}_{Raf}^-| \quad (14)$$

$$\angle \mathbf{I}_{Raf}^+ = \angle \mathbf{I}_{Raf}^- + 180^\circ + \angle \mathbf{K} \quad (15)$$

Considering the phase angle shift effect of a step-up transformer,  $\theta_{diff}$  can be calculated by:

$$\theta_{diff} = \angle \mathbf{I}_{Raf}^+ - \angle \mathbf{I}_{Raf}^- = 180^\circ, 60^\circ \text{ or } -60^\circ \quad (16)$$

In conclusion, when an LL fault occurs at F2–F6,  $|\mathbf{I}_{Raf}^+|$  is equal to  $|\mathbf{I}_{Raf}^-|$ , and  $\theta_{diff}$  is  $-120^\circ$ ,  $120^\circ$ , or  $0^\circ$ , depending on the faulted phase.

### 3) For a DLG fault

For a DLG fault, the relationship between the symmetrical components of the fault current can be given by:

$$\mathbf{I}_{Faf}^+ + \mathbf{I}_{Faf}^- \times \mathbf{K} + \mathbf{I}_{Faf}^0 \times \mathbf{K}^2 = 0 \quad (17)$$

where  $\mathbf{K}$  is 1,  $1\angle -120^\circ$ , or  $1\angle 120^\circ$  for a B-C-phase, a C-A-phase, or an A-B-phase DLG fault, respectively.

The zero-sequence component of the fault current at the relaying point does not exist due to the connection of a step-up transformer. Thus, (17) cannot be used directly.

For a zero-sequence network, the equivalent impedance can be approximated as that of an FCL.

The negative-sequence network is composed of parallel connection of two groups, i.e., group A and group B in Fig. 2c. The equivalent impedance of group A depends on the number of included WGs, and it can be assumed to be the negative source impedance of a WG divided by the number of WGs. On the other hand, the equivalent impedance of group B can be assumed to be the impedance of an FCL, because it is

larger than the impedance of the transmission system and smaller than that of the WGs. Since the equivalent impedance of group B is even smaller than that of group A, the equivalent impedance of the negative-sequence network can be assumed to be the impedance of the FCL.

Consequently, the equivalent impedance of a negative-sequence network can be regarded as that of a zero-sequence network, and the following relationship of (18) is valid.

$$\mathbf{I}_{Faf}^- \times \mathbf{K} \approx \mathbf{I}_{Faf}^0 \times \mathbf{K}^2 \quad (18)$$

Substituting (18) into (17) gives:

$$\mathbf{I}_{Faf}^+ + 2\mathbf{I}_{Faf}^- \times \mathbf{K} = 0 \quad (19)$$

In a general case, the coefficient “2” of  $|\mathbf{I}_{Faf}^-|$  can be replaced by scalar coefficient  $g$ , i.e.:

$$\mathbf{I}_{Faf}^+ + g\mathbf{I}_{Faf}^- \times \mathbf{K} = 0 \quad (20)$$

where  $g$  is approximately 2, depending on the topologies of the negative- and zero-sequence network.

Consequently, for a DLG fault, the relationship between the fault components at the relaying point can be obtained by:

$$\mathbf{I}_{Raf}^+ + g\mathbf{I}_{Raf}^- \times \mathbf{K} = 0 \quad (21)$$

Thus,

$$\left| \mathbf{I}_{Raf}^+ \right| = g \left| \mathbf{I}_{Raf}^- \right| \left| \mathbf{K} \right| = g \left| \mathbf{I}_{Raf}^- \right| > \left| \mathbf{I}_{Raf}^- \right| \quad (22)$$

In conclusion, when a DLG fault occurs at F2–F6,  $|\mathbf{I}_{Raf}^+|$  is larger than  $|\mathbf{I}_{Raf}^-|$ .

#### 4) For a 3P fault

When a 3P fault occurs, there are no negative- and zero-sequence components flowing through the fault point. Consequently, there is also no negative-sequence fault component flowing through the relaying point.

Table II summarizes the relationships of the symmetrical currents at the fault point and the relaying point for four types of faults. Since the type of fault is evaluated, the faults at F2–F4 can be distinguished from F5/F6 based on the magnitude of the positive-sequence fault component. Consequently, the WG relay can decide on delayed operation or instantaneous operation.

TABLE II  
RELATIONSHIPS OF THE SYMMETRICAL CURRENTS AT THE FAULT POINT AND THE RELAYING POINT FOR FOUR TYPES OF FAULTS

Fault type	Currents (Fault point)	Currents (Relaying point)
SLG	$\mathbf{I}_{Faf}^+ = \mathbf{K}\mathbf{I}_{Faf}^- = \mathbf{K}^2\mathbf{I}_{Faf}^0$	$\mathbf{I}_{Raf}^+ = \mathbf{K}\mathbf{I}_{Raf}^-$
LL	$\mathbf{I}_{Faf}^+ + \mathbf{K}\mathbf{I}_{Faf}^- = 0$	$\mathbf{I}_{Raf}^+ + \mathbf{K}\mathbf{I}_{Raf}^- = 0$
DLG	$\mathbf{I}_{Faf}^+ + \mathbf{K}\mathbf{I}_{Faf}^- + \mathbf{K}^2\mathbf{I}_{Faf}^0 = 0$	$\mathbf{I}_{Raf}^+ + g\mathbf{K}\mathbf{I}_{Raf}^- = 0$
3P	$\mathbf{I}_{Faf}^- = \mathbf{I}_{Faf}^0 = 0$	$\mathbf{I}_{Raf}^- = 0$

## IV. CASE STUDIES

To verify the performance of the proposed algorithm, a WPP is modeled using the EMTP-RV simulator, as shown in Fig. 1. The configuration of the WPP was mentioned in Section 2, and the system frequency is 60 Hz. The sampling rate is 64 samples/cycle, and the voltage and current are passed through the first-order low-pass RC filter with a cutoff frequency of 1,920 Hz (half the sampling frequency).

The performance of the algorithm is verified under various fault conditions involving changes in the fault positions, the types of faults, and the faulted phases. Results for three of these cases are shown in this paper: an SLG fault at F3, an SLG fault at F5, and a DLG fault at F5.

### A. Case 1: A-Phase SLG Fault at F3 (F3\_AG)

Fig. 3 shows the results for this case, where an A-phase SLG fault occurs at Feeder I at 33.33 ms. Fig. 3a indicates the currents,  $i_{a\_WG11}$  (solid),  $i_{b\_WG11}$  (dashed), and  $i_{c\_WG11}$  (dotted), measured at the terminal of WG<sub>11</sub>. Fig. 3b shows  $i_{a\_WG21}$ ,  $i_{b\_WG21}$ , and  $i_{c\_WG21}$ . In Fig. 3c, the solid and dashed lines show  $|\mathbf{I}_{a\_WG11}^+|$  and  $|\mathbf{I}_{a\_WG21}^+|$ , respectively, which are shown in per unit quantities.

At stage 1, faults at a parallel WG connected to the same feeder or an adjacent feeder are distinguished from the other faults at a connected feeder, an inter-tie, or a grid. For reliable operation, stage 2 starts if  $|\mathbf{I}_{a\_WG11}^+|$  is larger than  $K_{ini}$  for eight consecutive samples (2.08 ms).  $K_{ini}$ , which is determined via the fault analysis, is set to be 1 in this paper. In this case,  $|\mathbf{I}_{a\_WG11}^+|$  exceeds  $K_{ini}$  at 4.69 ms after a fault inception while  $|\mathbf{I}_{a\_WG21}^+|$  does not. This is because  $|\mathbf{I}_{a\_WG21}^+|$  is limited by the large impedance of an FCL and a step-up transformer because a fault occurs at Feeder I. Therefore, WG<sub>11</sub> relay enters stage 2 at 6.77 ms after a fault inception while the WG<sub>21</sub> relay remains stable. This means that the proposed protection algorithm does not operate for an adjacent feeder fault.

At stage 2, the fault direction is determined first. In this paper, to avoid maloperation during the transient state, the fault is judged to be a backward fault if  $\theta_{direction}$  remains in the region of  $[30^\circ, 150^\circ]$  for eight consecutive samples. As shown in Fig. 3d,  $\theta_{direction}$  enters the operation region at 7.56 ms after a fault inception. Thus, the fault direction is decided as backward at 9.64 ms after a fault inception. In this paper, to determine the fault direction,  $\theta_{direction}$  is used only after  $|\mathbf{I}_{a\_WG11}^+|$  exceeds  $K_{ini}$ . Thus,  $\theta_{direction}$  at stage 2 is shown.

After fault direction determination, to identify the fault type, we check which condition is satisfied among the four conditions in Table II for eight consecutive samples. For an SLG and an LL fault,  $|\mathbf{I}_{a\_WG11}^+|/|\mathbf{I}_{a\_WG11}^-|$  is one; for a 3P fault, it is infinite, and for a DLG fault, it is larger than one. In addition, for an SLG fault,  $\theta_{diff}$  is either  $60^\circ$ ,  $-60^\circ$ , or  $180^\circ$ , while for an LL fault,  $\theta_{diff}$  is either  $0^\circ$ ,  $-120^\circ$ , or  $120^\circ$ .

As mentioned above, for an SLG fault,  $|\mathbf{I}_{a\_WG11}^+|/|\mathbf{I}_{a\_WG11}^-|$  should be one. However, as shown in Figs. 3c and 3f,  $|\mathbf{I}_{a\_WG11}^+|$  is slightly larger than  $|\mathbf{I}_{a\_WG11}^-|$  after a fault. Thus, after a fault,  $|\mathbf{I}_{a\_WG11}^+|/|\mathbf{I}_{a\_WG11}^-|$  is less than one (see Fig. 3e). Hence, it can be judged to be either an SLG or an LL fault. In addition, as shown in Fig. 3g,  $\theta_{diff}$  slightly decreases as time goes on.

However, it is near  $60^\circ$ , so the fault type can be identified as an A-phase SLG fault. This is because the fault type is classified if the condition is satisfied for only eight consecutive samples.  $|I_{a\_WG11}^+|/|I_{a\_WG11}^-|$  and  $\theta_{diff}$  after fault

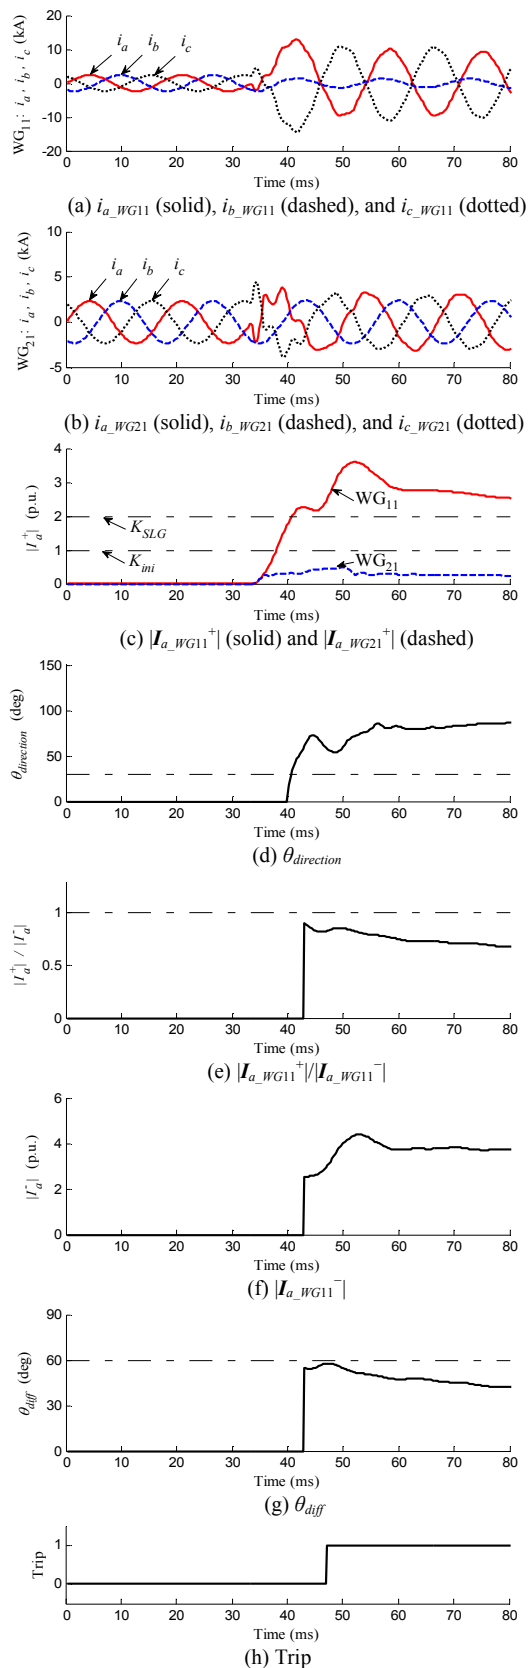


Fig. 3. Results for F3\_AG.

direction determination are shown in Figs. 3e and 3g; note that fault type identification only starts after fault direction determination.

In this paper, the different thresholds corresponding to the four fault types are used to decide on either an instantaneous or delayed trip signal. The threshold values are obtained via the fault analysis. The threshold for an SLG fault,  $K_{SLG}$ , is set to be 2. The instantaneous trip signal is activated if  $|I_{a\_WG11}^+|$  exceeds the threshold for eight consecutive samples.  $|I_{a\_WG11}^+|$  exceeds  $K_{SLG}$ , and consequently the instantaneous trip signal is activated at 13.81 ms after a fault inception (see Fig. 3h).

The results indicate that the proposed WG protection relay can operate instantaneously for a connected feeder fault and remain stable for an adjacent feeder fault.

B. Case 2: A-Phase SLG Fault at F5 (F5\_AG)

Fig. 4 shows the results for Case 2, where an A-phase SLG

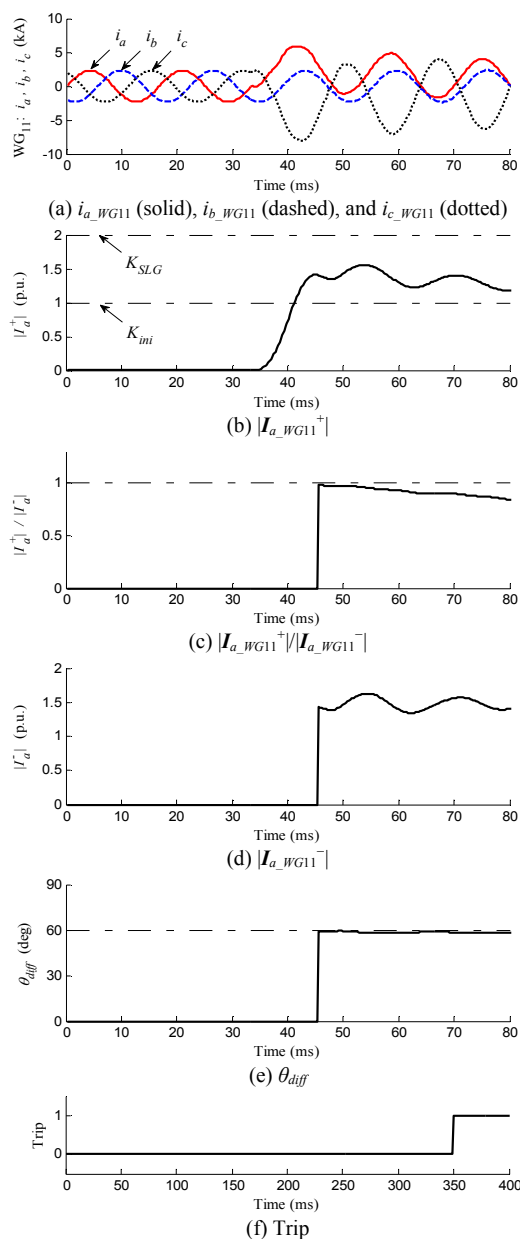


Fig. 4. Results for F5\_AG.



fault occurs at the inter-tie at 33.33 ms. In this case, the WG<sub>11</sub> protection relay should operate with a delay. At stage 1,  $|I_{a\_WG11}^+|$  exceeds  $K_{ini}$  at 8.08 ms after a fault inception. At stage 2, the proposed protection algorithm identifies the fault as an SLG fault using the same procedure as in Case 1. However,  $|I_{a\_WG11}^+|$  does not exceed  $K_{SLG}$  due to the impedance of the main transformer in the substation. Thus, the trip signal is activated at 316.17 ms after a fault inception (Fig. 4f). In this paper, the coordination time is set to be 300 ms, which is commonly used in Korean power system protection.

The results indicate that for an inter-tie fault, a delayed operation signal rather than an instantaneous operation signal is activated successfully.

### C. Case 3: DLG Fault at F5 (F5\_BCG)

Fig. 5 shows the results for Case 3; this is identical to Case 2 except for the fault type. At stage 1,  $|I_{a\_WG11}^+|$  exceeds  $K_{ini}$  at 5.21 ms after a fault inception, and thus the WG<sub>11</sub> protection relay enters stage 2.

At stage 2, for a DLG fault,  $|I_{a\_WG11}^+|/|I_{a\_WG11}^-|$  should be larger than one. As shown in Fig. 5c, a peak exceeding two is seen at 10.42 ms after a fault inception. This is because  $|I_{a\_WG11}^-|$  temporarily reduces to its minimum value, while  $|I_{a\_WG11}^+|$  keeps increasing.  $|I_{a\_WG11}^+|/|I_{a\_WG11}^-|$  decreases after

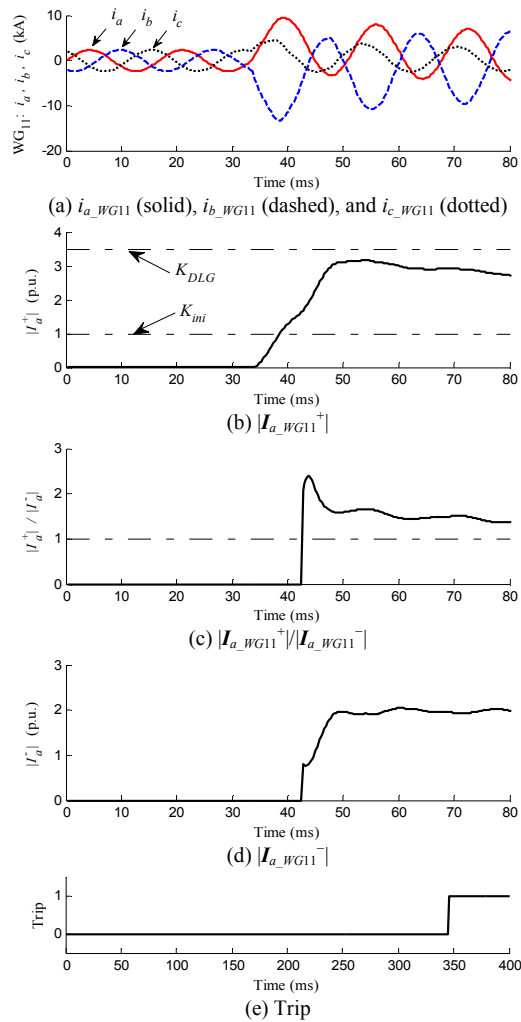


Fig. 5. Results for F5\_BCG.

the peak but is still larger than one. Thus, the fault type is identified as a DLG fault.

Next,  $|I_{a\_WG11}^+|$  is compared with  $K_{DLG}$  instead of  $K_{SLG}$ , which is set to be 3.5 in this paper. As seen in Fig. 5b,  $|I_{a\_WG11}^+|$  does not exceed  $K_{DLG}$ . Consequently, the trip signal is activated at 312.27 ms after a fault inception, considering the 300 ms coordination time (Fig. 5e).

The results indicate that the proposed WG protection relay can successfully distinguish between an instantaneous and delayed operation, irrespective of the type of fault.

## V. CONCLUSIONS

A WG protection relay based on the positive- and negative-sequence fault components is proposed in this paper. At stage 1, faults requiring an instantaneous or delayed operation are discriminated from those requiring non-operation based on the magnitude of the positive-sequence fault component. At stage 2, after fault direction determination, either instantaneous or delayed operation is decided based on fault type classification using the relationships between the positive- and negative-sequence fault components.

The performance of the proposed WG protection relay was verified using EMTP-RV generated data. The results indicate that the proposed protection relay can successfully distinguish among instantaneous, delayed, or non-operation for fault positions, irrespective of the type of fault and the faulted phases.

This paper shows only the results for a WPP consisting of induction generators. However, for a WPP consisting of other types of generators, a WG protection relay should be developed considering the characteristics of the WGs during the transient state.

The proposed relay can minimize the outage zone and thus undesirable disconnection of WPPs or healthy WGs can be avoided.

## VI. REFERENCES

- [1] Cable News Network. Clinton hails global warming pact. [Online]. Available: <http://www.cnn.com/ALLPOLITICS/1997/12/11/kyoto/>
- [2] The energy report: 100% renewable energy by 2050. World wildlife fund, Washington, DC, USA. [Online]. Available: <http://www.worldwildlife.org>
- [3] World wind energy report 2010. World wind energy association, Bonn, Germany. [Online]. Available: <http://www.wwindea.org>
- [4] S. J. Haslam, P. A. Crossley, and N. Jenkins, "Design and field testing of a source based protection relay for wind farms," *IEEE Trans. on Power Deliv.*, vol. 14, no. 3, pp. 818–823, Jul. 1999.
- [5] S. J. Haslam, P. A. Crossley, and N. Jenkins, "Design and evaluation of a wind farm protection relay," *IEE Proc. -Gener. Transm. Distrib.*, vol. 146, no. 1, pp. 37–44, Jan. 1999.
- [6] S. H. Li, S. S. Sun, and S. F. Li, "Operation characteristics of zone 3 impedance relays in wind power systems with fixed-speed induction generators," in *2011 Asia-Pacific Power and Energy Engineering Conference*, Wuhan, China, Mar. 2011.
- [7] GE Consumer & Industrial Multilin, W650-Wind generator protection system instruction manuals, 2006 GE Multilin. [online]. Available: <http://www.gedigitalenergy.com/app/ViewFiles.aspx?prod=w650&type=3>
- [8] Schweitzer Engineering Laboratories, SEL-700GW wind generator relay. [online]. Available: <http://www.selinc.com/sel-700gw/>
- [9] L. Ye and L. Z. Lin, "Study of superconducting fault current limiters for system integration of wind farms," *IEEE Trans. on Applied Superconductivity*, vol. 20, no. 3, pp. 1233–1237, Jun. 2010.

- 1 [10] E. Muljadi, V. Gevorgian, and F. Delarosa, "wind power plant  
2 enhancement with a fault current limiter," in *Proc. 2011 IEEE Power  
3 and Energy Society General Meeting*, Detroit, MI, USA, Jul. 2011.
- 4 [11] M. Reichard, D. Finney, and J. Garrity, "Wind farm system protection  
5 using peer-to-peer communications," in *Proc. IEEE 6th Annu. Conf.  
6 Protective Relay Eng.*, Mar. 27–29, 2007.
- 7 [12] Wind Plant Collector Design WG, "Wind power plant grounding,  
8 overvoltage protection, and insulation coordination," in *Proc. 2009  
9 IEEE Power and Energy Society General Meeting*, Calgary, Canada, Jul.  
10 2009.
- 11 [13] H. Gao and P. A. Crossley, "Design and evaluation of a directional  
12 algorithm for transmission-line protection based on positive-sequence  
13 fault components," *IEE Proc. –Gener. Transm. Distrib.*, vol. 153, no. 6,  
14 pp. 711–718, Nov. 2006.
- 15 [14] J. L. Blackburn and T. J. Domin, *Protective relaying principles and  
16 applications*, 3<sup>rd</sup> ed., CRC Press, Taylor & Francis Group, LLC, 2007.

## 17 VII. BIOGRAPHIES



18 **Tai Ying Zheng** (S'06–M'12) received his B.S.,  
19 M.S., and Ph.D. degrees from ZheJiang University,  
20 China, in 2004, and Chonbuk National University,  
21 Korea, in 2006 and 2011, respectively. He is  
22 currently a research professor in the Wind Energy  
23 Grid-Adaptive Technology (WeGAT) Research  
24 Center supported by the Ministry of Education,  
25 Science, and Technology, Korea. He is also a  
26 researcher in the Smart Grid Research Center in  
27 Chonbuk National University, Korea. His research  
28 interests are the development of protection systems for power systems using  
29 digital signal processing techniques and the development of new  
30 protection/control systems for wind power plants.



31 **Seung Tae, Cha** received his B.S degree in  
32 Electrical Engineering from Illinois Institute of  
33 Technology, Chicago, US, in 1992, and his M.S  
34 degree in Electrical Engineering from Yonsei  
35 University, Korea, in 1997. Upon graduation, he  
36 joined the Korea Electric Power Research Institute,  
37 KEPCO where he was actively engaged in the  
38 development of KEPS, a fully digital real-time  
39 simulator and various other research projects. He is  
40 a Ph.D candidate at the Technical University of  
41 Denmark & Korea University. His research interests  
42 include real-time simulation of power systems, integration of renewable  
43 energy, model development, studies involving load flow, and system planning  
44 and operation.



45 **Peter A. Crossley** (M'95) was born in the U.K. in  
46 1956. He received the B.Sc. degree from the  
47 University of Manchester (formerly UMIST),  
48 Manchester, U.K., in 1977 and the Ph.D. degree from  
49 the University of Cambridge, Cambridge, U.K., in  
50 1983. He is Director of the Joule Centre, Manchester,  
51 U.K., and a Professor of Electrical Engineering at the  
52 University of Manchester. He has been involved in  
53 the design and application of protection systems for  
54 many years, with GEC, ALSTOM, Queen's  
55 University Belfast, and The University of  
56 Manchester. He has published numerous technical papers on power system  
57 protection, embedded generation, and condition monitoring. Dr. Crossley is an  
58 active member of various CIGRE, IEEE, and IET committees on protection  
59 and control.



60 **Yong Cheol Kang** (S'93–M'98) received his B.S.,  
M.S., and Ph.D. degrees from Seoul National  
University, Korea, in 1991, 1993, and 1997,  
respectively. He has been with Chonbuk National  
University, Korea, since 1999. He is currently a  
professor at Chonbuk National University, Korea,  
and the director of the WeGAT Research Center  
supported by the Ministry of Education, Science, and  
Technology, Korea. He is also with Smart Grid  
Research Center in Chonbuk National University,

Korea. His research interests are the development of new protection and  
control systems for WPPs and the enhancement of wind energy penetration  
levels by keeping the capacity factor of WGs high.